

- GENERAL NOTES**
- BACKFLOW PREVENTER SHALL BE TESTED FOR PROPER OPERATION PER CITY OF SCOTTSDALE REQUIREMENTS BY A CERTIFIED TESTER RECOGNIZED BY THE CITY, BEFORE A TEMPORARY CERTIFICATE OF OCCUPANCY IS ISSUED.
 - ADEQUATE CLEARANCE SHALL BE PROVIDED AROUND FIRE RISER. DIMENSIONS FROM FACE OF PIPE SHALL MEASURE A MINIMUM OF 12" OFF THE BACK WALL, 18" ON EACH SIDE AND 36" CLEAR IN FRONT WITH A FULL HEIGHT DOOR. THE FIRE LINE SHALL EXTEND A MAXIMUM OF 3" INTO THE BUILDING FROM INSIDE FACE OF WALL TO CENTER OF PIPE.
 - RISER SHALL BE HYDROSTATICALLY TESTED AT 200 PSI FOR TWO HOURS.
 - AT #1 & #4 TEST PORTS INSTALL A 1/2" BRASS NIPPLE, TEE & PLUGS W/ 1/2" x 1/4" MALE FLARED CONNECTION W/ GAG (INSTALL PRESSURE GAUGE ON TEE OUTLET)
 - HYDRAULIC DESIGN AND SUMMARY INFORMATION PER NFPA SHALL BE ATTACHED TO RISER COVER SHEET FOR SHOP DRAWING RECORDS.
 - SPARE HEAD BOX SHALL BE MOUNTED IN AREA.
- * REDUCED-PRESSURE BACKFLOW REQUIRED WHEN F.D. CONNECTION IS WITHIN 1700 FEET OF AN AUXILIARY SUPPLY.

NOTED FIRE-RESISTANCE SAFETY Cover sheet for Shop Drawing Records Fire Protection Division

FIRE SPRINKLER RISER DETAIL WITH WALL MOUNT FD CONECTION

SCALE: NOT TO SCALE

LIST OF STANDARDS

- SILT FENCE ——— SF ———
- LIMITED OF DISTURBANCE - - - - L.O.D. - - - -
- STABILIZED CONSTRUCTION ENTRANCE

SOIL EROSION NOTES

- A SEDIMENT AND EROSION CONTROL METHOD SHALL BE INSTALLED BEFORE THE START OF ANY EXCAVATION AND/OR CONSTRUCTION AS PER STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL FOR THE DISTRICT OF COLUMBIA. IF AN ON-SITE INSPECTION REVEALS FURTHER EROSION CONTROL MEASURES ARE NECESSARY, THE SAME SHALL BE PROVIDED.
- ALL DEBRIS IS TO BE IMMEDIATELY REMOVED FROM SITE.
- STREETS/SIDWALKS SHALL BE SWEEP CLEAN AT ALL TIMES DURING EXCAVATION AND CONSTRUCTION.
- ALL CATCH BASIN AND AREA DRAINS SHALL BE PROTECTED DURING EXCAVATION AND CONSTRUCTION.
- IF ANY CATCH BASIN OR DRAINS BECOME CLOGGED AS A RESULT OF EXCAVATION OR CONSTRUCTION THE CONTRACTOR SHALL BE RESPONSIBLE FOR ITS CLEANING.
- WHEN SEDIMENT TRAP HAS REACHED 67% CAPACITY, CLEAN TRAP AS REQUIRED.
- ANY STOCKPILING, REGARDLESS OF LOCATION SHALL BE STABILIZED AND COVERED WITH PLASTIC OR CANVAS, AFTER ITS ESTABLISHMENT AND FOR DURATION OF THE PROJECT.
- AFTER REMOVALS OR DEMOLITION, PROVIDE GROUND COVER TO PREVENT EROSION AND SEDIMENT RUNOFF FROM OCCURRING, SUCH AS SEED, SOIL, PAVE, BROCKHAM OR MULCH, ETC., AS REQUIRED.

SEDIMENT CONTROL APPROVAL

PLAN NUMBER _____

DATE _____

FLOORING AND EROSION CONTROL NUMBER _____

GOVERNMENT OF THE DISTRICT OF COLUMBIA
 DISTRICT DEPARTMENT OF THE ENVIRONMENT
 NATURAL RESOURCES ADMINISTRATION
 WATERSHED PROTECTION DIVISION


Sediment Control Approval

Approved By:

Date: 11/16/14


Plan No: 111505134

Notes: This Approval is for Sediment Control Plan only. The applicant is responsible for ensuring that the approved design features are shown on these approved plans. The applicant must notify this office at least 72 hours prior to the start of maintenance activity and within 24 hours after completion of project to permit final inspection. If there is need to make any change or modifications to the approved design, the applicant is responsible to notify immediately.

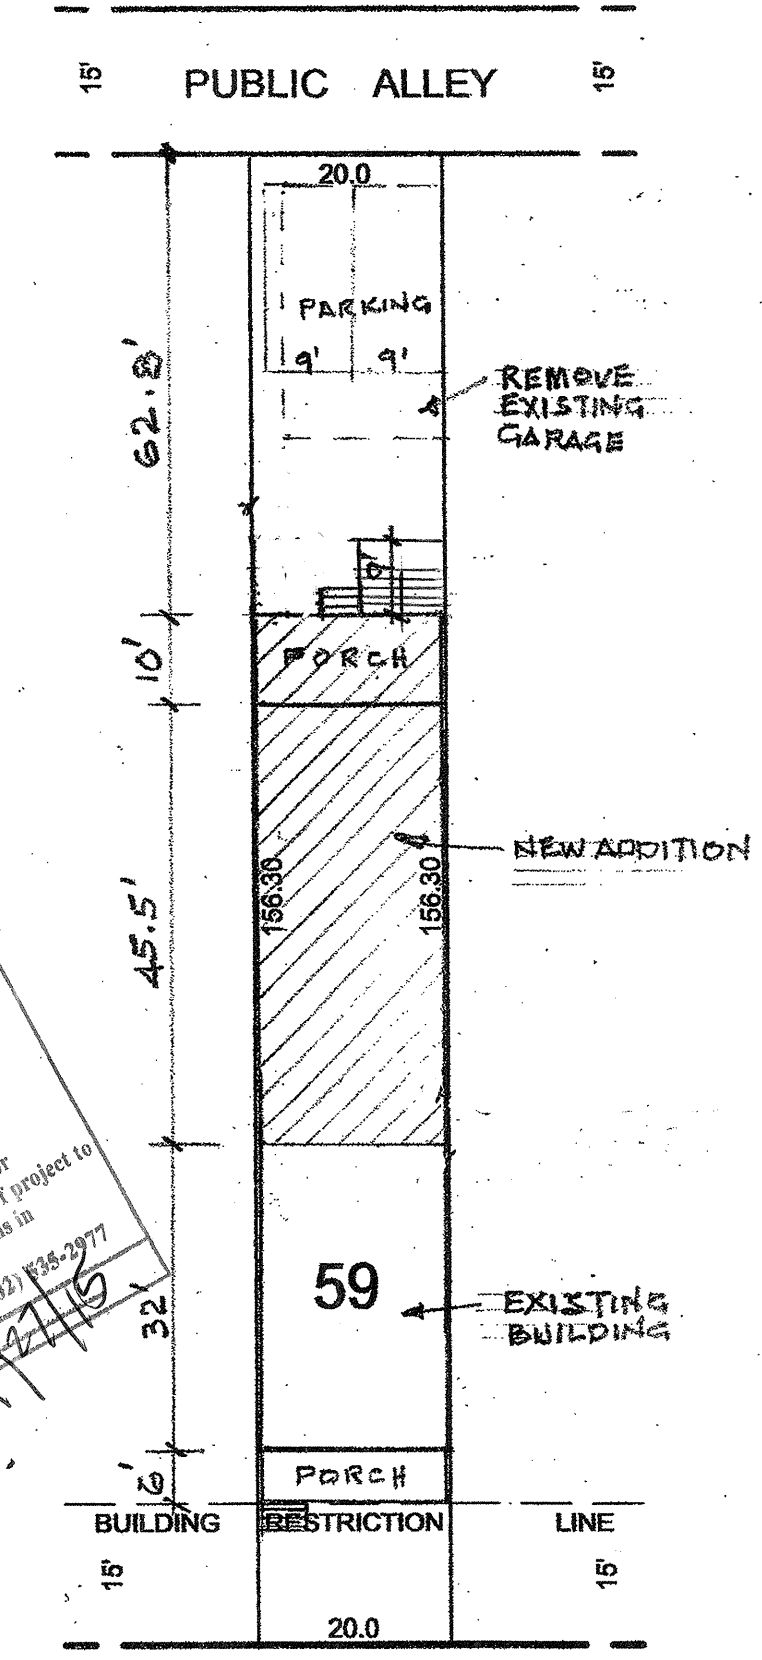

ALLISON STREET, N.W.

STABILIZED CONSTRUCTION ENTRANCE

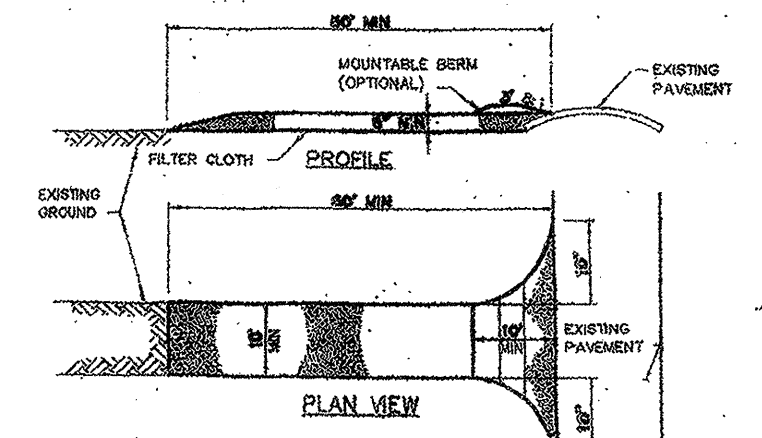

CONSTRUCTION SPECIFICATIONS

- STONE SIZE - USE 2" STONE, OR RECLAIMED OR RECYCLED CONCRETE EQUIVALENT.
 - LENGTH - AS REQUIRED, BUT NOT LESS THAN 50 FEET (EXCEPT ON A SINGLE RESIDENCE LOT WHERE A 30 FOOT MINIMUM LENGTH WOULD APPLY).
 - THICKNESS - NOT LESS THAN SIX (6) INCHES.
 - WIDTH - TEN (10) FOOT MINIMUM, BUT NOT LESS THAN THE FULL WIDTH AT POINTS WHERE INGRESS OR EGRESS OCCURS.
 - FILTER CLOTH - WILL BE PLACED OVER THE ENTIRE AREA PRIOR TO PLACING OF STONE. FILTER WILL NOT BE REQUIRED ON A SINGLE FAMILY RESIDENCE LOT.
 - SURFACE WATER - ALL SURFACE WATER FLOWING OR DIVERTED TOWARD CONSTRUCTION ENTRANCES SHALL BE PIPED ACROSS THE ENTRANCE. IF PIPING IS IMPRACTICAL, A MOUNTAIN BERM WITH 5:1 SLOPES WILL BE PERMITTED.
 - MAINTENANCE - THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND AND REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC RIGHTS-OF-WAY MUST BE REMOVED IMMEDIATELY.
 - WASHING - WHEELS SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RIGHTS-OF-WAY. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH STONE AND WHICH DRAINS INTO AN APPROVED SEDIMENT TRAPPING DEVICE.
- PERIODIC INSPECTION AND NEEDED MAINTENANCE SHALL BE PROVIDED AFTER EACH RAIN.

PROJECT DESCRIPTION

This project entails the construction of rear addition to the building as shown on plan.

Erosion & Sediment Control Plan

117 ALLISON STREET N.W.
 LOT 0059 SQUARE 2918
 WASHINGTON DC
 DATE: 07/16/14 SCALE: 1"=20'

Zone:	C
Lot Size:	3126 S.F.
Impervious Area:	
Lot Coverage Proposed:	1933 S.F.
Lot Coverage EXIST:	920 S.F.
Disturbed Area:	2106 S.F.
Volume of Cut:	87 cu. yd.
Volume of Fill:	0

C1

B1409828