
RECEIVED
D.C. OFFICE OF ZONING
2002 MAR 11 PM 1:57

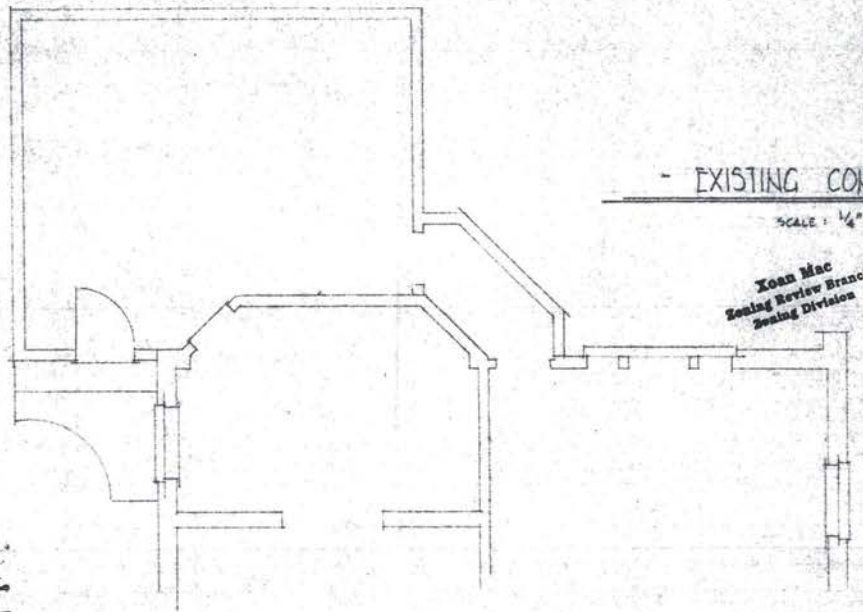


- EXISTING CONDITIONS -


SCALE: 1/4" = 1'-0"

Xoan Mac
Zoning Review Branch
Zoning Division


BZA
Case No. 16894
Exhibit No. 8


Smith, Thomas & Smith, Inc.	PABLO/ANTHONY RESIDENCE	REAR ADDITION

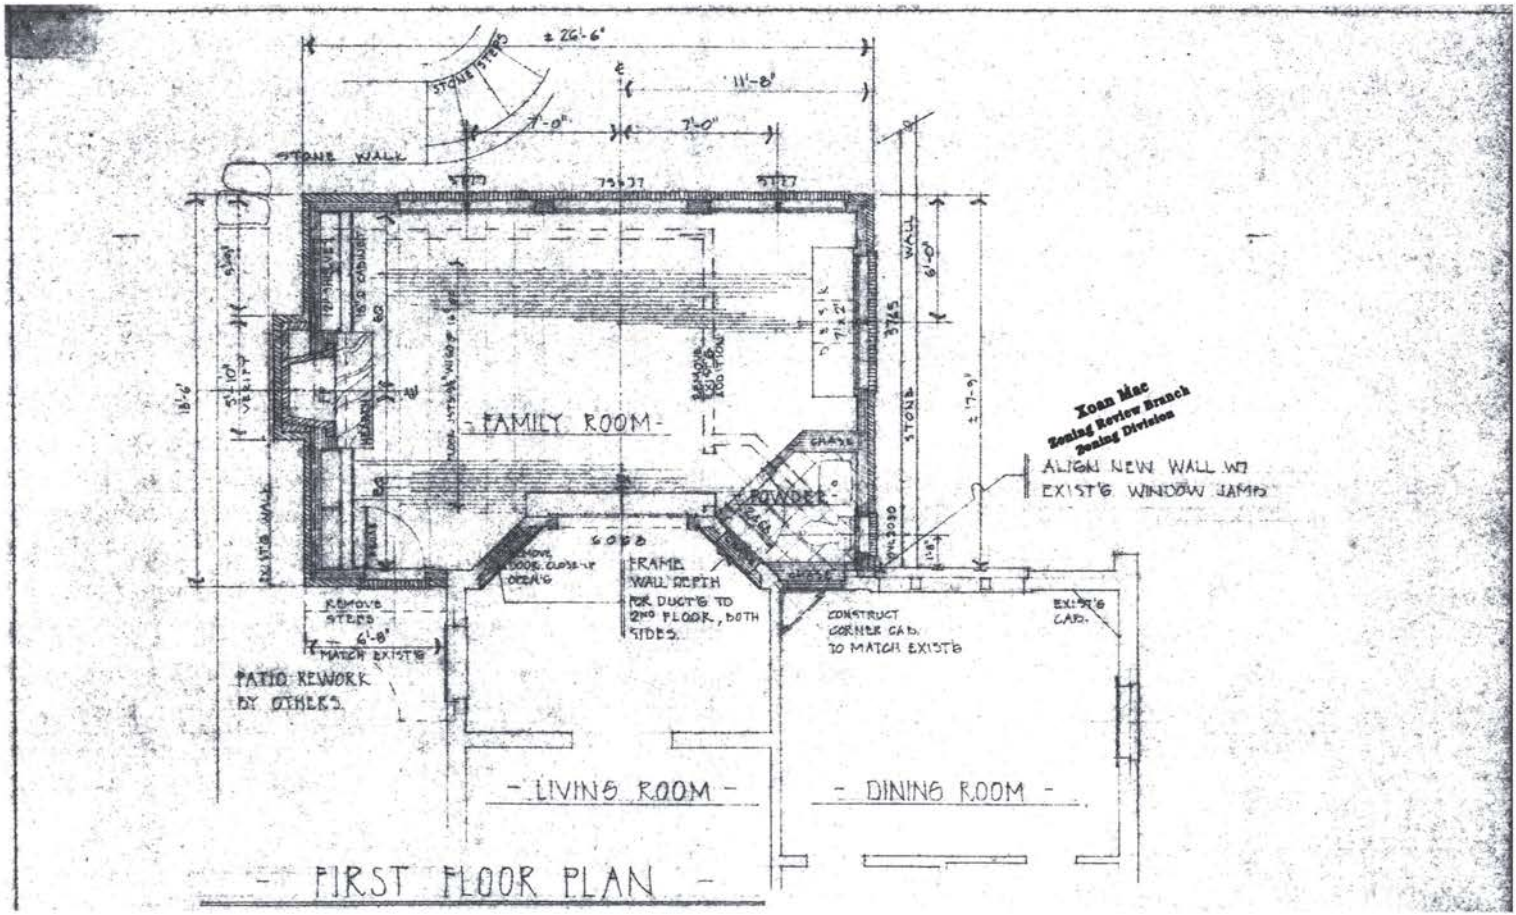

± 26'-6"
11'-8"
7'-0"
7'-0"
STONE STEPS
STONE WALL
FAMILY ROOM
POWDER
FRAME WALL WIDTH FOR DUCTS TO 2ND FLOOR, BOTH SIDES.
REMOVE DOOR, CLOSE-UP OPEN'G
REMOVE STEPS
6'-8" MATCH EXIST'G
PATIO REWORK BY OTHERS.
CONSTRUCT CORNER CAB. TO MATCH EXIST'G
EXIST'G CAB.
ALIGN NEW WALL W/ EXIST'G WINDOW JAMB
Xoan Mac
Zoning Review Branch
Zoning Division
LIVING ROOM
DINING ROOM
FIRST FLOOR PLAN

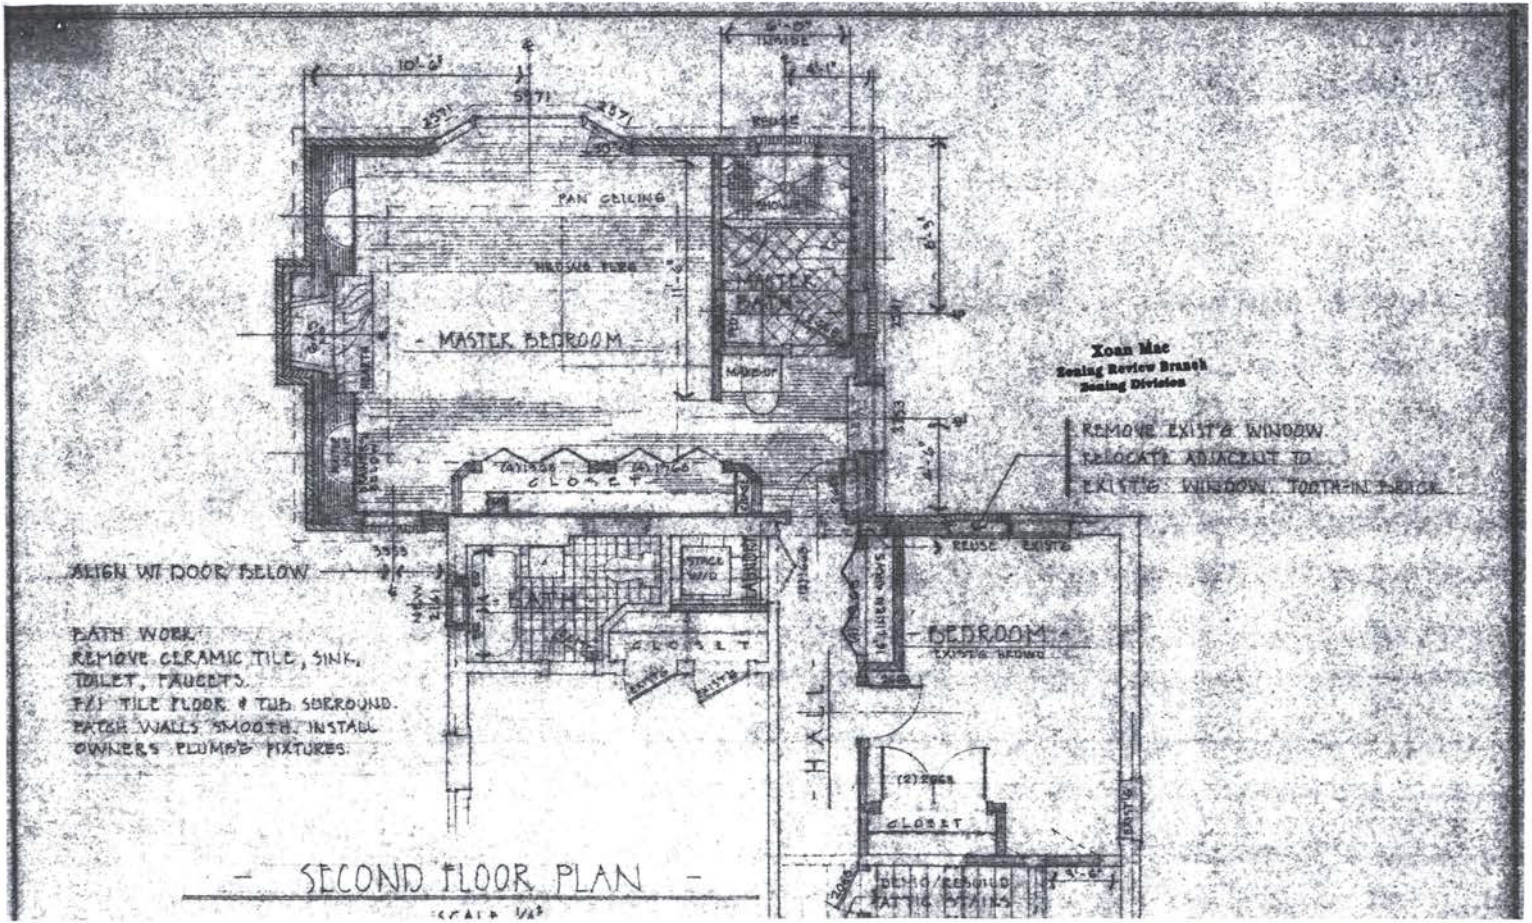



Xoan Mac
Zoning Review Branch
Zoning Division

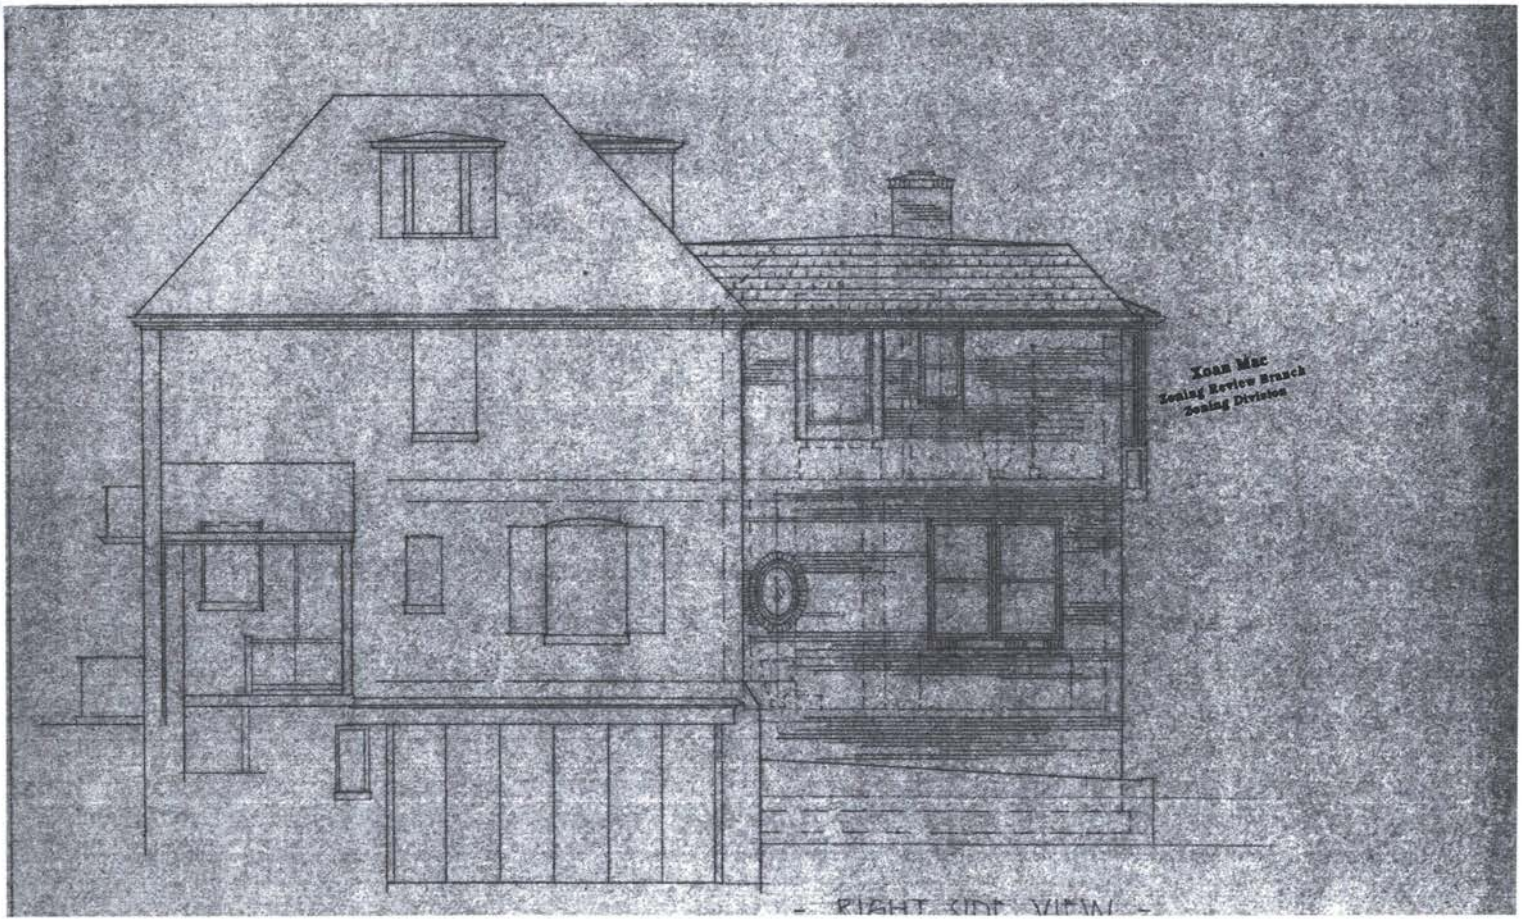

Xuan Mac
Zoning Review Branch
Zoning Division
- RIGHT SIDE VIEW -

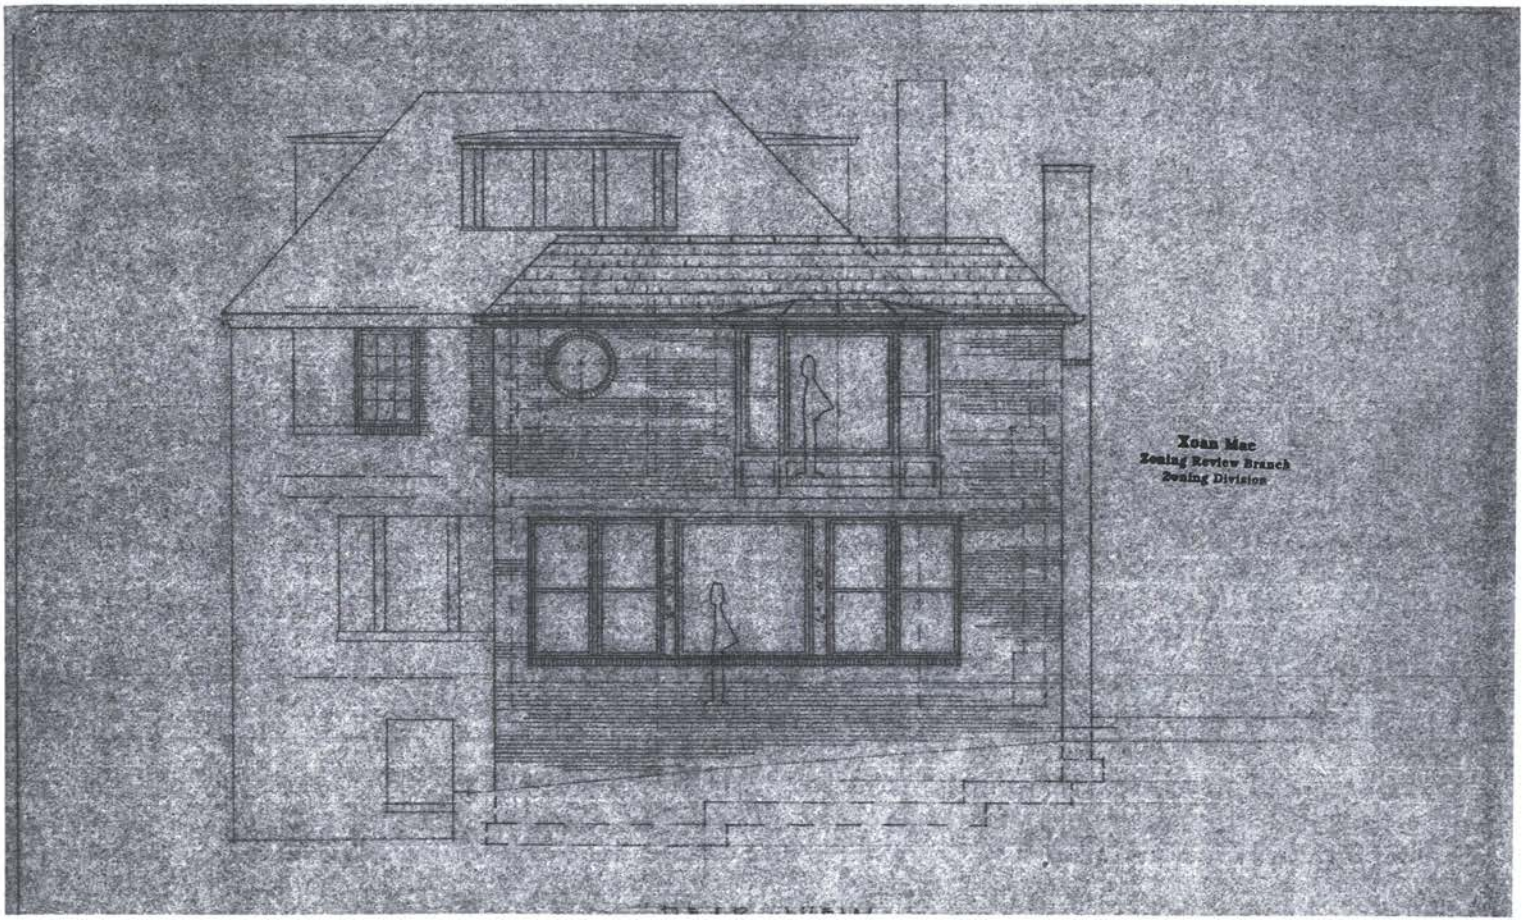
Xoan Mac
Zoning Review Branch
Zoning Division

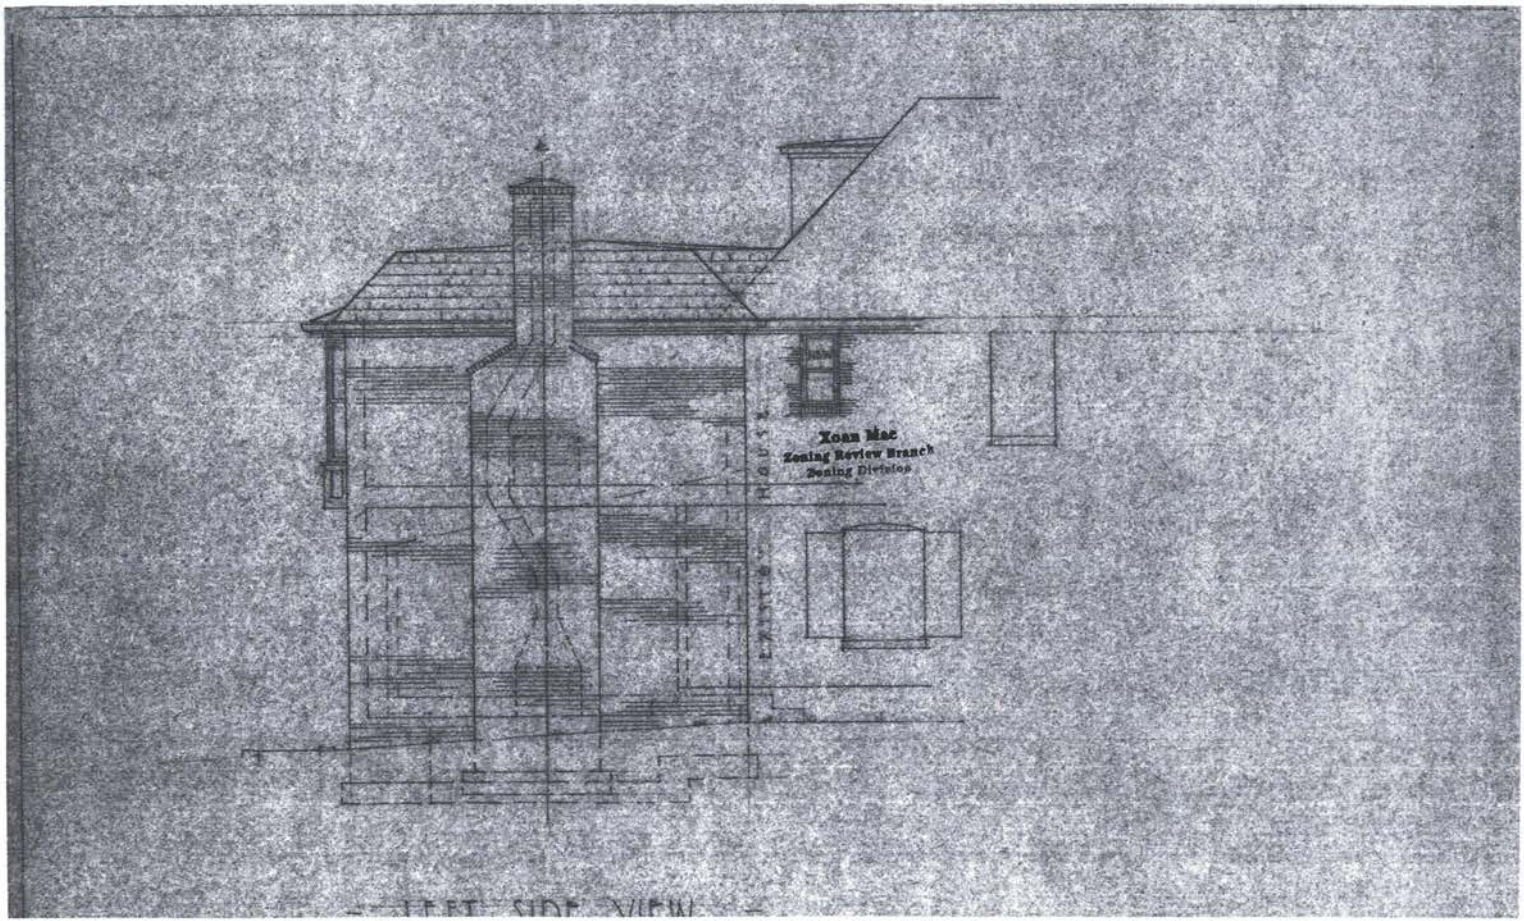
Xoan Mac
Zoning Review Branch
Zoning Division

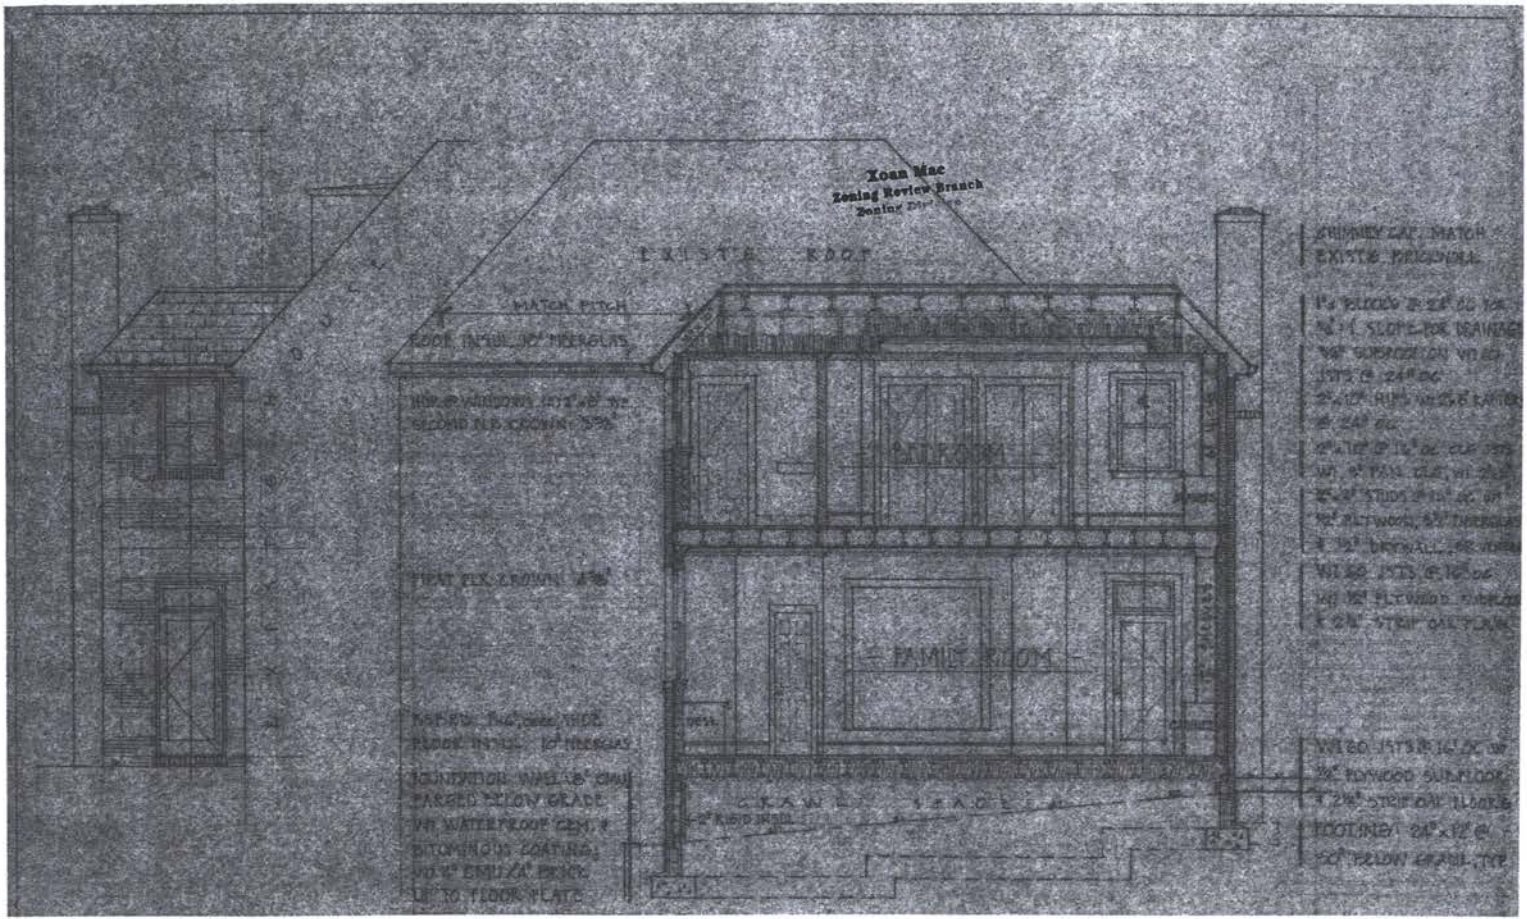

Xoan Mac
Zoning Review Branch
EXISTG. ROOF
MATCH PITCH
ROOF INTGL. 30° MIN.
FAMILY ROOM
FAMILY ROOM
CRAWL SPACE
FOUNDATION WALL
FOOTINGS
BELOW GRADE

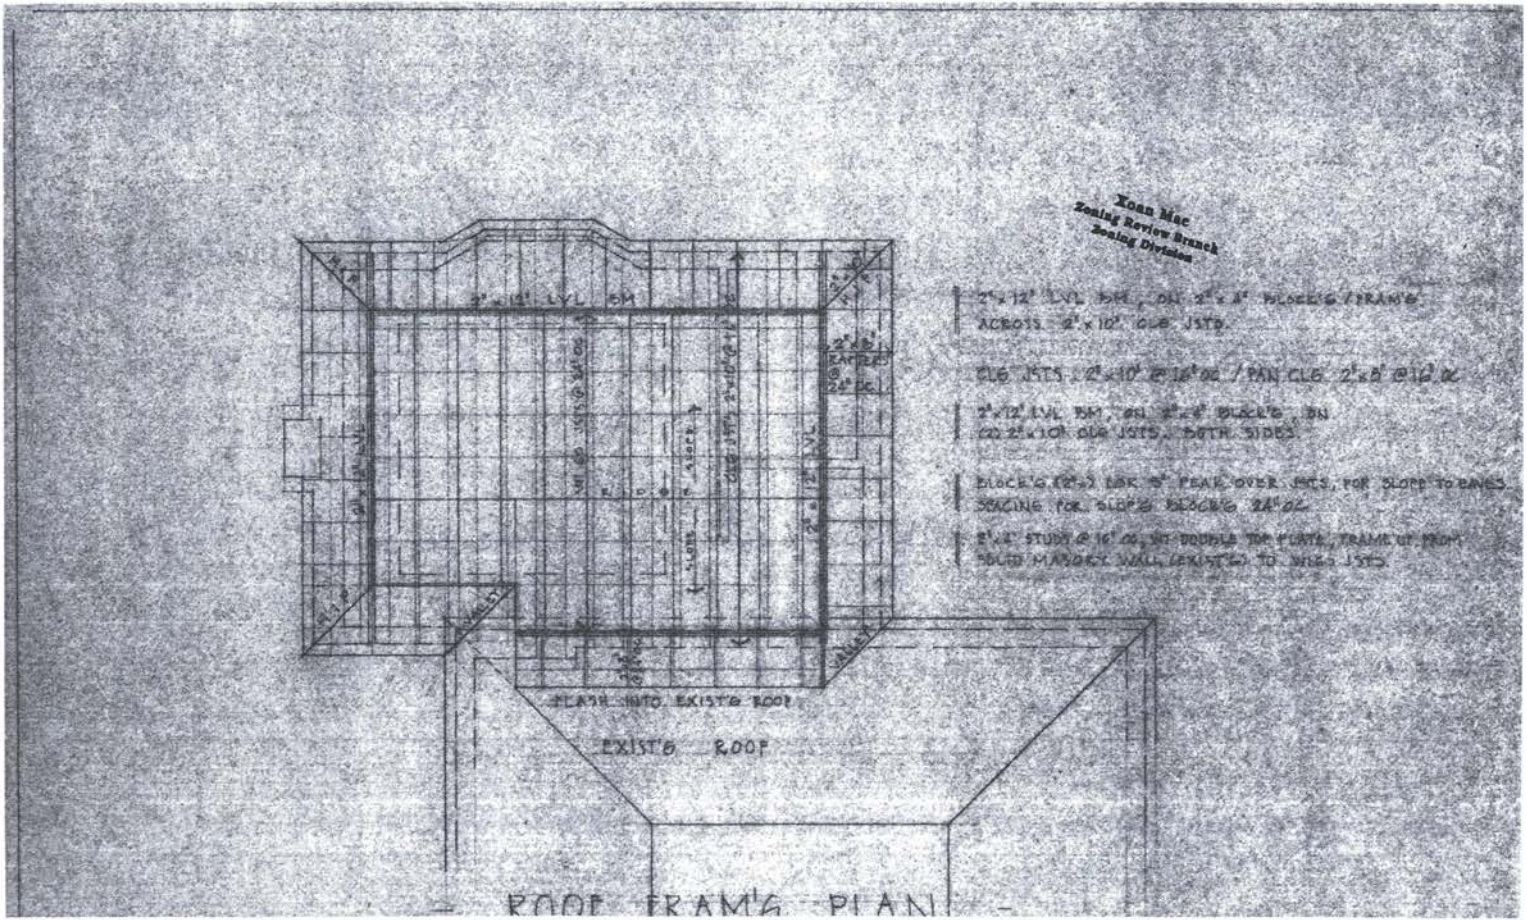
Xoan Mac
Zoning Review Branch
Zoning Division
2"x12" LVL BM, ON 2"x8" BLOCKING / FRAM'G ACROSS 2"x10" CLG JSTS.
CLG JSTS: 2"x10" @ 16"OC / PAN CLG 2"x8" @ 16" OC
2"x12" LVL BM, ON 2"x8" BLOCK'G, ON (2) 2"x10" CLG JSTS., BOTH SIDES
BLOCK'G (2"x) UNDER 3" PEAK OVER JSTS, FOR SLOPE TO EAVES SPACING FOR SLOP'G BLOCK'G 24" OC
2"x4" STUDS @ 16" OC, W/ DOUBLE TOP PLATE, FRAME UP FROM SOLID MASONRY WALL (EXIST'G) TO BRG'G JSTS.
2"x12" LVL BM
FLASH INTO EXIST'G ROOF
EXIST'G ROOF
ROOF FRAM'G PLAN

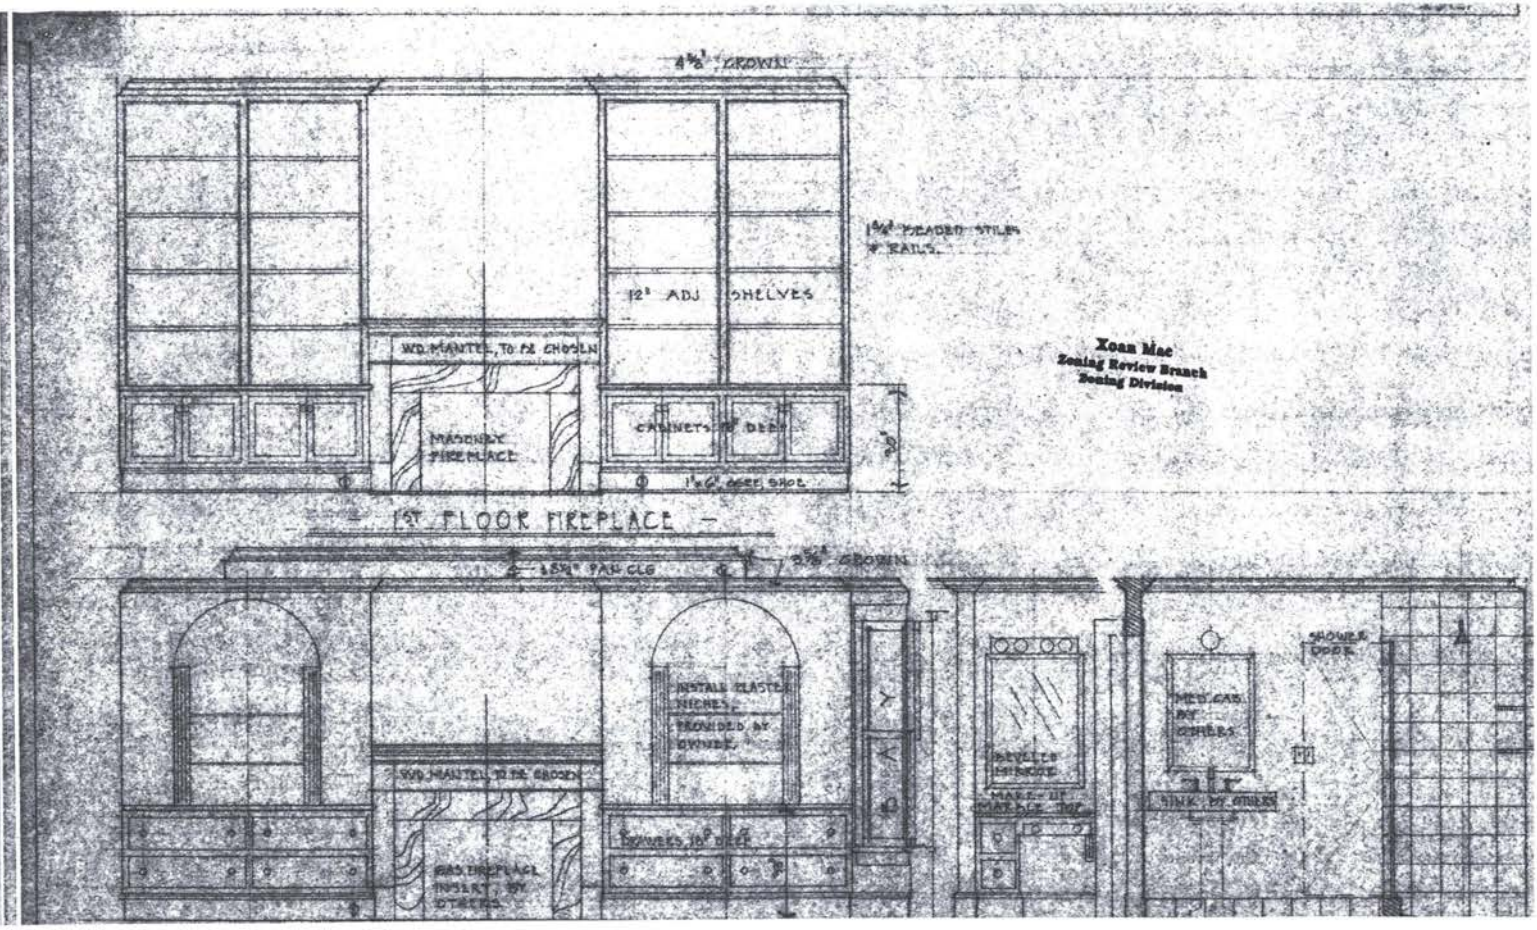


Xoan Mac
Zoning Review Branch
Zoning Division

(7)

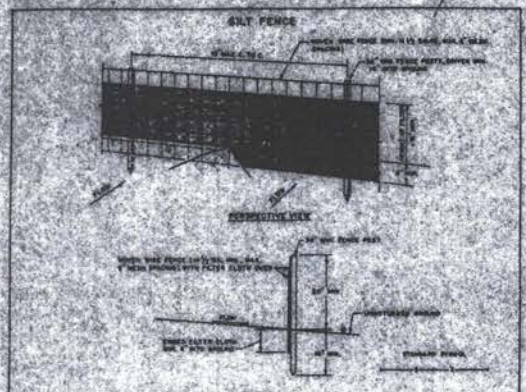


27

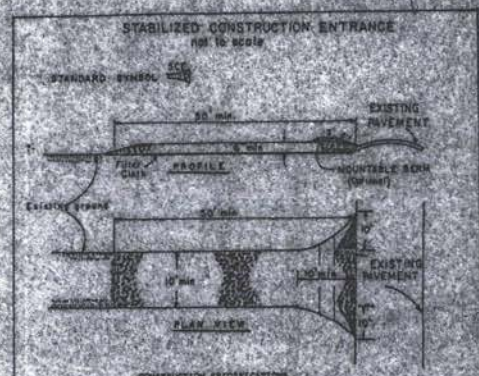

35

(9)

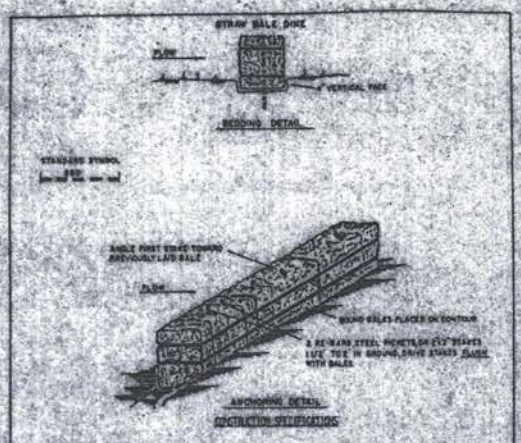

32

(8)

STANDARDS AND SPECIFICATIONS
FOR
BRICKBAT GROUND COVER

Zoning Map
Zoning Review Branch
Zoning Division

Definition

Temporary ground cover consisting of broken brick (a piece or shatter) placed over denuded earth.

Purpose

Brickbats provide a temporary ground cover over denuded areas earth to prevent the transportation of sediment from the site.

Conditions When Practice Applies

Brickbats may be used on any area in need of temporary ground cover.

Design Criteria

The brickbats shall be placed to a depth of 3 inches to 4 inches covering the denuded earth on the site, then compacted and leveled.



Figure 1 - BRICKBATS

34

EXHIBIT 8

FROM

CASE 16874

IS AN OVERSIZED DOCUMENT

PLEASE SEE AT OFFICE