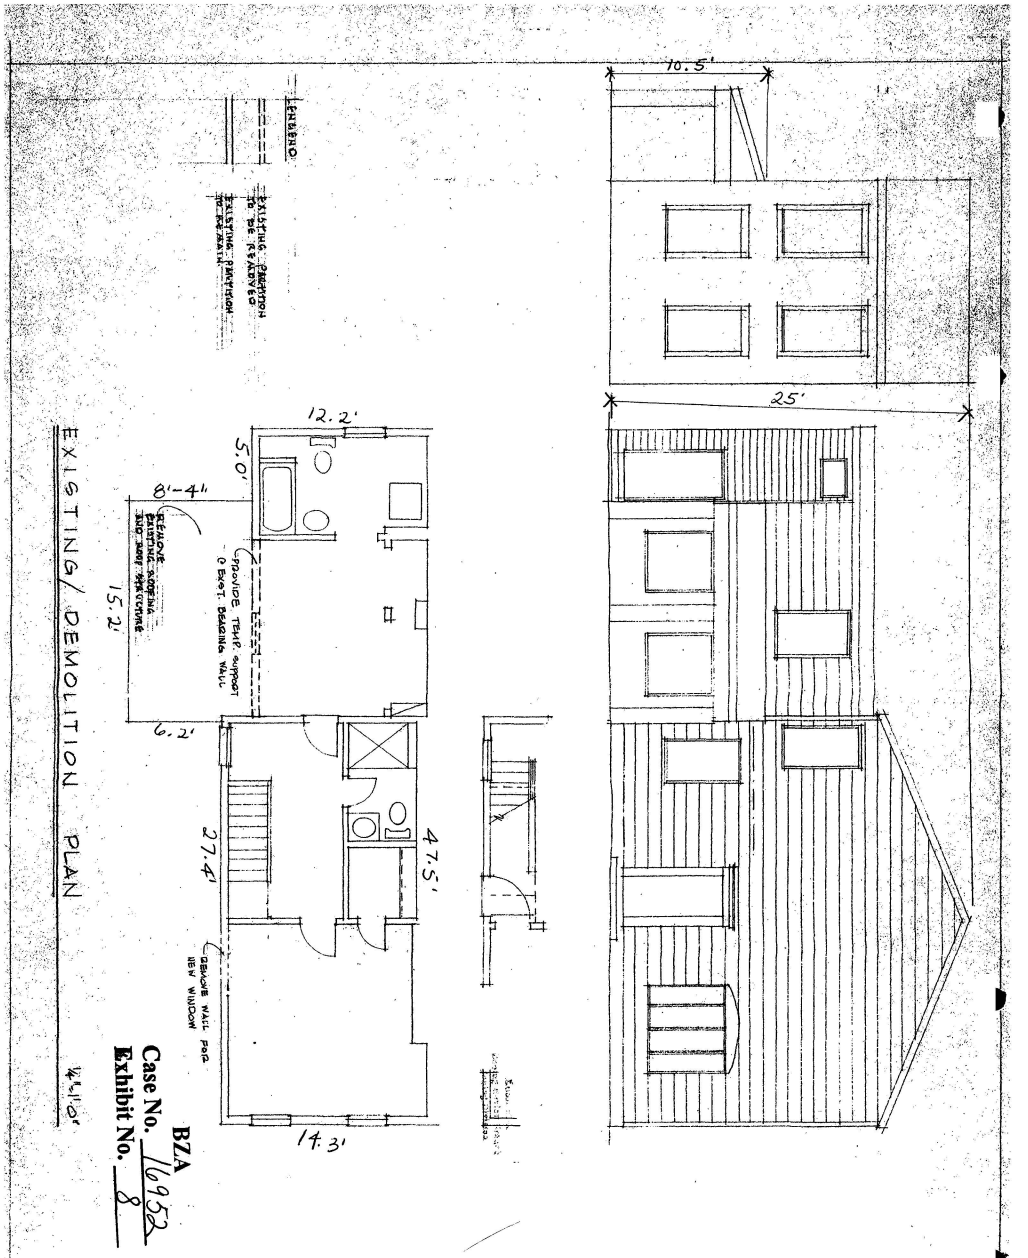


Addition and Remodeling for:
Paul Lumpkin
505 6th Street, SE
Washington, D.C. 20003

OF 15
9.12.01

Scott W. Sterl, AIA
Box 7984
McLean, Virginia 22106
703-790-5154

SECOND FLOOR PLAN 1/4"=1'-0"

NEW WALLS SHOWN SHADED


FIRST FLOOR PLAN 1/4"=1'-0"

Xuan Mac
Zoning Review Branch
Zoning Division


Scott W. Sterl, AIA
Box 7984
McLean, Virginia 22106
703-790-5164

Addition and Remodeling for:
Paul Lumpkin
505 6th Street, SE
Washington, D.C. 20003


2
OF 5
2/12/01

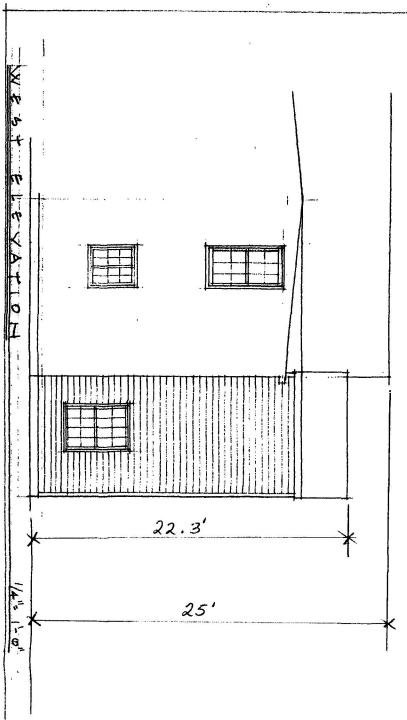

NORTH ELEVATION

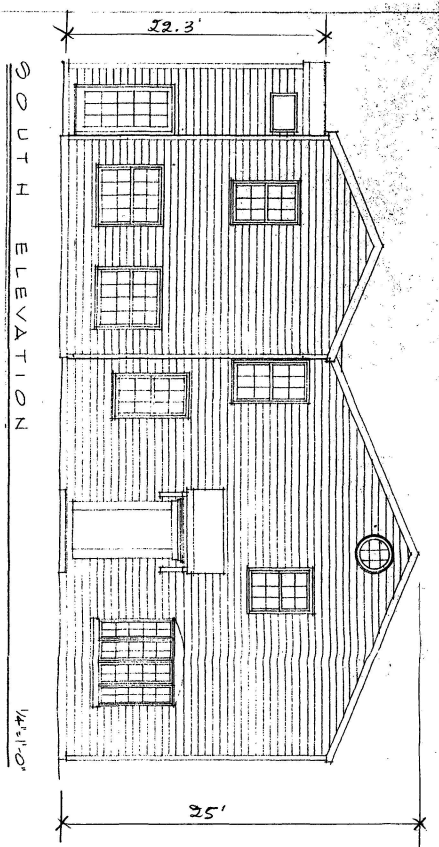

SOUTH ELEVATION 1/4"=1'-0"

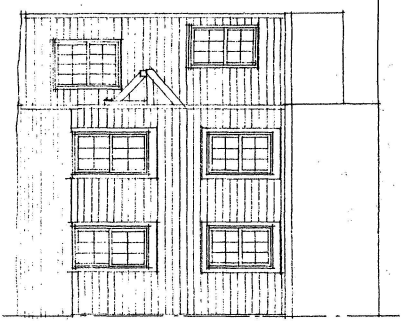

EAST ELEVATION 1/4"=1'-0"

Zoning Review Branch
Zoning Division

Zoning Review Branch
Zoning Division

3
OF 5
2.12.01

Addition and Remodeling for:
Paul Lumpkin
505 6th Street, SE
Washington, D.C. 20003

Scott W. Sterl, AIA
Box 7984
McLean, Virginia 22106
703-790-5154

SECOND FLOOR FRAMING 1/4"=1'-0"

ROOF FRAMING 1/4"=1'-0"

ROOF PLAN 1/4"=1'-0"


Zoning Review Branch
Zoning Division

Zoning Review Branch
Zoning Division

Scott W. Stark, AIA
Box 7984
Mclean, Virginia 22106
703-790-5154


Addition and Remodeling for:
Paul Lumpkin
505 6th Street, SE
Washington, D.C. 20003

4
of 5
12.12.01

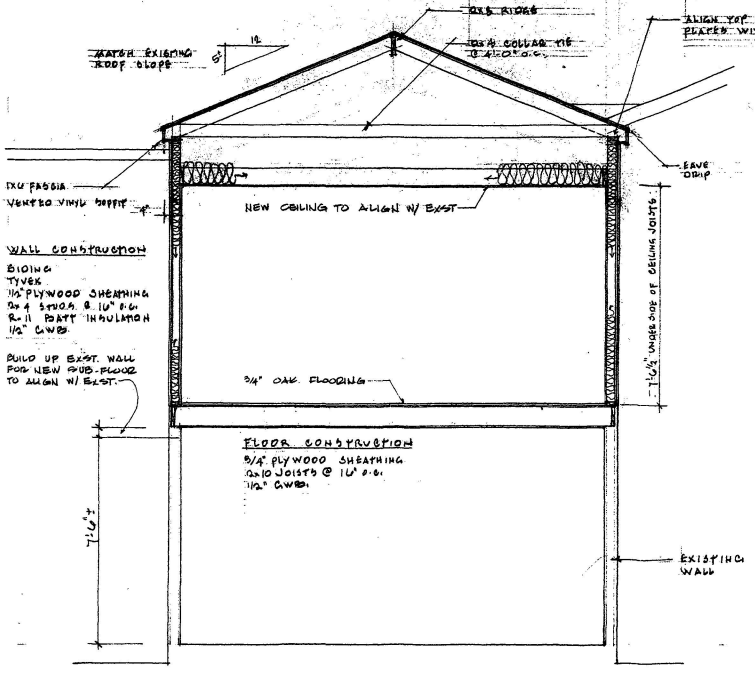

SECTION 1/2" = 1'-0"

ROOF CONSTRUCTION
ASPHALT SHINGLES
15# FELT
1/2" PLYWOOD SHEATHING
2x6 RAFTERS @ 16" O.C.
2x6 CEILING JOISTS @ 16" O.C.
R-30 BATT INSULATION
1/2" GWB

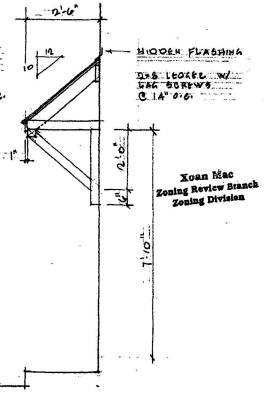


ENTRANCE CANOPY SECTION 1/2" = 1'-0"


Xoan Mac
Zoning Review Branch
Zoning Division

Addition and Remodeling for:
Paul Lumpkin
505 6th Street, SE
Washington, D.C. 20003

5 of 15
2.12.01

Scott W. Stein AIA
Box 7984
McLean, Virginia 22106
703-790-1154

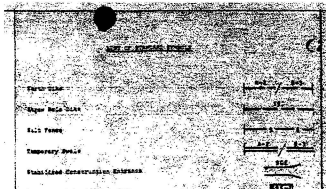

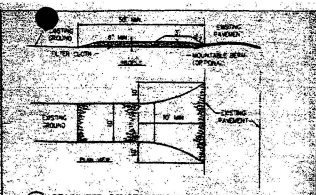



2 STABILIZED CONSTRUCTION ENTRANCE
(NOT TO SCALE)

CONSTRUCTION RAMP SPECIFICATION

STONE SIZE- USE 2" STONE, OR RECLAIMED OR RECYCLED CONCRETE EQUIVALENT

2. LENGTH— AS REQUIRED, BUT NOT LESS THAN 50 FEET (EXCEPT ON A SINGLE RESIDENCE LOT WHERE A 30 FOOT MINIMUM LENGTH WOULD APPLY)
3. THICKNESS— NOT LESS THEN SIX (6) INCHES
4. WIDTH— TEN (10) FOOT MINIMUM, BUT NOT LESS THAN FULL WIDTH OF ALL POINTS OF INGRESS OR EGRESS OCCURS.
5. FILTER CLOTH— WILL BE PLACED OVER THE ENTIRE AREA PRIOR TO PLACING OF STONE. FILTER WILL NOT BE REQUIRED ON A SINGLE FAMILY RESIDENCE LOT.
6. SURFACE WATER— ALL SURFACE WATER FLOWING OR DIVERTED TOWARD CONSTRUCTION ENTRANCE SHALL BE PIPED ACROSS THE ENTRANCE, IF PIPING IS IMPRACTICAL, A MOUNTABLE BERM WITH 5:1 SLOPES WILL BE PERMITTED.
7. MAINTENANCE— THE ENTRANCE SHALL BE MAINTAINED IN CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND AND REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC RIGHTS-OF-WAY MUST BE REMOVED IMMEDIATELY.
8. WASHING— WHEELS SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RIGHT-OF-WAY. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH STONE WHICH DRAINS INTO AN APPROVED SEDIMENT TRAPPING DEVICE.
9. PERIODIC INSPECTION AND NEEDED MAINTENANCE SHALL BE PROVIDED AFTER EACH RAIN.

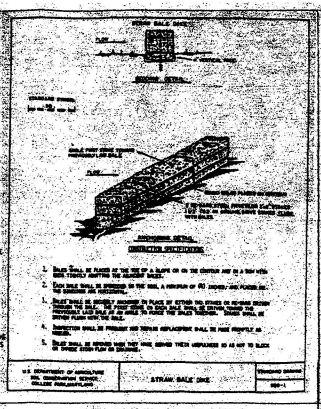

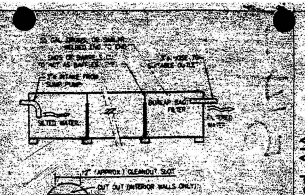

7 PORTABLE SEDIMENT TANK
(NO SCALE)

STANDARDS AND SPECIFICATIONS FOR BRICKBAT GROUND COVER

Definition

Temporary ground cover consisting of broken brick (4 inches or smaller) placed over exposed earth.

Purpose

Brickbats provide a temporary ground cover over exposed urban earth to prevent the transportation of sediments from the site.

Conditions When Practice Applies

Brickbats may be used on any site in need of temporary ground cover.

Design Criteria

The brickbats shall be placed to a depth of 3 inches to 6 inches covering 2/3 the exposed earth on the site. Upon completion and fine-tuning,


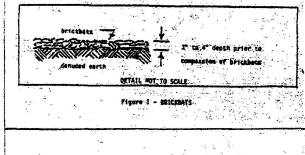



Figure 1 - BRICKBATS

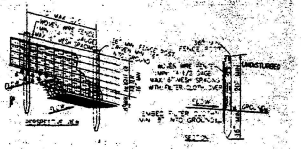


CONSTRUCTION NOTES FOR FABRICATED SILT FENCE


1. POSTS: STEEL EITHER T OR U TYPE OR 2" SQUARE WOOD, WITH A MINIMUM LENGTH OF 5 FEET.
2. FENCE: WOVEN WIRE, 14½ GAGE, 6" MAX MESH OPENING.
3. FILTER CLOTH: MIRAFI 100X, STABLINKA T140N OR APPROVED EQUAL.
4. MAINTENANCE: FENCE SHALL BE INSPECTED AFTER EACH RAIN AND REPAIRS MADE AS NEEDED.
5. POSTS: STEEL EITHER T OR U TYPE OR 2" SQUARE WOOD.
6. FENCE: WOVEN WIRE, 14½ GAGE 6" MAX MESH OPENING.
7. FILTER CLOTH: MIRAFI 100X, STABLINKA T140N OR APPROVED EQUAL.
8. PREFABRICATED UNIT: GEOFAB ENVIROFENCE OR APPROVED EQUAL.

4 SILT FENCE





3 VEHICLE WASH DETAIL
(NOT TO SCALE)

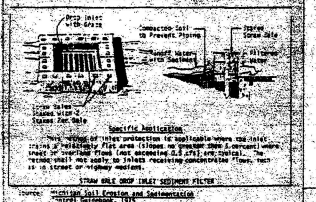


Source: Maryland Soil Erosion and Sedimentation Control Handbook, 1994

1 EROSION AND SEDIMENT CONTROL MEASURES AND SEQUENCE:

1. ALL EROSION AND SEDIMENT CONTROL MEASURES SHALL BE PLACED PRIOR TO OR AS THE FIRST STEP IN GRADING.
2. INSTALL TEMPORARY STONE CONSTRUCTION ENTRANCE WHERE SHOWN. PROVIDE WATER SOURCE AND HOSE OUTLET FOR ALL EQUIPMENT LEAVING SITE.
3. INSTALL SILT FENCE AROUND PERIMETER OF SITE.
4. ALL DISTURBED AREA MUST BE STABILIZED (SEE NOTE 5 BELOW) WITHIN THE NECESSARY TEMPORARY OR PERMANENT VEGETATIVE STABILIZATION MEASURES TO ACHIEVE ADEQUATE EROSION AND SEDIMENT CONTROL.
5. ALL CONSTRUCTION TO BE INSPECTED DAILY BY THE CONTRACTOR, AND ANY DAMAGED SITUATION OR EROSION OR SEDIMENT RUN-OFF SHALL BE REPAIRED BY THE CLOSE OF THE DAY.
6. [illegible] TO BE MAINTAINED IN WORKING CONDITION.
7. [illegible] SHALL BE REMOVED BY THE CONTRACTOR AFTER SITE HAS BECOME STABILIZED, AS NEEDED.
8. [illegible] BY THE CONTRACTOR AFTER THE [illegible]

EROSION CONTROL NOTES

1. A sediment and erosion control methods shall be installed before the start of any excavation and/or construction as per Standards and Specifications for Soil Erosion and Sediment Control for the District of Columbia. If, on-site inspection reveals further erosion control measures are necessary, the same shall be provided.
2. All debris is to be removed from site.
3. Alley and/or streets/sidewalks shall be swept clean at all time during excavation and construction.
4. All catch basins and drain area shall be protected during excavation and construction.
5. If any catch basins or drains become clogged as a result of excavation or construction the contractor shall be responsible for its cleaning.
6. When sediment trap/sediment tank has reached 50% capacity, clean out of same is required.
7. Any stockpiling, regardless of location shall be stabilized and covered with plastic or canvas, after its establishment and for duration of the project.
8. After Aggs or Dacey, there is the need for grading and to provide erosion and sediment control from starting. Such as seed, hay, straw, mulch, etc.



EROSION CONTROL PLAN 1"=20'

Xoan Mac
Zoning Review Branch
Zoning Division

Scott W. Stein, AIA
P.O. Box 7984
McLean, Virginia 22106
703-734-6245

SEC Addition and Remodeling for:
Paul Lumpkin
505 6th Street, SE
Washington, D.C. 20003

2 of 2