ZONING NOTES

ZONE

PROJECT IS IN ZONE RF-1.

BUILDING HEIGHT

THE EXISTING BUILDING IS 32'-7" ABOVE GRADE MEASURED FROM THE MIDPOINT OF THE FRONT FACADE. IN COMPLIANCE WITH 303.1.

LOT OCCUPANCY

LOT AREA = 880 SF BUILDING FOOTPRINT = 668 SF LOT OCCUPANCY = 76%

FLOOR AREA RATIO

GROSS FLOOR AREA = 2089 SF (INCLUDING BASEMENT & PENTHOUSE)

BASEMENT 668 SF FIRST FLOOR 668 SF SECOND FLOOR 668 SF PENTHOUSE 85 SF TOTAL 2089 SF

FAR = 2.4

YARDS

FRONT AND REAR YARDS ARE NOT MODIFIED BY THIS PROJECT. THERE ARE NO SIDE YARDS APPLICABLE TO ROW HOUSES ON AN INTERIOR LOT.

ORIGINAL ROOFTOP ELEMENTS

THE ONLY ORIGINAL ROOFTOP ELEMENT IS AN EXISTING CHIMNEY AND IT IS NOT ALTERED BY THIS PROJECT. THIS PROJECT IS IN COMPLIANCE WITH 206.1.

PENTHOUSE

THIS PROJECT INCLUDES STAIR ACCESS TO THE ROOF. THE STAIR ENCLOSURE FALLS UNDER THE CRITERIA OF PENTHOUSE PER CHAPTER 15, 1500.3 AND IS PROVIDED SOLELY FOR ROOF ACCESS, NOT HABITABLE SPACE.

PENTHOUSE APPLICABILITY

ON ROWHOUSES, A PENTHOUSE IS ALLOWABLE AS A SPECIAL EXCEPTION PER 1500.4 THAT CONTAINS ONLY STAIR ACCESS TO THE ROOF AND IS NO MORE THAN 10-0" HIGH. THIS PENTHOUSE CONSISTS ONLY OF A STAIR AND HAS NO STORAGE AND NO OCCUPIED SPACE.

PENTHOUSE HEIGHT

THE STAIR ENCLOSURE IS IN COMPLIANCE WITH 1500.4 IN THAT IT RISES 9' 10 1/2" ABOVE THE EXISTING ROOF HIGH POINT (10'-0" ALLOWED) AND IS ONE STORY.

THE STAIR ENCLOSURE IS IN COMPLIANCE WITH SPECIAL EXCEPTION UNDER SUBTITLE X, CHAPTER 9 AND PENTHOUSE MAXIMUM HEIGHT OF 12'-0" PER 303.7.

PENTHOUSE WALLS

UNIFORM HEIGHT WALLS ARE REQUIRED PER 1500.9. THIS IS NOT FEASIBLE DUE TO HISTORIC VIEW REGULATIONS. THE STAIR ENCLOSURE HAS BEEN DESIGNED WITH A SLOPING ROOF TO BE OUT OF THE HISTORIC VIEW SHED.

PENTHOUSE SETBACKS

THE FRONT PENTHOUSE SETBACK IS 16'-6" FROM THE FRONT BUILDING WALL, IN COMPLIANCE WITH 1502.1a AS THIS IS GREATER THAN ITS HEIGHT OF 9'-10 1/2".

THE REAR PENTHOUSE SETBACK IS 6'-3". PER 1502.b THIS IS TO BE EQUAL TO THE PENTHOUSE HEIGHT. DUE TO THE HISTORIC VIEW REQUIREMENTS, COMPLIANCE WITH THIS SETBACK IS INFEASIBLE. THE SETBACK HAS BEEN MAXIMIZED TO THE GREATEST DEGREE POSSIBLE WHILE PROVIDING COMPLIANCE WITH HISTORIC REGULATIONS. THE SIZE OF THE PENTHOUSE HAS BEEN MADE AS SMALL AS POSSIBLE WHILE PROVIDING SAFE ROOF ACCESS

PENTHOUSE SIDE SETBACK PER 1502.c IS NOT FEASIBLE FOR AN 18'-0" WIDE LOT. PLEASE NOTE THAT THE INTENT OF THE PENTHOUSE DESIGN IS TO PROVIDE SAFE ROOF ACCESS TO CORRECT THE NON-COMPLIANT CONSTRUCTION.

REFER TO 1504 RELIEF TO PENTHOUSE REQUIREMENTS:

a. STRICT APPLICATION OF PENTHOUSE SIDE SETBACK WOULD BE UNDULY RESTRICTIVE.

- b. THE RELIEF REQUESTED RESULTS IN A BETTER DESIGN OF THE ROOF STRUCTURE WITHOUT APPEARING TO BE AN EXTENSION OF THE BUILDING WALL. THE STAIR ENCLOSURE IS NOT VISIBLE FROM THE STREET, IS CONSTRUCTED OF WOOD, AND IS STRUCTURALLY SEPARATE FROM THE MASONRY BEARING WALLS, THEREFORE IT IS NOT AN EXTENSION OF THE BUILDING WALL.
- c. THE STAIR ENCLOSURE IS NOT VISUALLY INTRUSIVE AS IT IS NOT VISIBLE FROM THE STREET.
- d. CONSTRUCTION CODE REASONABLE EFFICIENCIES IN LOWER FLOORS: THE STAIR HAS BEEN DESIGNED AS A CONTINUATION OF THE EXISTING STAIR. CREATING A SECOND STAIR IN A ROW HOUSE IS PRACTICALLY INFEASIBLE DUE TO THE NARROW WIDTH OF THE LOT.
- e. EVERY EFFORT HAS BEEN MADE TO BE IN COMPLIANCE WITH THE REQUIRED SETBACKS.
- THERE IS NO EFFECT TO THE LIGHT AND AIR OF ADJACENT STRUCTURES.

PENTHOUSE AREA

THE EXISTING PENTHOUSE IS 31 SF AND WILL BE REPLACED WITH A NEW PENTHOUSE THAT IS 85 SF. THIS IS 13% OF THE TOTAL ROOF AREA, IN COMPLIANCE WITH 1503.2.

THE NEW PENTHOUSE IS 85 SF AND IS 20% OF THE USABLE ROOFTOP SPACE, IN COMPLIANCE WITH 1500.3b.

TOTAL ROOF AREA: 668 SF USABLE ROOF AREA 434 SF (GREEN ROOF + WOOD DECK) PENTHOUSE AREA: 85 SF

PROPERTY IDENTIFICATION: CLUSTER 26 WARD 6 SMD 6A03 CENSUS TRACT 008100 SSL 0941 0821 ANC 6A03

THE FOLLOWING MATERIALS ARE THE BASIS OF DESIGN. ALL SUBSTITUTIONS MUST BE APPROVED BY THE OWNER AND THE AOR PRIOR TO INSTALLATION.

DIV 02

GREEN ROOF

BASIS OF DESIGN WHITE EPDM 45 MIL MINIMUM & EXTENSIVE 4" LAY-IN GREEN ROOF SYSTEM. GREEN ROOF SATURATED WEIGHT IS NOT TO EXCEED 30 PSI. EPDM ROOF MEMBRANE IS TO BE COMPATIBLE WITH GREEN ROOF SYSTEM AND IS TO BE SUITABLE FOR EXPOSURE TO THE ELEMENTS WITHOUT BALLAST.

DIV 04

GUARDRAIL: ATLANTIS SUN RAILLATITUDE (NOTE NO SUBSTITUTIONS FOR THIS PRODUCT)

ALL EXERIOR STEEL IN PROJECT IS TO BE GALVANIZED UNLESS PRIMED AND PAINTED IS APPROVED BY THE OWNER.

DIV 05

ALL WOOD IN PROJECT IS TO BE FSC CERTIFIED.ALL COMPOSITE WOOD PRODUCTS ARE TO CONTAIN NO UREA FORMALDEHYDE.

DECKING

THE OWNER.

SIDING

"VANISH RAINSCREEN" BY IRONWOODS. PROVIDE SAMPLE TO FOR OWNER'S APPROVAL

ROUGH CARPENTRY & SOLID STRUCTURAL LUMBER SEE PLANS

FINISH CARPENTRY

SOLID RED OAK 2¹/₄ WIDE WOOD FLOORING, FSC CERTIFIED, RIFT & QUARTER SAWN, SELECT OR BETTER, ALLEGHANY HARDWOOD OR SIMILAR, FINISHED IN FIELD TO MATCH EXISTING WOOD FLOOR. PROVIDE FINISH SAMPLE FOR OWNER'S APPROVAL.

DIV 07

INSULATION

INTERIOR - MINERAL WOOL SOUND ATTENUATION INSULATION EXTERIOR - ECOTOUCH PINK FIBERGLASS R-14 PLUS EXTRUDED POLYSTYRENE R5 PER INCH

ROOF ASSEMBLY

CONTRACTOR IS RESPONSIBLE FOR COMPATIBILITY OF SELECTED FLASHING, ROOFING, AND WATERPROOF AIR BARRIER TO FORM A COMPLETE WATERTIGHT BUILDING ENVELOPE. PROVIDE A COPY OF PRODUCT DATA TO OWNER. PROVIDE A 20 YEAR WARRANTY FOR ROOFING AND GREEN ROOF. ROOFING MANUFACTURER TO VISIT SITE AND PROVIDE A LETTER CERTIFYING QUALITY CRAFTSMANSHIP AND COMPATIBILITY OF MATERIALS.

EPDM ROOFING - NOTED UNDER GREEN ROOF ABOVE.

SEALANT

DIV 08

SLIDING DOOR WESTERN WINDOWS SERIES 7650 SLIDING GLASS DOOR WITH INSULATED GLAZING, LOW-E COATING AND A THERMALLY BROKEN


ARCHITECTURE FOREVER



4500 East West Highway #125 Bethesda, MD 20814 (240) 760-1037

NOTE: Drawing may be printed at reduced scale

DRAFT - NOT FOR CONSTRUCTION

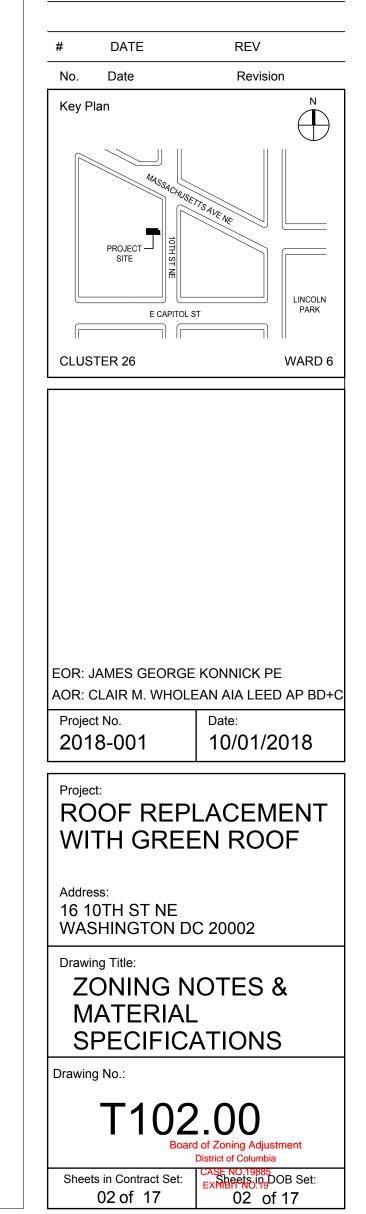

MATERIAL SPECIFICATIONS

1X6 IPE, ADVANTAGE LUMBER OR SIMILAR. PROVIDE A 2 YEAR SUPPLY OF A A LOW-VOC SEALER RECOMMENDED BY IPE MANUFACTURER TO

1X6 IPE SHIPLAP SIDING WITH RAINSCREEN SYSTEM - BASIS OF DESIGN

ROOF FLASHING - PROVIDE EPDM COMPATIBLE WITH MEMBRANE.

WINDOWS & SKYLIGHTS

FRAME.

PELLA, ANDERSON, MARVIN, WESTERN WINDOWS, THERMALLY BROKEN FRAME WITH INSULATED GLASS UNIT, CLEAR GLASS AND LOW-E COATING WITH 0.40 SHGC OR BETTER FOR WINDOWS AND A SKYLIGHT U-FACTOR OF 0.55 OR BETTER. SUBMIT COLOR SAMPLES TO **OWNER & AOR. PROVIDE SINGLE SOURCE MANUFACTURER FORALL** DIV 8 MATERIALS. SUBMISSION OF PRODUCT DATA AND OWNER OR AOR APPROVAL IS REQUIRED FOR ALL DIV 8 MATERIALS PRIOR TO INSTALLATION. WINDOW U-FACTOR 0.32 OR BETTER PER IRC 402.1.2. OPERABLE WINDOWS TO HAVE LOCKING HARDWARE AND BE FITTED WITH SCREENS TYP.

DIV 09

INTERIOR PAINT

BENJAMIN MOORE AURA OR EQUAL LOW-VOC BRAND, COLOR TO MATCH EXISTING WALLS OR OWNER'S CHOICE.

PLUMBING:

PROVIDE NATURAL GAS CONVERSION KIT FOR FIRE TABLE AND GRILL AND INSTALL NATURAL GAS SERVICE TO THE ROOF TO SERVE BOTH. DESIGN ROUTING OF PIPE TO MINIMIZE IMPACT TO EXISTING CONSTRUCTION. PROVIDE PATCHING OF AREAS OPENED UP FOR GAS PIPE AND FINISH TO MATCH ADJACENT CONSTRUCTION. ADVISE OWNER ON PREFERRED GAS ROUTE AND IMPACT TO EXISTING CONSTRUCTION PRIOR TO SELECTIVE DEMOLITION. MINIMIZE IMPACT TO KITCHEN.

ELECTRICAL:

LIGHTING

CONTRACTOR TO PROVIDE ALL WIRING, ACCESSORIES AND SERVICE TO ENSURE A COMPLETE AND FUNCTIONAL ELECTRICAL INSTALLATION. ALL ELECTRICAL WORK TO BE BY A LICENSED ELECTRICIAN. SWITCHES ARE OWNER'S CHOICE.

PROVIDE GFCI AND EXTERIOR GRADE RECEPTACLES WITH ENCLOSED COVER PLATE FOR ELECTRICAL SERVICE ON ROOF.

DOWNLIGHTS:

LED:

SCONCE MAY BE OWNER PROVIDED, CONTRACTOR INSTALLED

FURNITURE OWNER PROVIDED, CONTRACTOR INSTALLED.

ZONING NOTES

ZONE

PROJECT IS IN ZONE RF-1.

BUILDING HEIGHT

THE EXISTING BUILDING IS 32'-7" ABOVE GRADE MEASURED FROM THE MIDPOINT OF THE FRONT FACADE. IN COMPLIANCE WITH 303.1.

LOT OCCUPANCY

LOT AREA = 880 SF BUILDING FOOTPRINT = 668 SF LOT OCCUPANCY = 76%

FLOOR AREA RATIO

GROSS FLOOR AREA = 2089 SF (INCLUDING BASEMENT & PENTHOUSE)

BASEMENT 668 SF FIRST FLOOR 668 SF SECOND FLOOR 668 SF PENTHOUSE 85 SF TOTAL 2089 SF

FAR = 2.4

YARDS

FRONT AND REAR YARDS ARE NOT MODIFIED BY THIS PROJECT. THERE ARE NO SIDE YARDS APPLICABLE TO ROW HOUSES ON AN INTERIOR LOT.

ORIGINAL ROOFTOP ELEMENTS

THE ONLY ORIGINAL ROOFTOP ELEMENT IS AN EXISTING CHIMNEY AND IT IS NOT ALTERED BY THIS PROJECT. THIS PROJECT IS IN COMPLIANCE WITH 206.1.

PENTHOUSE

THIS PROJECT INCLUDES STAIR ACCESS TO THE ROOF. THE STAIR ENCLOSURE FALLS UNDER THE CRITERIA OF PENTHOUSE PER CHAPTER 15, 1500.3 AND IS PROVIDED SOLELY FOR ROOF ACCESS, NOT HABITABLE SPACE.

PENTHOUSE APPLICABILITY

ON ROWHOUSES, A PENTHOUSE IS ALLOWABLE AS A SPECIAL EXCEPTION PER 1500.4 THAT CONTAINS ONLY STAIR ACCESS TO THE ROOF AND IS NO MORE THAN 10-0" HIGH. THIS PENTHOUSE CONSISTS ONLY OF A STAIR AND HAS NO STORAGE AND NO OCCUPIED SPACE.

PENTHOUSE HEIGHT

THE STAIR ENCLOSURE IS IN COMPLIANCE WITH 1500.4 IN THAT IT RISES 9' 10 1/2" ABOVE THE EXISTING ROOF HIGH POINT (10'-0" ALLOWED) AND IS ONE STORY.

THE STAIR ENCLOSURE IS IN COMPLIANCE WITH SPECIAL EXCEPTION UNDER SUBTITLE X, CHAPTER 9 AND PENTHOUSE MAXIMUM HEIGHT OF 12'-0" PER 303.7.

PENTHOUSE WALLS

UNIFORM HEIGHT WALLS ARE REQUIRED PER 1500.9. THIS IS NOT FEASIBLE DUE TO HISTORIC VIEW REGULATIONS. THE STAIR ENCLOSURE HAS BEEN DESIGNED WITH A SLOPING ROOF TO BE OUT OF THE HISTORIC VIEW SHED.

PENTHOUSE SETBACKS

THE FRONT PENTHOUSE SETBACK IS 16'-6" FROM THE FRONT BUILDING WALL, IN COMPLIANCE WITH 1502.1a AS THIS IS GREATER THAN ITS HEIGHT OF 9'-10 1/2".

THE REAR PENTHOUSE SETBACK IS 6'-3". PER 1502.b THIS IS TO BE EQUAL TO THE PENTHOUSE HEIGHT. DUE TO THE HISTORIC VIEW REQUIREMENTS, COMPLIANCE WITH THIS SETBACK IS INFEASIBLE. THE SETBACK HAS BEEN MAXIMIZED TO THE GREATEST DEGREE POSSIBLE WHILE PROVIDING COMPLIANCE WITH HISTORIC REGULATIONS. THE SIZE OF THE PENTHOUSE HAS BEEN MADE AS SMALL AS POSSIBLE WHILE PROVIDING SAFE ROOF ACCESS

PENTHOUSE SIDE SETBACK PER 1502.c IS NOT FEASIBLE FOR AN 18'-0" WIDE LOT. PLEASE NOTE THAT THE INTENT OF THE PENTHOUSE DESIGN IS TO PROVIDE SAFE ROOF ACCESS TO CORRECT THE NON-COMPLIANT CONSTRUCTION.

REFER TO 1504 RELIEF TO PENTHOUSE REQUIREMENTS:

a. STRICT APPLICATION OF PENTHOUSE SIDE SETBACK WOULD BE UNDULY RESTRICTIVE.

- b. THE RELIEF REQUESTED RESULTS IN A BETTER DESIGN OF THE ROOF STRUCTURE WITHOUT APPEARING TO BE AN EXTENSION OF THE BUILDING WALL. THE STAIR ENCLOSURE IS NOT VISIBLE FROM THE STREET, IS CONSTRUCTED OF WOOD, AND IS STRUCTURALLY SEPARATE FROM THE MASONRY BEARING WALLS, THEREFORE IT IS NOT AN EXTENSION OF THE BUILDING WALL.
- c. THE STAIR ENCLOSURE IS NOT VISUALLY INTRUSIVE AS IT IS NOT VISIBLE FROM THE STREET.
- d. CONSTRUCTION CODE REASONABLE EFFICIENCIES IN LOWER FLOORS: THE STAIR HAS BEEN DESIGNED AS A CONTINUATION OF THE EXISTING STAIR. CREATING A SECOND STAIR IN A ROW HOUSE IS PRACTICALLY INFEASIBLE DUE TO THE NARROW WIDTH OF THE LOT.
- e. EVERY EFFORT HAS BEEN MADE TO BE IN COMPLIANCE WITH THE REQUIRED SETBACKS.
- THERE IS NO EFFECT TO THE LIGHT AND AIR OF ADJACENT STRUCTURES.

PENTHOUSE AREA

THE EXISTING PENTHOUSE IS 31 SF AND WILL BE REPLACED WITH A NEW PENTHOUSE THAT IS 85 SF. THIS IS 13% OF THE TOTAL ROOF AREA, IN COMPLIANCE WITH 1503.2.

THE NEW PENTHOUSE IS 85 SF AND IS 20% OF THE USABLE ROOFTOP SPACE, IN COMPLIANCE WITH 1500.3b.

TOTAL ROOF AREA: 668 SF USABLE ROOF AREA 434 SF (GREEN ROOF + WOOD DECK) PENTHOUSE AREA: 85 SF

PROPERTY IDENTIFICATION: CLUSTER 26 WARD 6 SMD 6A03 CENSUS TRACT 008100 SSL 0941 0821 ANC 6A03

PRIOR TO INSTALLATION.

DIV 02

GREEN ROOF

BASIS OF DESIGN WHITE EPDM 45 MIL MINIMUM & EXTENSIVE 4" LAY-IN GREEN ROOF SYSTEM. GREEN ROOF SATURATED WEIGHT IS NOT TO EXCEED 30 PSI. EPDM ROOF MEMBRANE IS TO BE COMPATIBLE WITH GREEN ROOF SYSTEM AND IS TO BE SUITABLE FOR EXPOSURE TO THE ELEMENTS WITHOUT BALLAST.

DIV 04

GUARDRAIL: ATLANTIS SUN RAILLATITUDE (NOTE NO SUBSTITUTIONS FOR THIS PRODUCT)

ALL EXERIOR STEEL IN PROJECT IS TO BE GALVANIZED UNLESS PRIMED AND PAINTED IS APPROVED BY THE OWNER.

DIV 05

ALL WOOD IN PROJECT IS TO BE FSC CERTIFIED.ALL COMPOSITE WOOD PRODUCTS ARE TO CONTAIN NO UREA FORMALDEHYDE.

DECKING

THE OWNER.

SIDING

"VANISH RAINSCREEN" BY IRONWOODS. PROVIDE SAMPLE TO FOR OWNER'S APPROVAL

ROUGH CARPENTRY & SOLID STRUCTURAL LUMBER SEE PLANS

FINISH CARPENTRY

SOLID RED OAK 2¹/₄ WIDE WOOD FLOORING, FSC CERTIFIED, RIFT & QUARTER SAWN, SELECT OR BETTER, ALLEGHANY HARDWOOD OR SIMILAR, FINISHED IN FIELD TO MATCH EXISTING WOOD FLOOR. PROVIDE FINISH SAMPLE FOR OWNER'S APPROVAL.

DIV 07

INSULATION

INTERIOR - MINERAL WOOL SOUND ATTENUATION INSULATION EXTERIOR - ECOTOUCH PINK FIBERGLASS R-14 PLUS EXTRUDED POLYSTYRENE R5 PER INCH

ROOF ASSEMBLY

CONTRACTOR IS RESPONSIBLE FOR COMPATIBILITY OF SELECTED FLASHING, ROOFING, AND WATERPROOF AIR BARRIER TO FORM A COMPLETE WATERTIGHT BUILDING ENVELOPE. PROVIDE A COPY OF PRODUCT DATA TO OWNER. PROVIDE A 20 YEAR WARRANTY FOR ROOFING AND GREEN ROOF. ROOFING MANUFACTURER TO VISIT SITE AND PROVIDE A LETTER CERTIFYING QUALITY CRAFTSMANSHIP AND COMPATIBILITY OF MATERIALS.

EPDM ROOFING - NOTED UNDER GREEN ROOF ABOVE.

SEALANT

DIV 08

SLIDING DOOR WESTERN WINDOWS SERIES 7650 SLIDING GLASS DOOR WITH INSULATED GLAZING, LOW-E COATING AND A THERMALLY BROKEN


ARCHITECTURE FOREVER

Sie

4500 East West Highway #125 Bethesda, MD 20814 (240) 760-1037

NOTE: Drawing may be printed at reduced scale

DRAFT - NOT FOR CONSTRUCTION

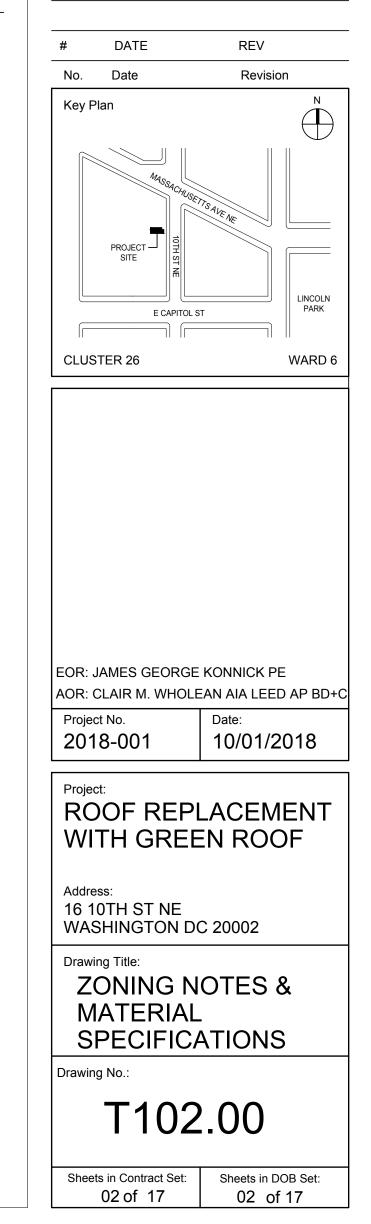

MATERIAL SPECIFICATIONS

THE FOLLOWING MATERIALS ARE THE BASIS OF DESIGN. ALL SUBSTITUTIONS MUST BE APPROVED BY THE OWNER AND THE AOR

1X6 IPE, ADVANTAGE LUMBER OR SIMILAR. PROVIDE A 2 YEAR SUPPLY OF A A LOW-VOC SEALER RECOMMENDED BY IPE MANUFACTURER TO

1X6 IPE SHIPLAP SIDING WITH RAINSCREEN SYSTEM - BASIS OF DESIGN

ROOF FLASHING - PROVIDE EPDM COMPATIBLE WITH MEMBRANE.

WINDOWS & SKYLIGHTS

FRAME.

PELLA, ANDERSON, MARVIN, WESTERN WINDOWS, THERMALLY BROKEN FRAME WITH INSULATED GLASS UNIT, CLEAR GLASS AND LOW-E COATING WITH 0.40 SHGC OR BETTER FOR WINDOWS AND A SKYLIGHT U-FACTOR OF 0.55 OR BETTER. SUBMIT COLOR SAMPLES TO **OWNER & AOR. PROVIDE SINGLE SOURCE MANUFACTURER FORALL** DIV 8 MATERIALS. SUBMISSION OF PRODUCT DATA AND OWNER OR AOR APPROVAL IS REQUIRED FOR ALL DIV 8 MATERIALS PRIOR TO INSTALLATION. WINDOW U-FACTOR 0.32 OR BETTER PER IRC 402.1.2. OPERABLE WINDOWS TO HAVE LOCKING HARDWARE AND BE FITTED WITH SCREENS TYP.

DIV 09

INTERIOR PAINT

BENJAMIN MOORE AURA OR EQUAL LOW-VOC BRAND, COLOR TO MATCH EXISTING WALLS OR OWNER'S CHOICE.

PLUMBING:

PROVIDE NATURAL GAS CONVERSION KIT FOR FIRE TABLE AND GRILL AND INSTALL NATURAL GAS SERVICE TO THE ROOF TO SERVE BOTH. DESIGN ROUTING OF PIPE TO MINIMIZE IMPACT TO EXISTING CONSTRUCTION. PROVIDE PATCHING OF AREAS OPENED UP FOR GAS PIPE AND FINISH TO MATCH ADJACENT CONSTRUCTION. ADVISE OWNER ON PREFERRED GAS ROUTE AND IMPACT TO EXISTING CONSTRUCTION PRIOR TO SELECTIVE DEMOLITION. MINIMIZE IMPACT TO KITCHEN.

ELECTRICAL:

LIGHTING

CONTRACTOR TO PROVIDE ALL WIRING, ACCESSORIES AND SERVICE TO ENSURE A COMPLETE AND FUNCTIONAL ELECTRICAL INSTALLATION. ALL ELECTRICAL WORK TO BE BY A LICENSED ELECTRICIAN. SWITCHES ARE OWNER'S CHOICE.

PROVIDE GFCI AND EXTERIOR GRADE RECEPTACLES WITH ENCLOSED COVER PLATE FOR ELECTRICAL SERVICE ON ROOF.

DOWNLIGHTS:


LED:

SCONCE MAY BE OWNER PROVIDED, CONTRACTOR INSTALLED


FURNITURE OWNER PROVIDED, CONTRACTOR INSTALLED.

DEMOLITION NOTES

- 1. THIS PROJECT CONTAINS AN ACTIVE LEAK AROUND THE STAIR BULKHEAD WHICH MAY HAVE CAUSED DETERIORATION OF ARCHITECTURAL OR STRUCTURAL ELEMENTS NOT NOTED ON PLAN. IN THE CASE THAT ADDITIONAL DETERIORATED ELEMENTS ARE ENCOUNTERED, NOTIFY THE AOR FOR REMEDY. REPAIR OR REPLACEMENT OF ALL ELEMENTS DAMAGED BY LEAK IS INCLUDED IN THE SCOPE OF WORK.
- 2. PROVIDE TEMPORARY PROTECTION OF THE STAIR BULKHEAD, ROOF OPENINGS, AND ANY UNCOVERED ROOF AREAS THROUGHOUT THE DURATION OF CONSTRUCTION.
- 3. ROOF MOUNTED EQUIPMENT, CONDUIT, PIPE PENETRATIONS AND OTHER ROOF TOP ELEMENTS TO BE PROTECTED THROUGHOUT THE DURATION OF CONSTRUCTION.
- 4. DRAWINGS ARE BASED ON ARCHITECTURAL OBSERVATION OF EXISTING CONDITIONS. CONTRACTOR TO TAKE FIELD MEASUREMENTS AND VERIFY DIMENSIONS PRIOR TO FABRICATION AND INSTALLATION.
- 10. MATERIAL OF DEMOLTION SHALL BE DISPOSED OFF SITE. SALVAGE OR RECYCLE EXISTING MATERIALS WHEN REASONABLY POSSIBLE TO REDUCE CONSTRUCTION




- 11. SELECTIVE DEMOLITION IS TO BE DONE IN A WORKMANLIKE MANNER AND BE LIMITED TO THE AREAS INDICATED ON DRAWINGS. CREATE A CLEAR BOUNDARY BETWEEN REQUIRED SELECTIVE DEMOLITION AND ARCHITECTURAL ELEMENTS TO REMAIN AND BE PROTECTED. DAMAGE TO ANY PART OF THE BUILDING DUE TO SELECTIVE DEMOLITION IS THE CONTRACTOR'S RESPONSIBILITY TO REPAIR TO MATCH THE ORIGINAL CONDITION.
- 12. ALL SELECTIVE DEMOLITION AND REMOVALS IS TO BE PERFORMED IN ACCORDANCE WITH ALL APPLICABLE ENVIRONMENTAL AND SAFETY REGULATIONS ACCORDING TO FEDERAL, STATE AND LOCAL LAWS. COMPLIANCE IS THE CONTRACTOR'S RESPONSIBILITY.
- 13. PROVIDE DUST CONTROL MEASURES SO THAT CONSTRUCTION DUST DOES NOT ENTER THE LIVING AREA OR MECHANICAL SYSTEM.
- 14. AFTER DEMOLITION OF MATERIALS, THE RESULTING EXPOSED SURFACE SHALL MATCH AND BE SMOOTH, LEVEL AND FLUSH WITH EXISTING CONDITIONS.

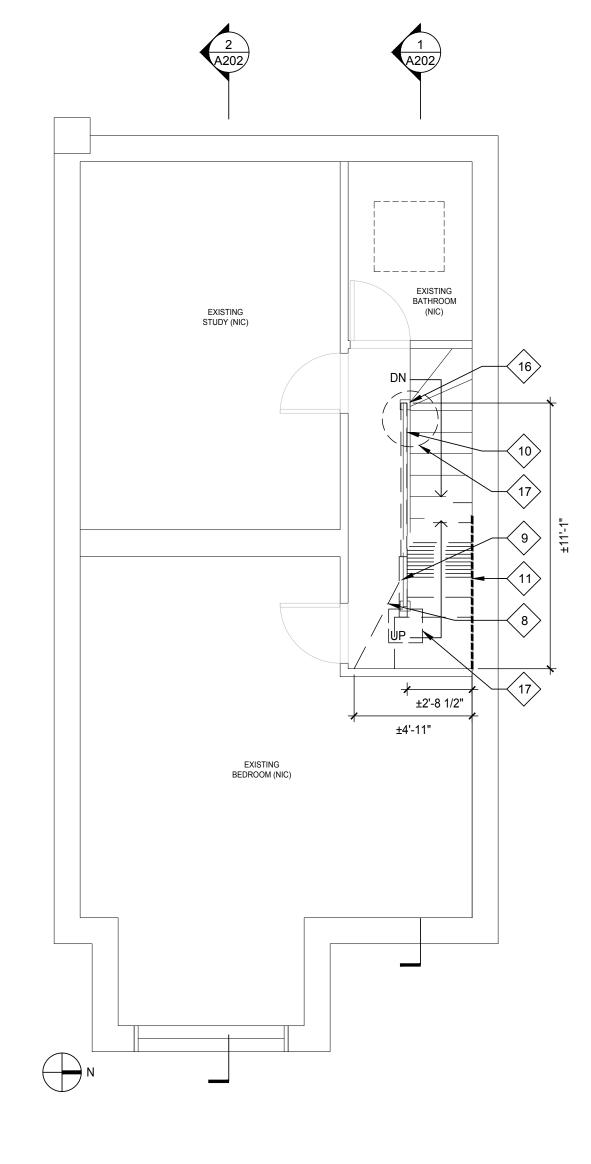


SECOND FLOOR DEMOLITION PLAN

2

1/4" = 1'-0"

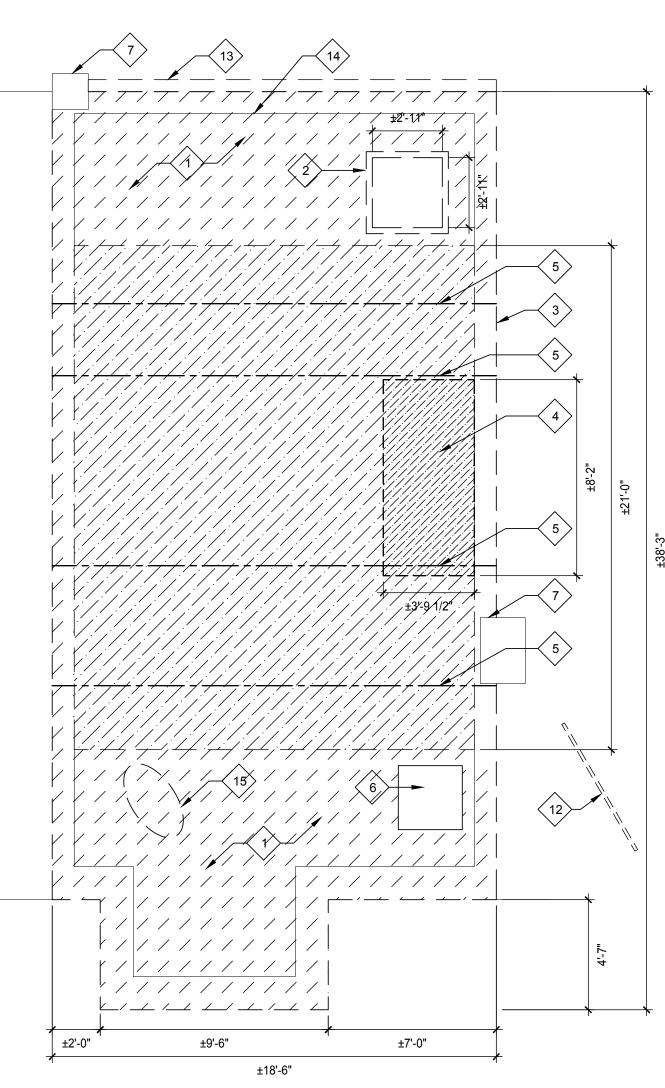

1/4" = 1'-0"

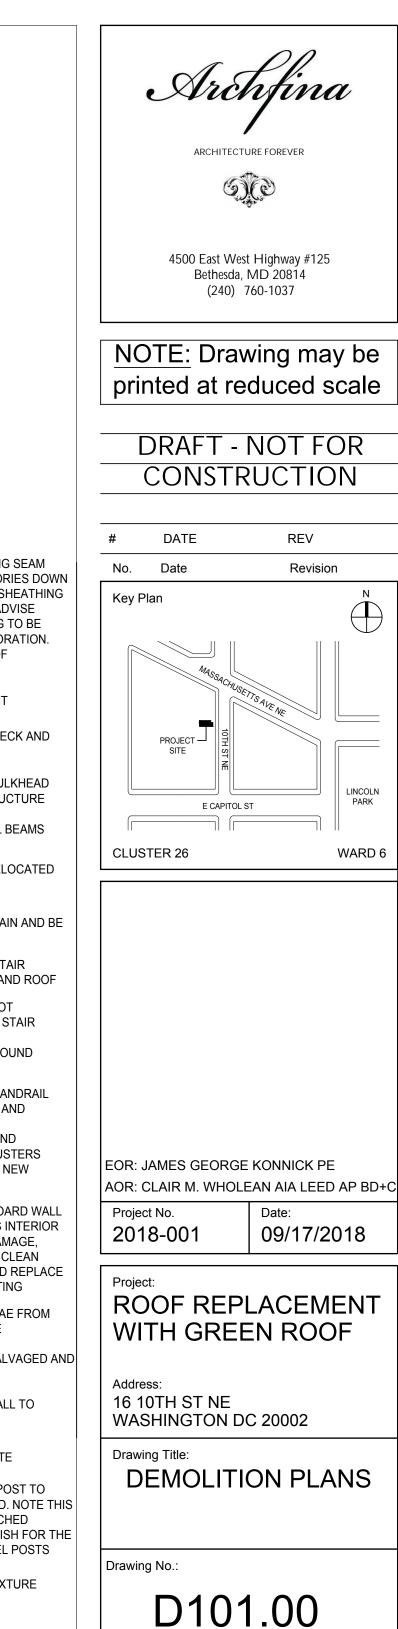

Sheets in Contract Set:

03 of 17

Sheets in DOB Set:

03 of 17

ROOF DEMOLITION PLAN



 $\langle 1 \rangle$

 $\langle 2 \rangle$

 $\langle 3 \rangle$

 $\langle 4 \rangle$

 $\langle 5 \rangle$

 $\langle 6 \rangle$

< 7 >

 $\langle 8 \rangle$

<٩>

 $\langle 10 \rangle$

(13)

 $\langle 16 \rangle$

 $\langle 17 \rangle$

REMOVE EXISTING STANDING SEAM METAL ROOF AND ACCESSORIES DOWN TO SHEATHING. EVALUATE SHEATHING FOR WATER DAMAGE AND ADVISE OWNER/AOR ON SHEATHING TO BE REPLACED DUE TO DETERIORATION. NOTE STANDING SEAM ROOF CONTINUES UNDER DECK

REMOVE EXISTING SKYLIGHT

REMOVE EXISTING WOOD DECK AND HANDRAILS

REMOVE EXISTING STAIR BULKHEAD ENCLOSURE DOWN TO STRUCTURE

REMOVE(4) EXISTING STEEL BEAMS AND MASONRY PEDESTALS

EXISTING AC UNIT TO BE RELOCATED AND PROTECTED DURING CONSTRUCTION

EXISTING CHIMNEY TO REMAIN AND BE PROTECTED

REMOVE EXISTING WOOD STAIR BETWEEN SECOND FLOOR AND ROOF

REMOVE EXISTING WAINSCOT PARTITION AND EMBEDDED STAIR STRINGER. NOTIFY AOR IF STRUCTURE OR PIPING IS FOUND INSIDE PARTITION

REMOVE EXISTING WOOD HANDRAIL AND BALUSTERS. SALVAGE AND PROTECT FOR MATCHING REPLACEMENT HANDRAIL AND

BALUSTERS. EXISTING BALUSTERS MAY BE REINSTALLED WITH NEW HANDRAIL.

REMOVE ±25 SF GYPSUM BOARD WALL OR PLASTER WALL, ASSESS INTERIOR OF PARTITION FOR LEAK DAMAGE, $\langle 11 \rangle$ REPAIR DEGRADED STUDS, CLEAN INTERIOR OF PARTITION AND REPLACE PARTITION TO MATCH EXISTING

REMOVE EXISTING ANTENNAE FROM $\langle 12 \rangle$ ROOF OF ADJACENT HOUSE

> EXISTING GUTTER TO BE SALVAGED AND REINSTALLED

EXISTING LOW PARAPET WALL TO (14) REMAIN

REMOVE EXISTING SATTELITE

REMOVE EXISTING NEWEL POST TO REMAIN AND BE PROTECTED. NOTE THIS NEWEL POST IS TO BE MATCHED EXACTLY IN SHAPE AND FINISH FOR THE NEW CONSTRUCTION NEWEL POSTS

REMOVE EXISTING LIGHT FIXTURE









PHOTO C

- 1. SATELLITE IS VISIBLE AND WILL BE PERMANENTLY REMOVED AS PART OF THIS PROJECT.
- 2. AIR CONDITIONER IS VISIBLE AND WILL BE RELOCATED 2'-10" TO THE REAR.
- 2. EXISTING GUARDRAIL IS VISIBLE. THE LINE OF THE NEW GUARDRAIL IS 5'-7" FT BEHIND THE EXISTING GUARDRAIL. SEE PLAN ON A002.

SATELLITE

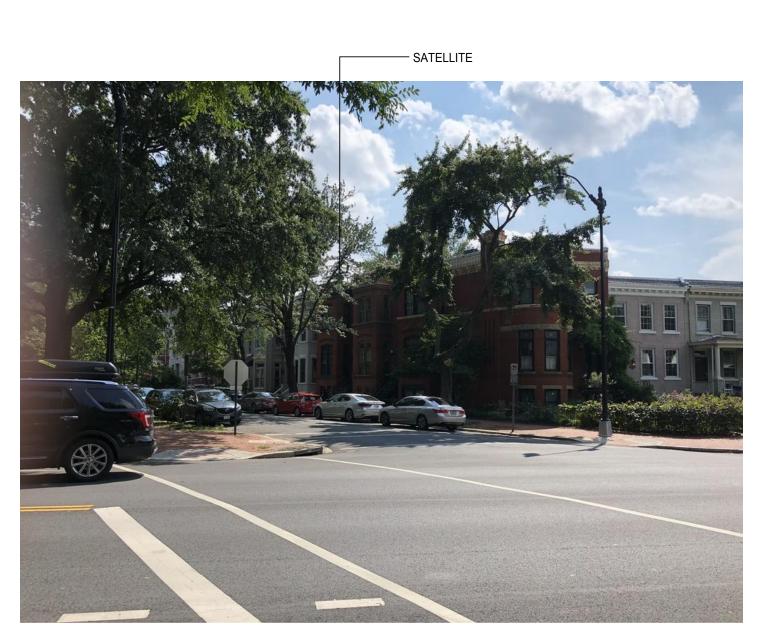

- STAIR BULKHEAD


- GUARDRAIL

PHOTO B 1. SATELLITE IS VISIBLE AND WILL BE PERMANENTLY REMOVED AS PART OF THIS PROJECT.



PHOTO D

- EXISTING STAIR BULKHEAD IS VISIBLE. THE NEW STAIR BULKHEAD WILL HAVE A SLOPING TOP REMOVING IT FROM THE VIEWSHED. 1.
- 2. EXISTING GUARDRAIL IS VISIBLE. THE LINE OF THE NEW GUARDRAIL IS 5'-7" FT BEHIND THE EXISTING GUARDRAIL. SEE PLAN ON A002.
- 3. EXISTING SATTELITE IS ALSO VISIBLE AND WILL BE PERMANENTLY REMOVED.

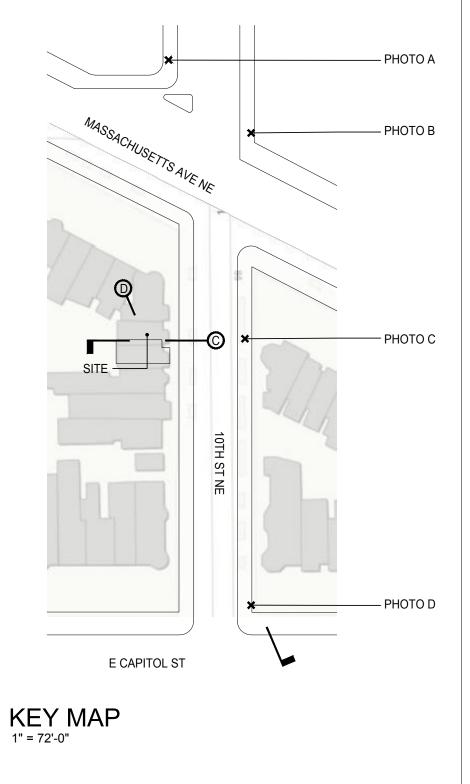



Architecture forever
4500 East West Highway #125 Bethesda, MD 20814 (240) 760-1037
NOTE: Drawing may be printed at reduced scale
DRAFT - NOT FOR CONSTRUCTION
DATE REV
No. Date Revision
CLUSTER 26 WARD 6
EOR: JAMES GEORGE KONNICK PE AOR: CLAIR M. WHOLEAN AIA LEED AP BD+C Project No. 2018-001 Date: 09/17/2018
Project: ROOF REPLACEMENT WITH GREEN ROOF Address: 16 10TH ST NE
WASHINGTON DC 20002 Drawing Title: HISTORIC VIEWSHED COMPLIANCE
Drawing No.: A001.00


Sheets in Contract Set:

04 of 17

Sheets in DOB Set: 04 of 17

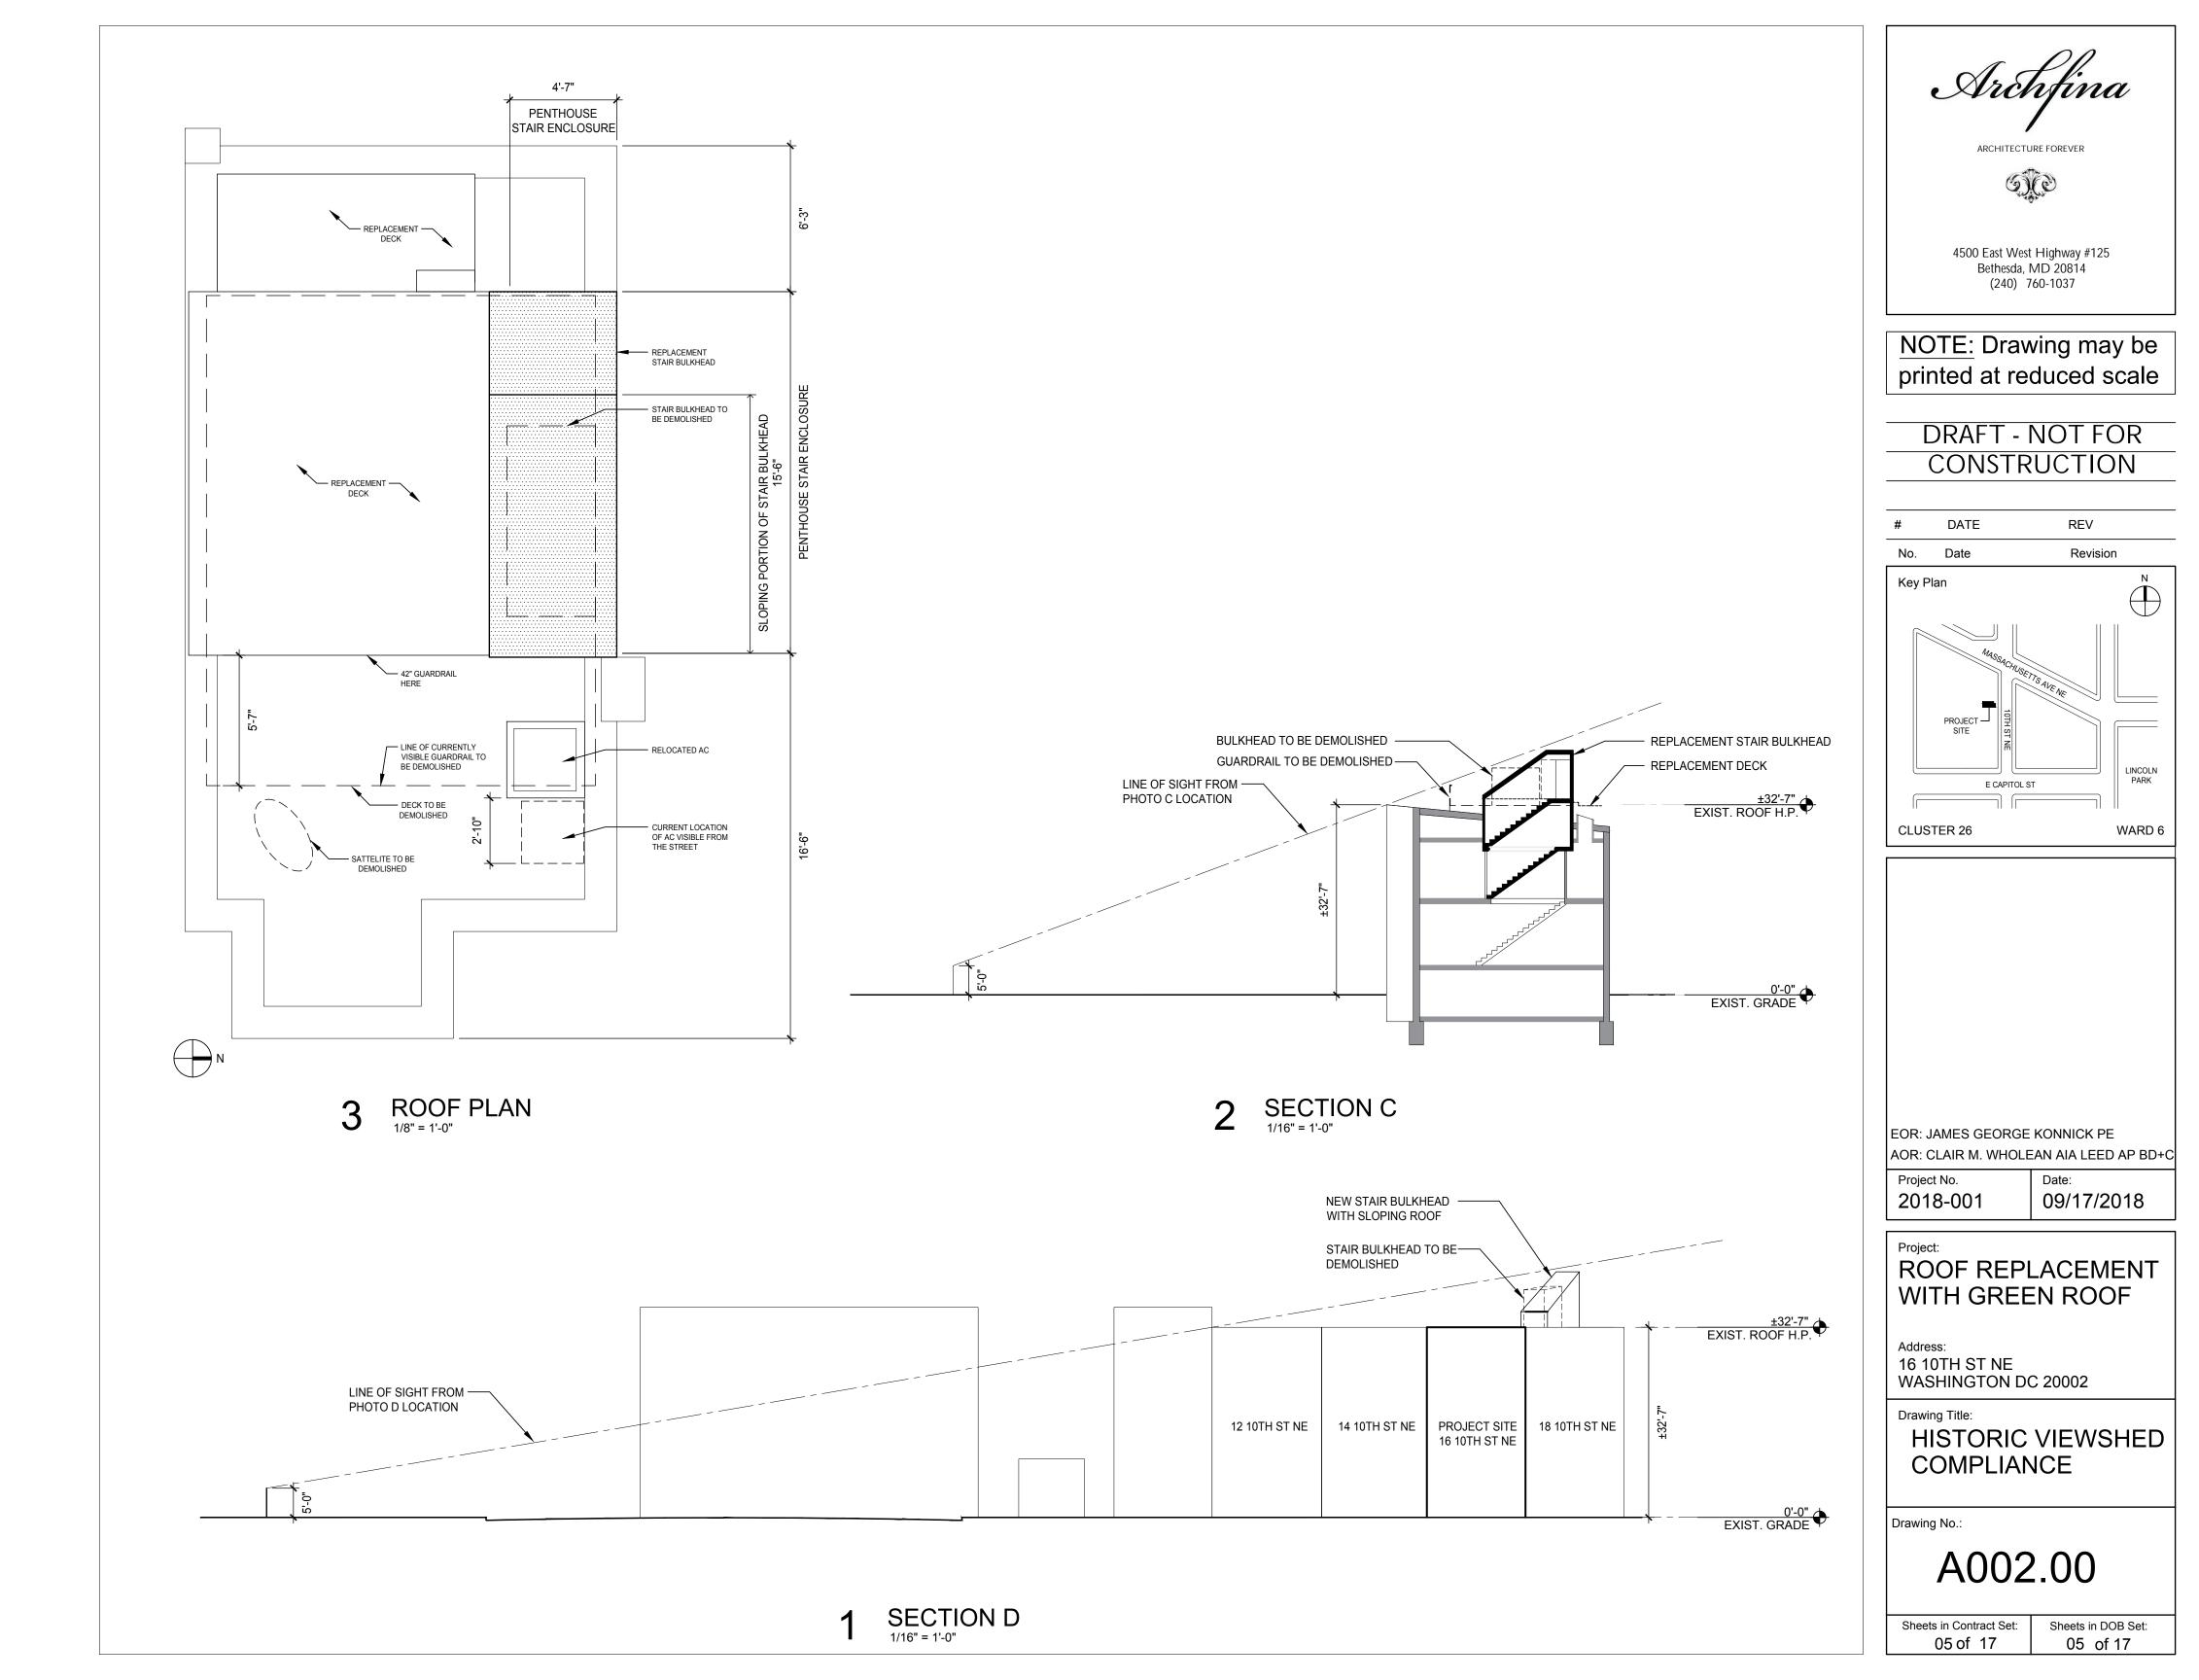

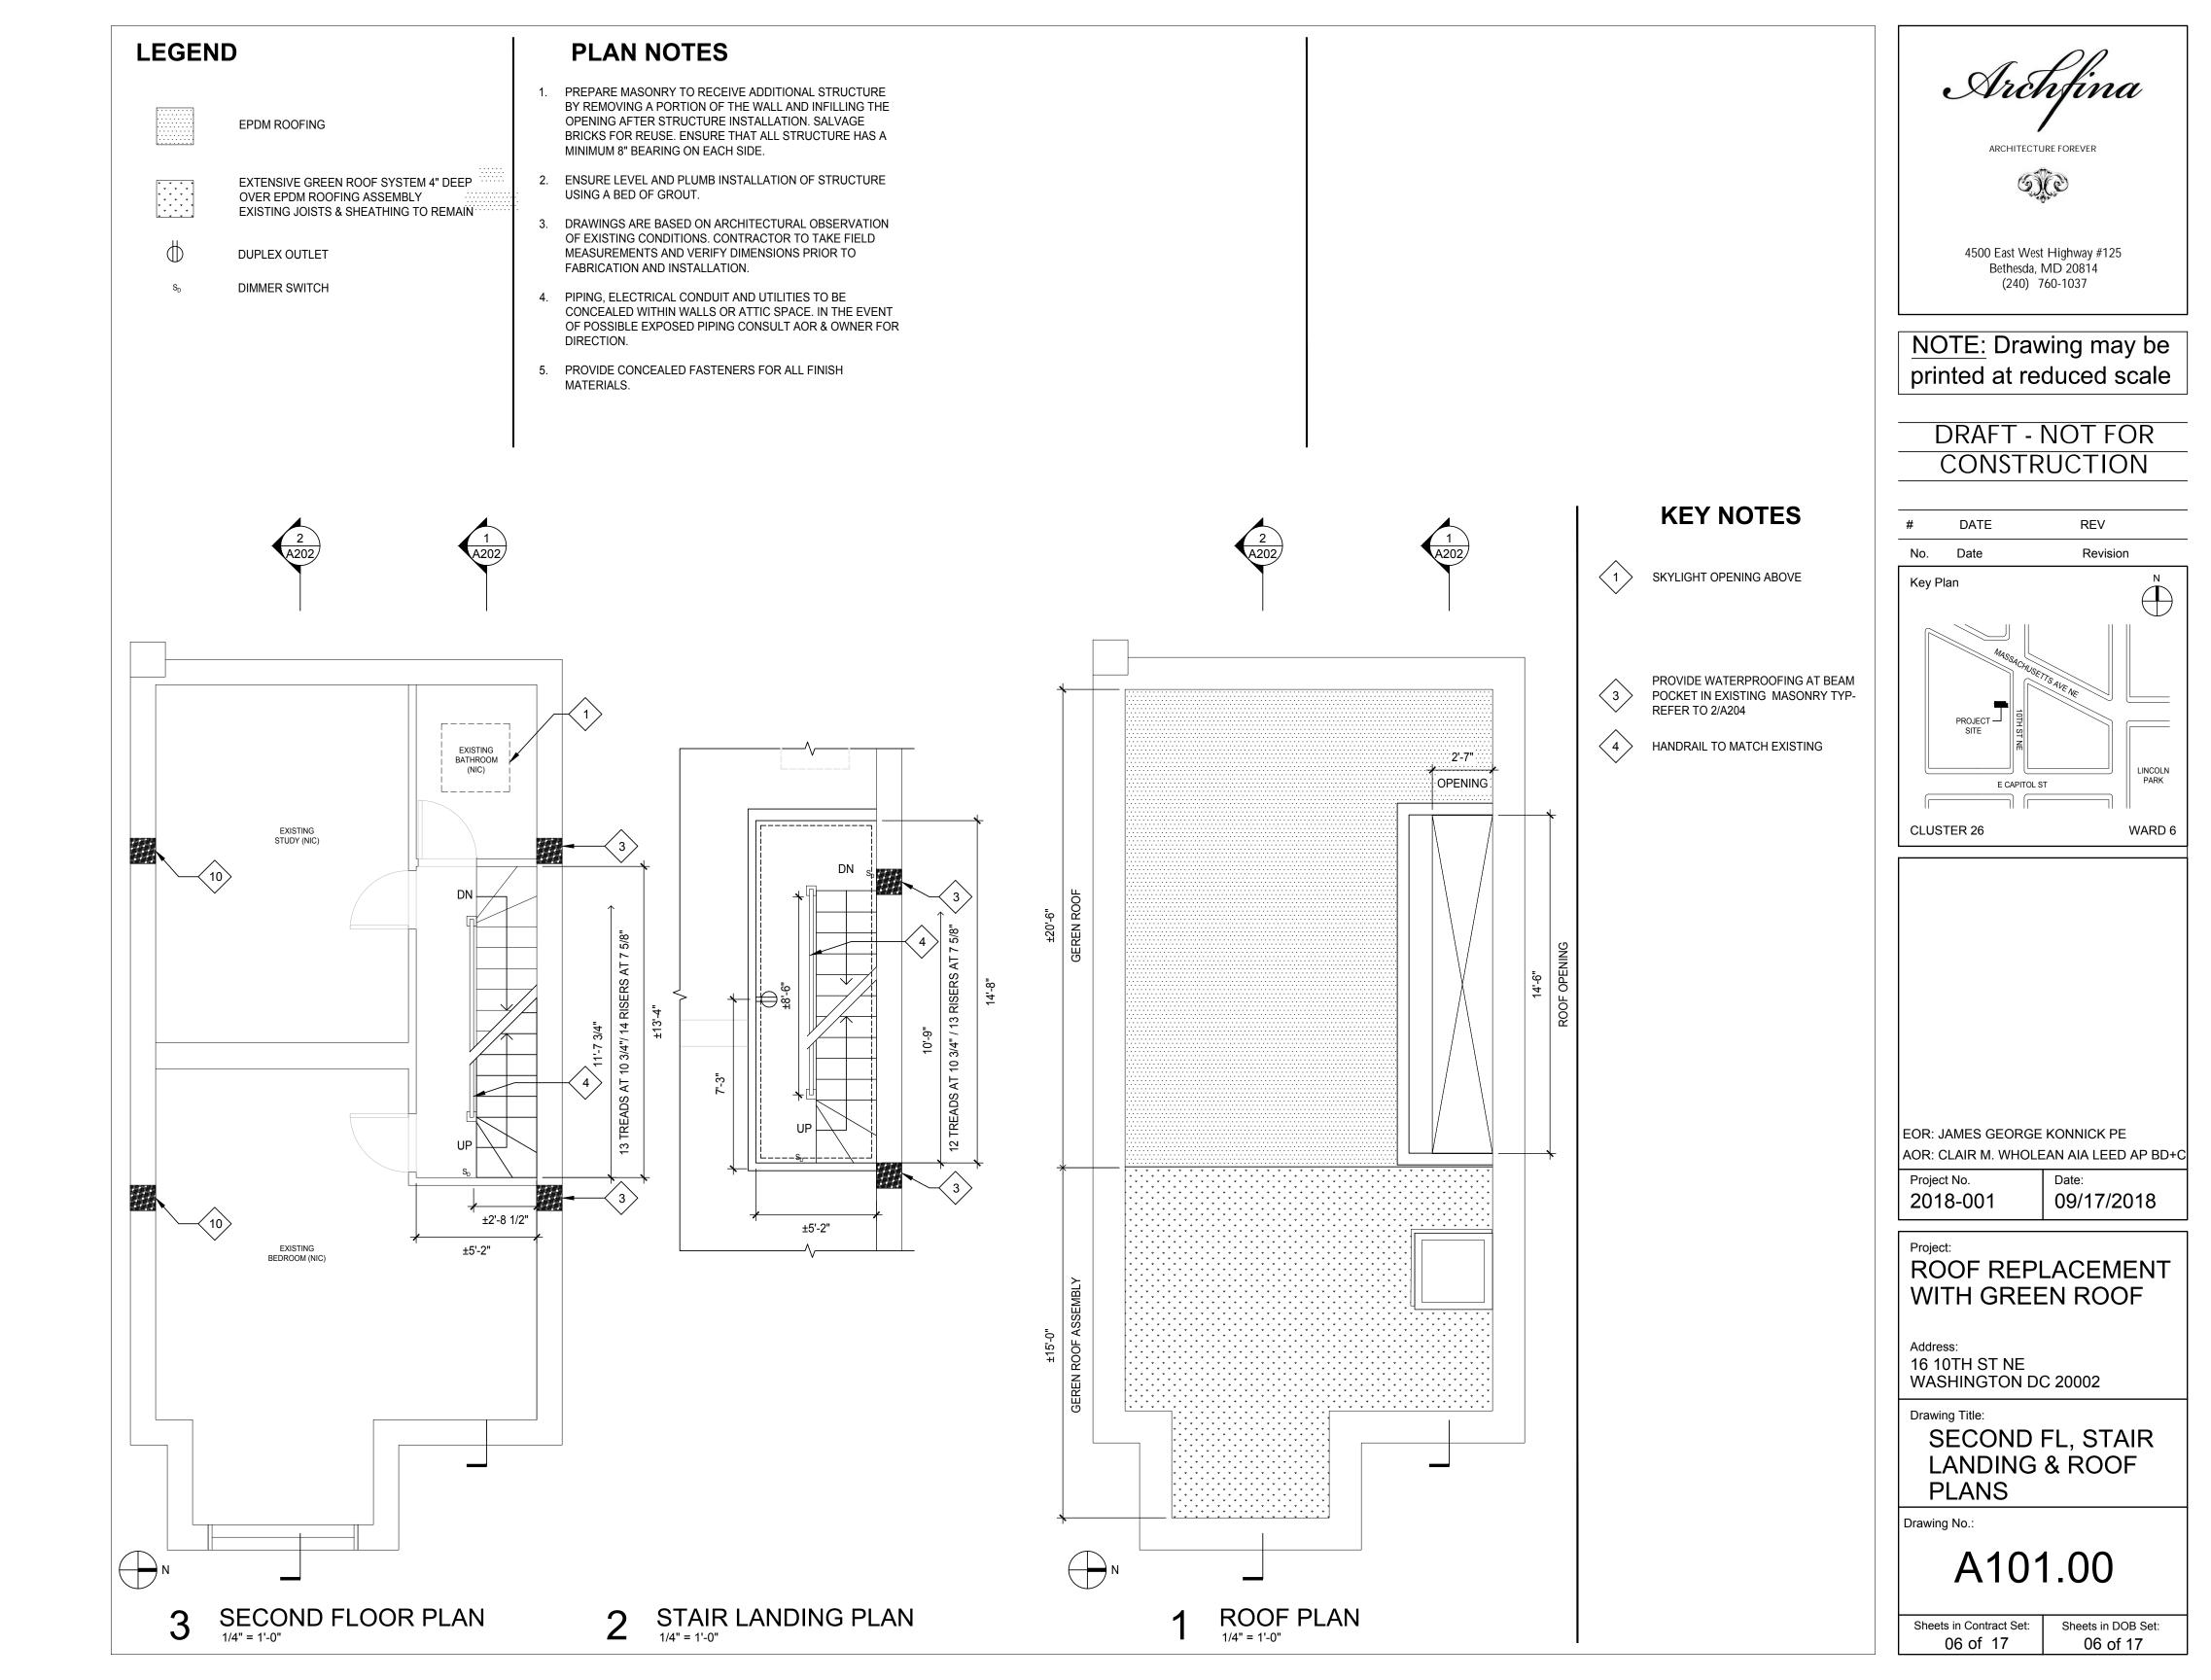

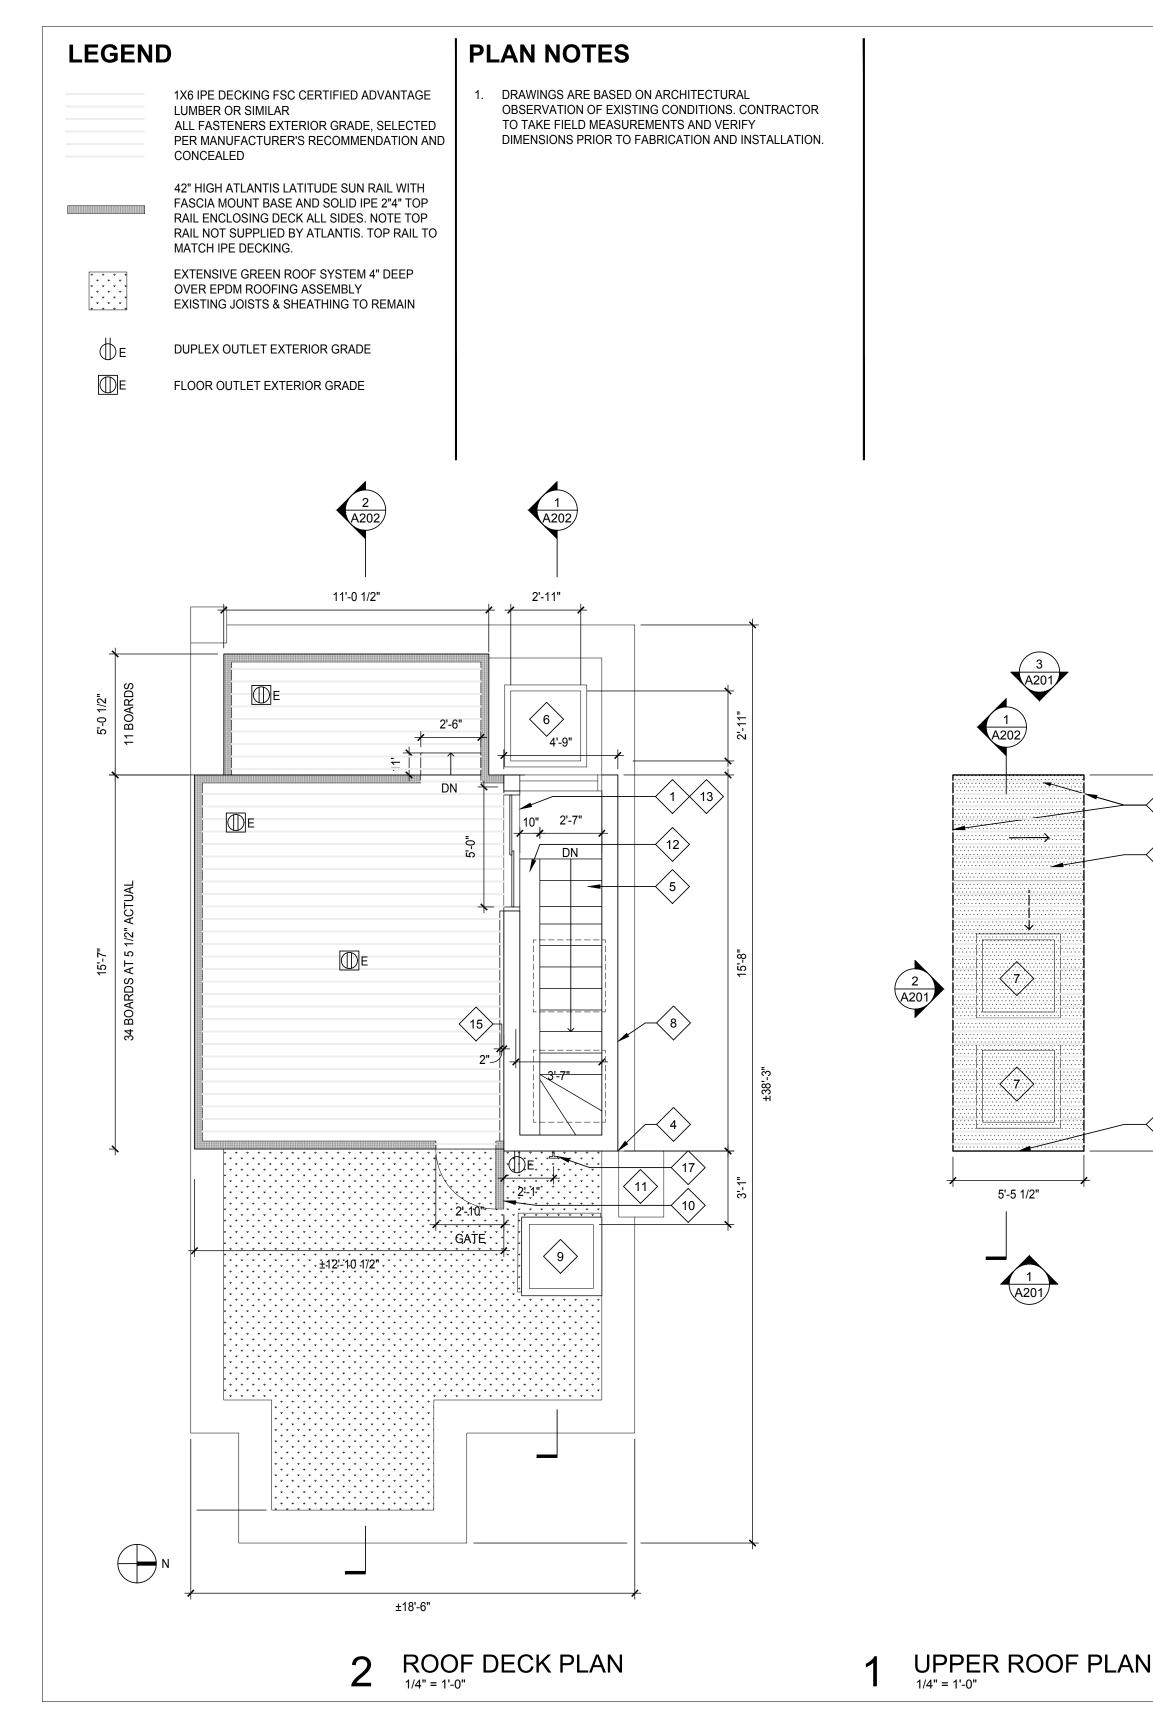

Archfina ARCHITECTURE FOREVER SC 4500 East West Highway #125 Bethesda, MD 20814 (240) 760-1037 NOTE: Drawing may be printed at reduced scale DRAFT - NOT FOR CONSTRUCTION REV # DATE Revision No. Date Key Plan \square PROJECT SITE LINCOLN PARK E CAPITOL ST CLUSTER 26 WARD 6 EOR: JAMES GEORGE KONNICK PE AOR: CLAIR M. WHOLEAN AIA LEED AP BD+C Project No. Date: 2018-001 09/17/2018 Project: **ROOF REPLACEMENT** WITH GREEN ROOF Address: 16 10TH ST NE WASHINGTON DC 20002

Drawing Title:

Drawing No.:

Sheets in Contract Set:

07 of 17

ROOF DECK PLAN

A102.00

Sheets in DOB Set:

07 of 17

& ROOF PLAN

KEY NOTES

 $\langle 1 \rangle$

 $\langle 2 \rangle$

 $\langle 3 \rangle$

4

 $\langle 5 \rangle$

6

7`

8

 $\langle 9 \rangle$

(10)

 $\begin{pmatrix} 11 \end{pmatrix}$

(12)

14

 $\langle 17 \rangle$

THRESHOLD FROM SLIDING DOOR MANUFACTURER

EXTEND EXISTING PLUMBING VENT STACK TO

RELOCATE EXISTING AC UNIT AS INDICATED AND ENSURE THAT UNIT IS NOT VISIBLE FROM 10TH ST ALTERNATE SIDE

PROVIDE 1/2" AIR GAP AT EXISTING BRICK CHIMNEY

HARDWOOD RED OAK FLOORING ON STAIR AND LANDING

REPLACEMENT SKYLIGHT TO MATCH EXISTING IN SIZE AND PROVIDE UPGRADED ENERGY EFFICIENCY PER T002. EXTEND ROOF FLASHING TO THE FULL HEIGHT OF THE CURB

3'-0" X 3'-0" SKYLIGHT

STAIR ENCLOSURE STUD WALL W/ IPE RAINSCREEN REFER TO DTL ON A201

RELOCATED EXISTING AC UNIT

GATE IN GAURDRAIL SYSTEM. CONSTRUCT TO MATCH GAURDRAIL SO GATE IS DISGUISED AND VISUALLY APPEARS AS A PART OF THE RAILING SYSTEM

EXISTING CHIMNEY TO REMAIN AND BE PROTECTED

OWNER PROCURED MARBLE SILL

 13
 SLIDING DOOR 5'-0" X 6'-8"

1/6 IPE SHIPLAP SIDING RAINSCREEN SLOPE 1/2" PER FOOT OVER 5/8" PLYWOOD SHEATHING WITH CONTINUOUS WATERPROOF AIR BARRIER. PROVIDE R49 MIN INSULATION

FOR ROOF OF ENCLOSURE 2" REVEAL BETWEEN DECK AND STAIR (15) ENCLOSURE

2X4 ALL STUDS DOUBLE (2) 2X4 @ 16" O.C. WITH HORIZONTAL BRACING 48" O.C. AND DOUBLE HEADERS AROUND ALL OPENINGS

RELOCATE EXISTING HOSE BIB

16

[14]


16)

LEGEND

O RECESSED ADJUSTABLE WALL WASH LED DOWNLIGHT

PLAN NOTES

1. DRAWINGS ARE BASED ON ARCHITECTURAL OBSERVATION OF EXISTING CONDITIONS. CONTRACTOR TO TAKE FIELD MEASUREMENTS AND VERIFY DIMENSIONS PRIOR TO FABRICATION AND INSTALLATION.

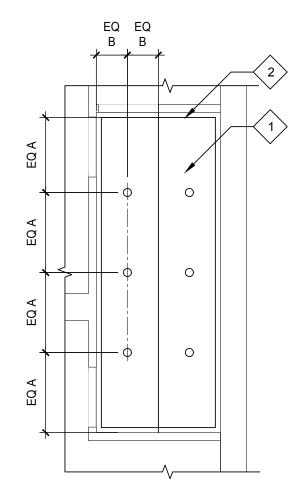

	Are	hfin	A.
e	<i>_~</i> ~~	/////	
	ARCHITEC	TURE FOREVER	
	Ę	ĴÇ Ŏ	
	Bethesda	est Highway #125 a, MD 20814 760-1037	5
		wing ma educed s	
D	RAFT -	NOT F	OR
(CONST	RUCTIO	DN
#	DATE	REV	
No.	Date	Revisio	on N
CLUST		SETTS AVE NE	LINCOLN PARK WARD 6
AOR: C Project	LAIR M. WHO	E KONNICK P LEAN AIA LEE Date: 09/17/2	D AP BD+0
	OF REF	PLACEN EN ROC	
	^{s:} ITH ST NE HINGTON I	DC 20002	
	-	FED CEI	LING
Drawing	No.:		
	A10	3.00	
	in Contract Set:	Sheets in D	IOB Set

08 of 17


08 of 17


2


PTD GYPSUM BOARD BENJAMIN MOORE OC-17 DOVE WHITE TYP ALL CEILINGS

KEY NOTES

PROVIDE CROWN MOLDING TO MATCH FIRST FLOOR ON SECOND FLOOR AND MEZZANINE IN PROFILE, FINISH AND COLOR

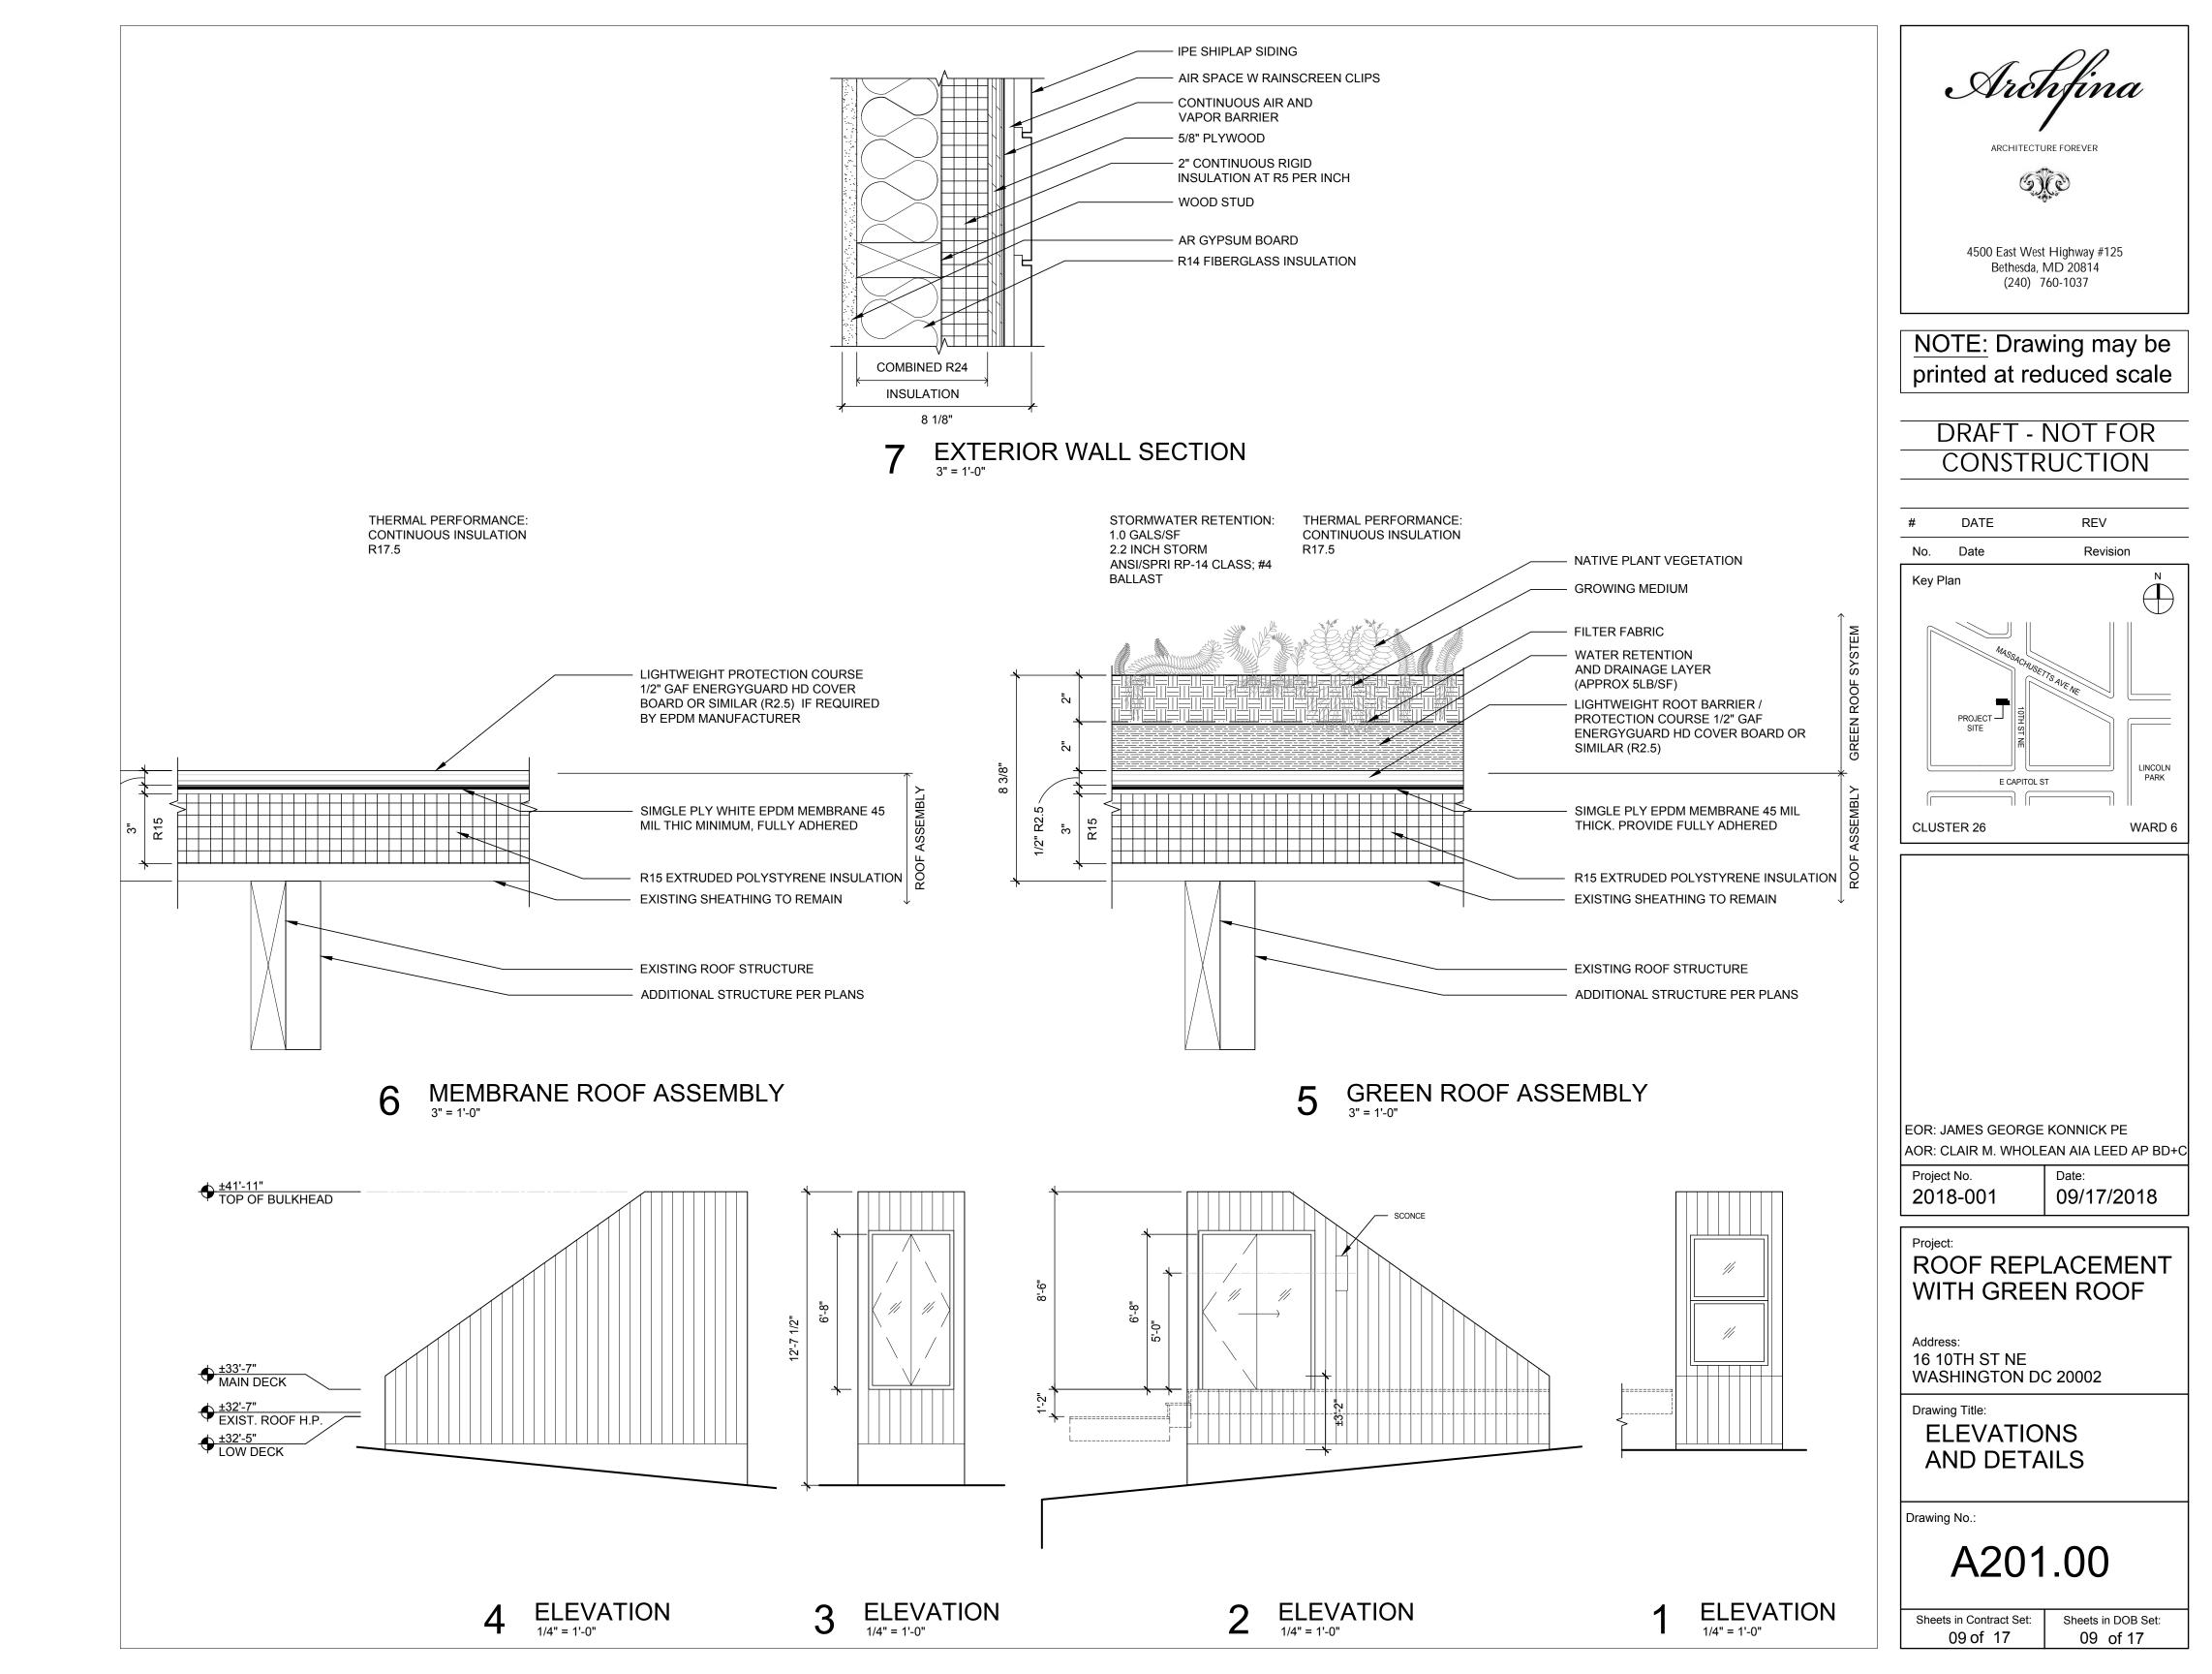

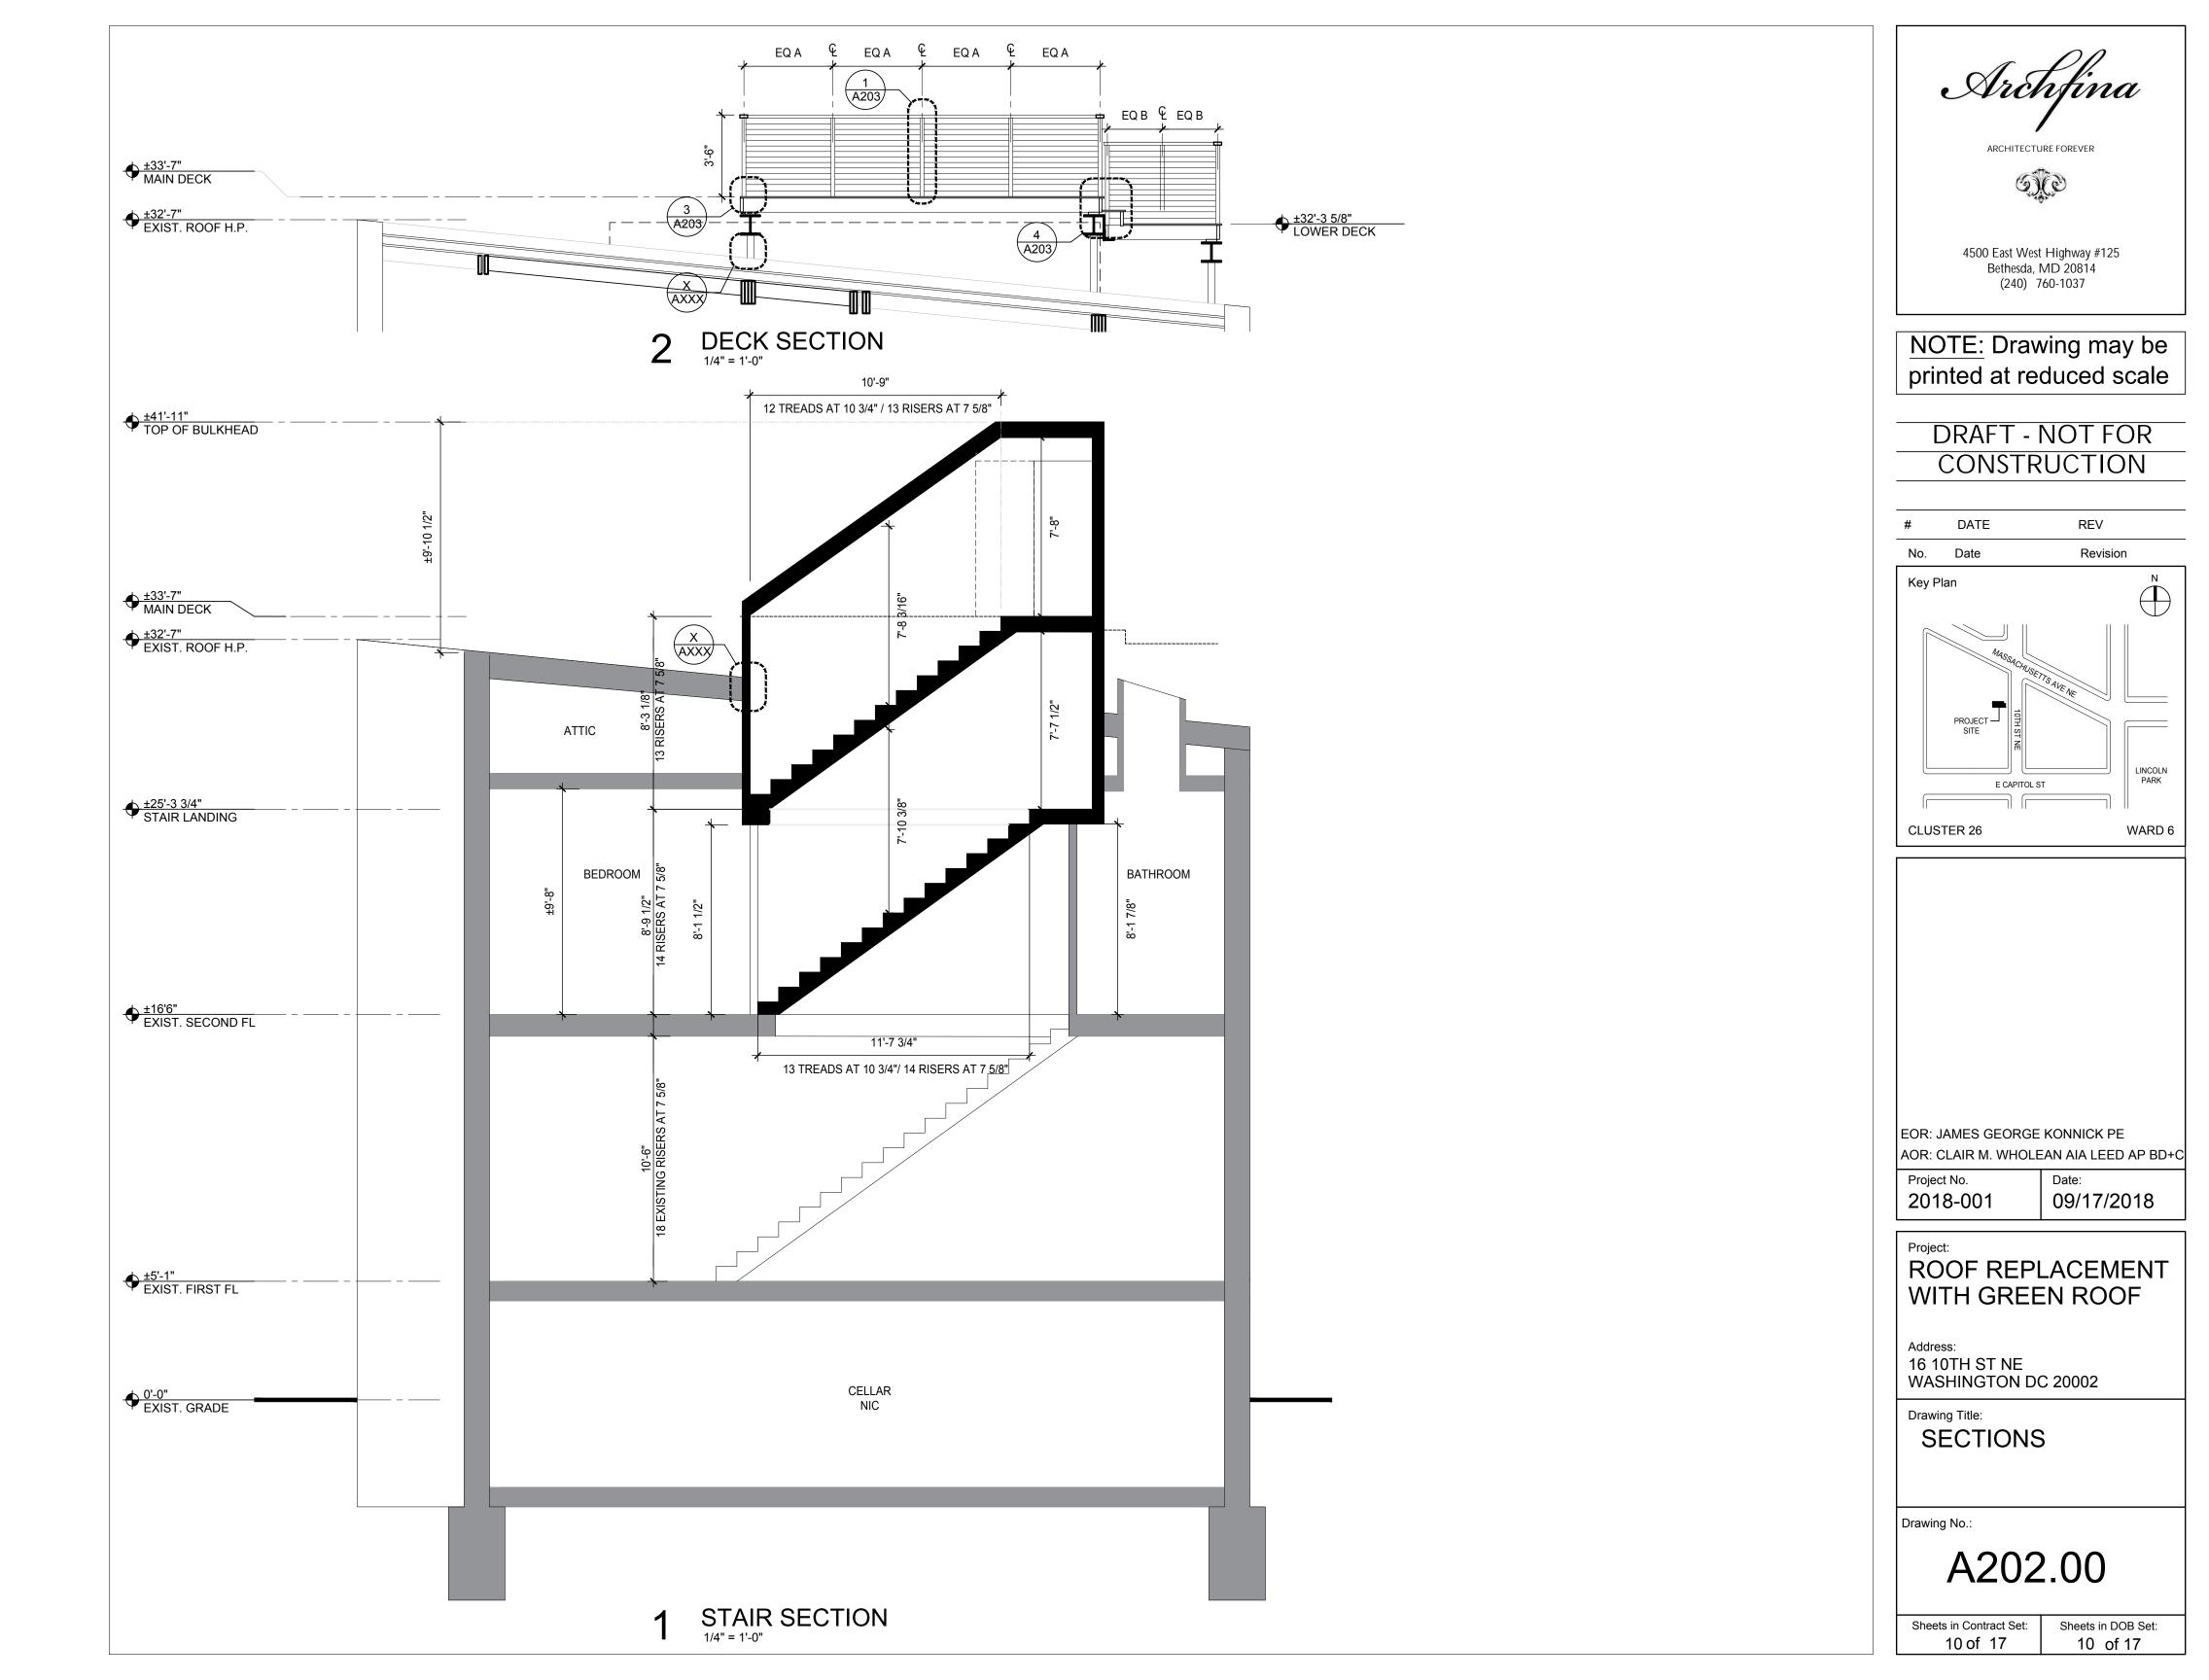

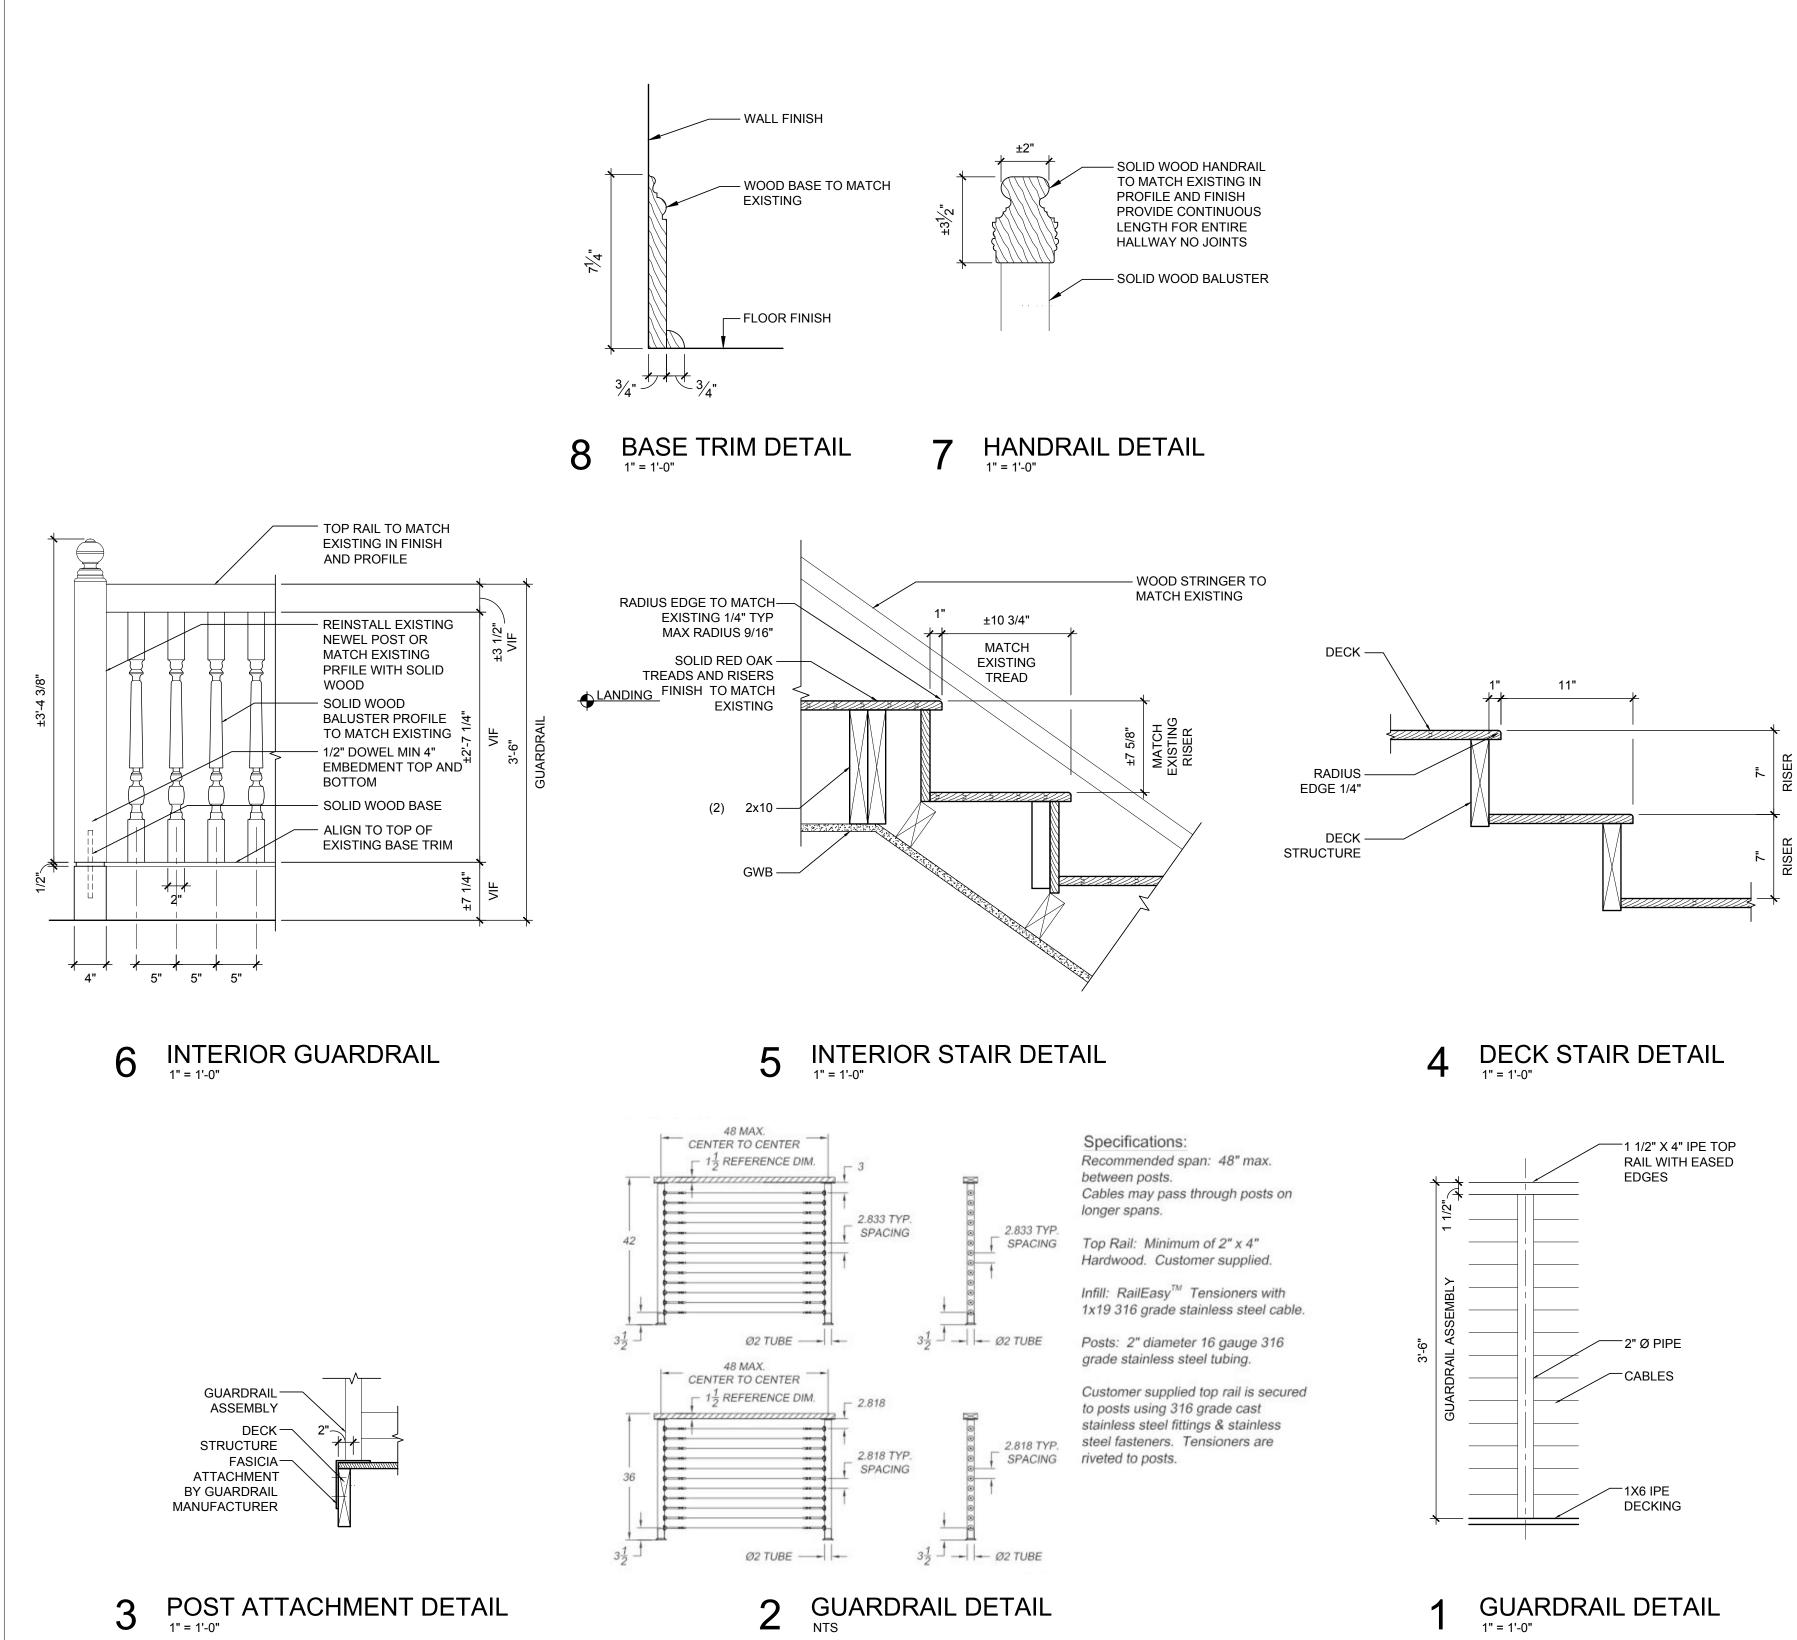

Archfina ARCHITECTURE FOREVER SCO 4500 East West Highway #125 Bethesda, MD 20814 (240) 760-1037 NOTE: Drawing may be printed at reduced scale DRAFT - NOT FOR CONSTRUCTION REV DATE # Revision No. Date Key Plan \bigcirc PROJECT SITE LINCOLN PARK E CAPITOL ST CLUSTER 26 WARD 6 EOR: JAMES GEORGE KONNICK PE AOR: CLAIR M. WHOLEAN AIA LEED AP BD+C Project No. Date: 09/17/2018 2018-001 Project: ROOF REPLACEMENT WITH GREEN ROOF Address: 16 10TH ST NE WASHINGTON DC 20002 Drawing Title: DETAILS Drawing No .: A203.00

Sheets in Contract Set:

11 of 17

Sheets in DOB Set:

11 of 17

Z /	AL	. N(DT	ES									
HE E II	E WAL INSTA	L AND	INFIL ON. S.	LING T ALVAG	ture e He E Bric Nimum	KS	2	AT	ALL B		LICES	OR CC	INUOUS' DNNECTI
١NS	ISTALI	LATIO	N OF S	STRUC	TURE								
TR. Y E	RACTO	ECTUR OR TO NSION	TAKE	FIELD		OF							
		E USEI DOCL			NCTION	I							
JSE	SED W		DT CAU	JSE DA	.L MAGE PERTY.								
ENT IT F JPP	its,in Port Plier	ICLUDI TIONS	ing Al To Al Or To	L ADD L OF SU	JBMITT								
VES	ES ANI	E AND D REP(AWING	ORT A	NY	TE THE				SI	PEC		LIN	NSP
		ME OR OCATI		_AR SI	Γυατιο	NS		STRU	ICTUR	AL STE	EL		
\TE	ED BE	and di Etwee Dr to f	EN AR	CHITE	CTURAL	L							
		BE CU PPROV											
INC		L BE RI MENSIO											
		ND PR			TING PLACE								
	-	ONSIB ORDIN	-		IPLYIN	G							
T R	REQU	N STRI JIREME IALL G	ENTS,	AS INE	DICATEI	D							
NTI CTI E W UC	TENDE TON. T WORK CTION	-	INDIC ONTR/ SHALL NS, ME	ATE TH ACTOR BE SO THOD	HE MEA SHALL DLELY S,	-							
e f Qu MS	FOR, (UENC 1S IN (OF AN	CONST ES, PF CONNE	TRUC ⁻ ROCEI ECTIO THEM	TION M DURES N WITH TO CA	, SAFÉ	ΤY							
R. T W D C JS (S IN S. R P	THE S THE S OBSE OR E N COM THE PERFO	GENER STRUC RVATI XHAU MPLIAN	PURPO RAL C CTURA ONS S STIVE NCE W RAL C IG ALL	OSE OF ONFOF L CON HOUL TO VE /ITH TH ONTRA	F THES RMANC TRACT D NOT RIFY IE ACTOR K IN	E BE							
ΕC	CONT	RACTO	OR. ST	RUCT	ENTS IS URAL NG THE	-							
LS	S HAV	/E SUF	FICIE	NT STF	ERECT RENGTI ECTINO	Н							
DI	IPPED	D GAL\	/ANIZI	ED MEI	MBERS	IS							
OT 123 432 ZE[t dipf 23 AFT 325 BC Ed Hai	PED G/ TER SA OLTS H RDENE	ALVAN ANDBL IOT DI ED WA	NIZED I AST C PPED SHER	LEANIN	IG							

SPECTIONS

DESIGN LOADS

ROOF

DEAD LOAD - 20 PSF LIVE LOAD - 30 PSF (SNOW)

GREEN ROOF

DEAD LOAD - 35 PSF LIVE LOAD - 30 PSF (SNOW)

WIND LOAD

WIND SPEED 115 MPH, EXPOSURE B

MATERIAL NOTES

STRUCTURAL STEEL

ALL W BEAMS A992. ALL OTHER STEEL A36.

ALL STEEL EXPOSED TO THE ELEMENTS SHALL BE GALVANIZED. REFER TO ALTERNATES ON T001.

LUMBER

ALL LUMBER EXCEPT STUDS SHALL BE YELLOW PINE NO. 1 PRESSURE TREATED ALL STUDS SHALL BE SPRUCE, PINE, OR FIR, SURFACE DRY,

CONSTRUCTION GRADE

BOLTS

ALL EXPANSION ANCHORS TO BE HILTI AND TO BE GALVANIZED STEEL OR STAINLESS STEEL FOR EXTERIOR APPLICATION.

MECHANICAL ANCHORS INTO MASONRY OR GROUT FILLED CELLS, USE THE FOLLOWING (UNO):

- A. HILTI KWIK BOLT 3 MASONRY ANCHORS (ICC-ES ESR1385)
- B. SIMPSON STRONG-TIE WEDGE-ALL ANCHOR(WA) (ICBO-ES ER-3631) (FL5415)

ADHESIVE ANCHORS INTO MASONRY OR GROUT FILLED CELLS, USE THE FOLLOWING (UNO):

- A. HILTI HIT HY-150 MAX ADHESIVE (ICC-ES ESR1967)
- B. SIMPSON STRONG-TIE SET EPOXY-TIE ADHESIVE (SET) (ICC-ES ESR1772)(FL5550)

<u>GROUT</u>

NON-SHRINK, NON-METALLIC GROUT WITH A 28 DAY STRENGTH OF 5000 PSI SHALL BE USED UNDER BASE PLATES AND SHALL CONFORM TO CORPS OF ENGINEERS CRD-C621, FACTORY PREMIX GROUT. SEE SPECIFICATIONS FOR TESTING REQUIREMENTS.

EXISTING CONDITIONS:


THE CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS DEPICTED ON THESE DRAWINGS AND NOTIFY ENGINEER AND ARCHITECT IF DIFFERENT.

WHERE EMBEDDING STRUCTURE INTO EXISTING MASONRY, CONTRACTOR SHALL VISUALLY INSPECT MASONRY AND ADVISE AOR/EOR IF THE MASONRY APPEARS NOT TO BE STRUCTURALLY SOUND IN ANY WAY. CONDITIONS SUCH AS WATER INFILTRATION, MOLD, LOOSE MORTAR, CRACKING OR CRUMBLING BRICKS, CRACKING OR DELAMINATED JOINTS AND HEAVY WEATHERING ARE TO BE REPORTED TO AOR/EOR FOR REPAIR PRIOR TO ANCHORING STRUCTURE. MASONRY REPAIRS REQUIRED FOR PROPER STRUCTURAL ANCHORING ARE INCLUDED IN THE SCOPE OF WORK.

Archfina	
ARCHITECTURE FOREVER	
ARCHITECTURE FOREVER	
4500 East West Highway #125 Bethesda, MD 20814 (240) 760-1037	
<u>NOTE:</u> Drawing may be printed at reduced scale	
DRAFT - NOT FOR	-
CONSTRUCTION	
# DATE REV	•
No. Date Revision	
CLUSTER 26 WARD 6	
EOR: JAMES GEORGE KONNICK PE AOR: CLAIR M. WHOLEAN AIA LEED AP BD+C	
Project No. Date: 2018-001 09/17/2018	
Project: ROOF REPLACEMENT WITH GREEN ROOF	
16 10TH ST NE WASHINGTON DC 20002	
Drawing Title: STRUCTURAL NOTES LOADS AND SPECIAL INSPECTIONS Drawing No.:	


Sheets in Contract Set: 13 Of 17 Sheets in DOB Set:


13 of 17

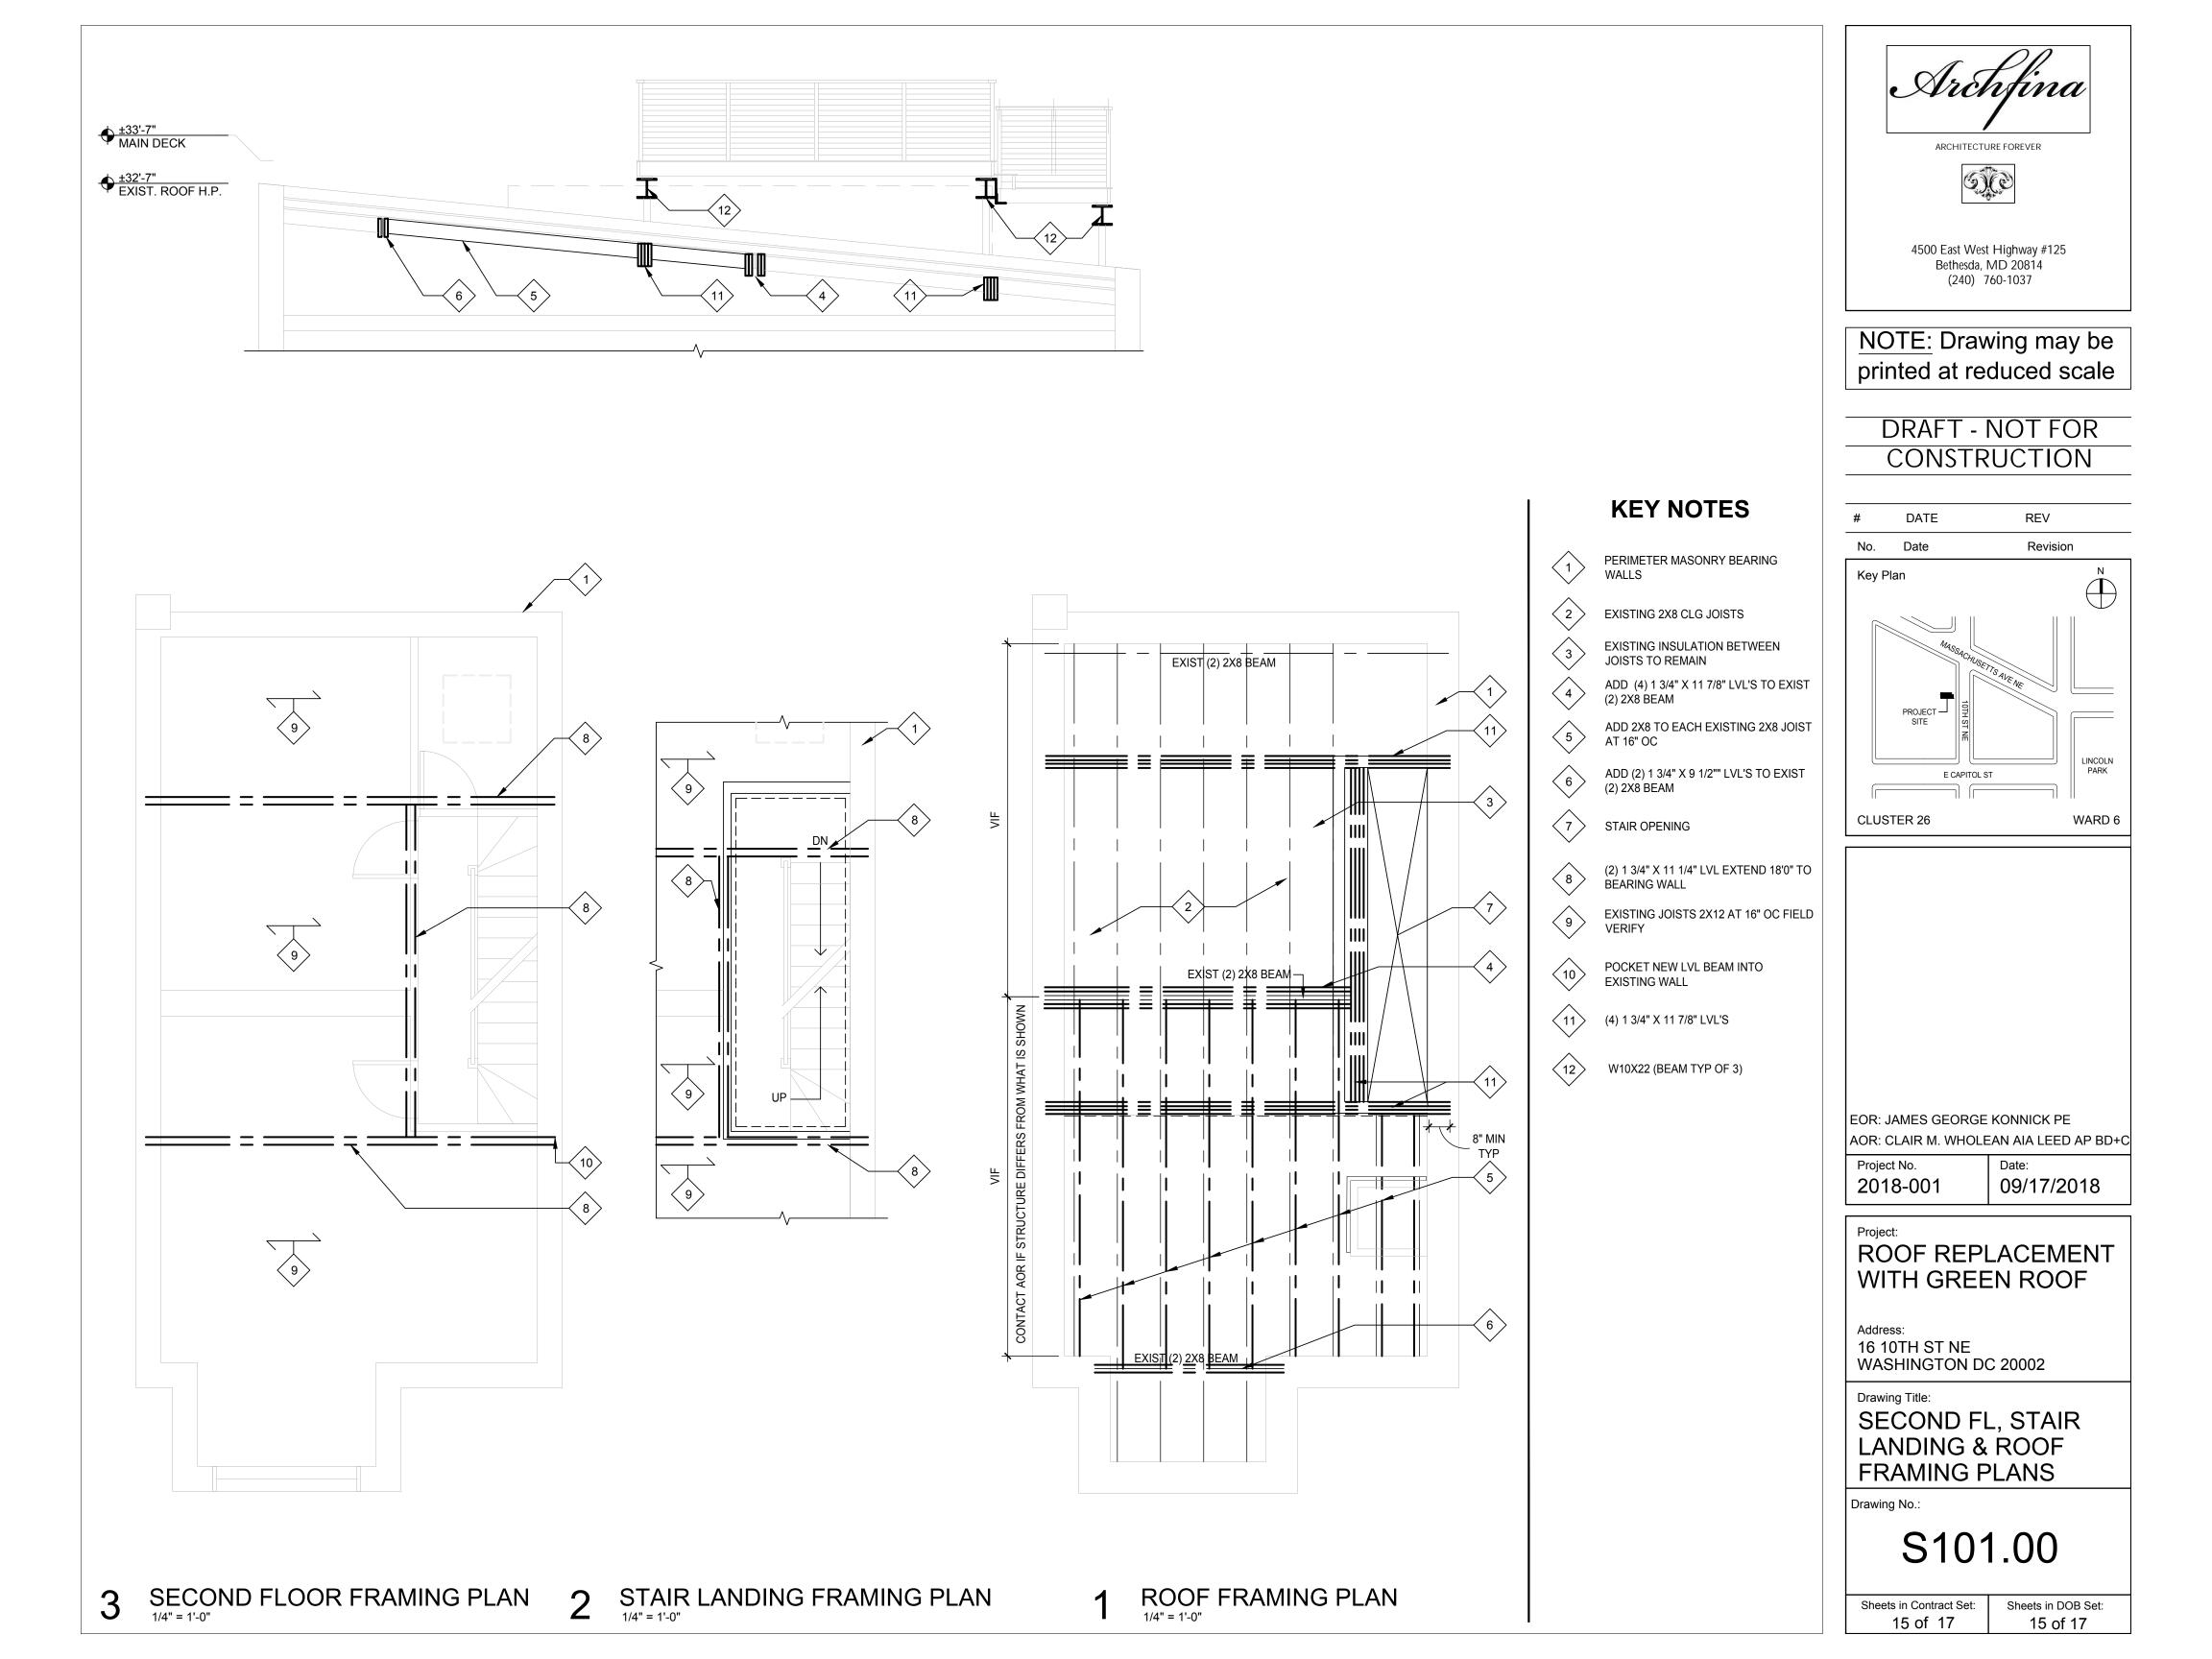

NOTES

- INSTALLATION.

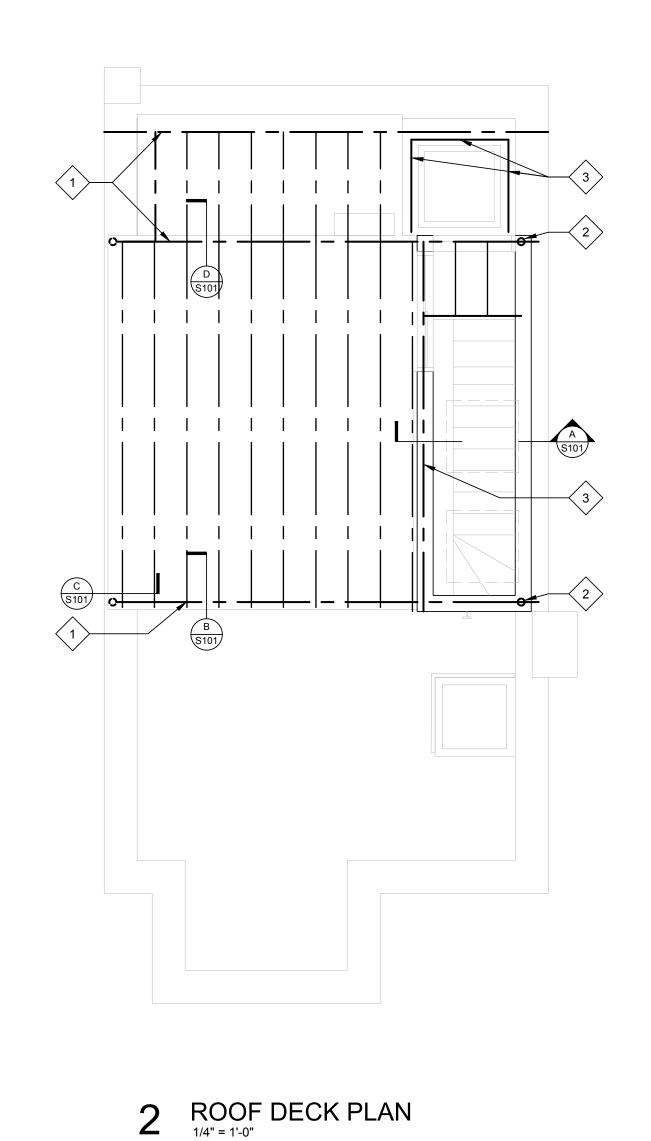

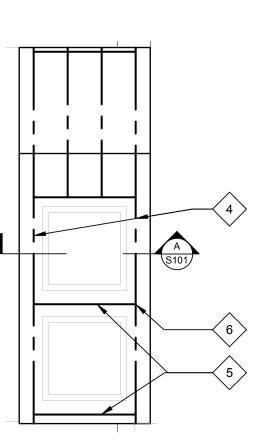



STRUCTURAL

1. PREPARE MASONRY TO RECEIVE ADDITIONAL STRUCTURE BY REMOVING A PORTION OF THE WALL AND INFILLING THE OPENING AFTER STRUCTURE INSTALLATION. SALVAGE BRICKS FOR REUSE. ENSURE THAT ALL STRUCTURE HAS A MINIMUM 8" BEARING ON EACH SIDE.

2. ENSURE LEVEL AND PLUMB INSTALLATION OF STRUCTURE USING A BED OF GROUT.

3. DRAWINGS ARE BASED ON ARCHITECTURAL OBSERVATION OF EXISTING CONDITIONS. CONTRACTOR TO TAKE FIELD MEASUREMENTS AND VERIFY DIMENSIONS PRIOR TO FABRICATION AND





2

W10X22 (BEAM TYP OF 3)

PIPE 3 STANDARD SCHEDULE 40 PIPE (3 1/2 " OD) TYP OF 6

 $\langle 3 \rangle$ (2) 2X12

2X8 @ 16 OC RAFTERS $\langle 4 \rangle$

5 (2) 2X8 BEAM

6 3 STUDS TYP EACH END OF BEAM

Archifina ARCHITECTURE FOREVER
4500 East West Highway #125 Bethesda, MD 20814 (240) 760-1037
<u>NOTE:</u> Drawing may be printed at reduced scale
DRAFT - NOT FOR CONSTRUCTION
DATE REV
No. Date Revision
Key Plan
EOR: JAMES GEORGE KONNICK PE AOR: CLAIR M. WHOLEAN AIA LEED AP BD+C Project No. 2018-001
ROOF REPLACEMENT WITH GREEN ROOF
Address: 16 10TH ST NE WASHINGTON DC 20002
ROOF DECK & ROOF FRAMING PLANS
Drawing No.: S102.00

Sheets in DOB Set:

16 of 17

Sheets in Contract Set:

16 of 17

