



GENERAL NOTES:
 -EXTERIOR WALLS: 2x6 @ 16"o.c. U.N.O.
 -INTERIOR WALLS: 2x4 @ 16"o.c. U.N.O.
 -ALL ALARMS SHALL BE INTERCONNECTED AS PER R314.4
 -A 1" WATER SERVICE AND CORRESPONDING WATER METER IS REQUIRED
 -NEW EGRESS WINDOWS MEET MIN CLEAR OPENING OF 24" HEIGHT, 20" WIDTH, AND 5.7SF TYP. PER R310.1
 -SAFETY GLASS TO BE INSTALLED AS PER IRC R308.4 (1-11)
 -AT TUB & SHOWER LOCATIONS WHERE WATER-RESISTANT GYP. BD. IS USED AND A VAPOR RETARDER IS REQ'D THE VAPOR RETARDER SHALL BE ON THE ROOM SIDE OF THE GYP. BD. (NOT BETWEEN THE GYP.BD. AND STUDS) TYP.
 -CARBON MONOXIDE ALARMS TO BE LOCATED OUTSIDE OF EACH SLEEPING AREA PER IRC R315
 -TYPE 2-A: 10-B: C RATED FIRE EXTINGUISHER TO BE LCATED IN THE KITCHEN PER IRC 329
 - A MINIMUM OF 50% OF LAMP BULBS IN PERMANENTLY INSTALLED NEW FIXTURES TO BE HIGH EFFICIENCY AND HOME TO HAVE AT LEAST ONE PROGRAMMABLE THERMOSTAT IN CONJUNCTION WITH ANY FORCED AIR HEATING SYSTEM PER N1103 AND N1104


STAIR, HANDRAIL AND GUARD GENERAL NOTES:
 - Stairways are no less than 36" in clear width at all points above the permitted handrail height and below the required headroom height per R311.7.1
 - Minimum headroom in all parts of stairway is no less than 6'8" per R311.7.2
 - Risers are no more than 7.75" in height per R311.7.5.1
 - Treads are no less than 10" in depth per R311.7.5.2
 - Stair nosing radius is no greater than 9/16"; solid risers to be used for any nosing less than 3/4" and greater than 1 1/4" per R311.7.5.3
 - All landings are no less than 36" in the direction of travel or less than the width of the stairway served per R311.7.6
 - Handrails are no less than 34" and no more than 38" from finished surface per R311.7.8.1
 - Grip size of handrails to meet Type I constraints per R311.7.8.3
 - Guards at open-sided walking surfaces are no less than 36" high per R312.1.1
 - Guard openings to not allow passage of a sphere 4" in diameter per R312.1.3

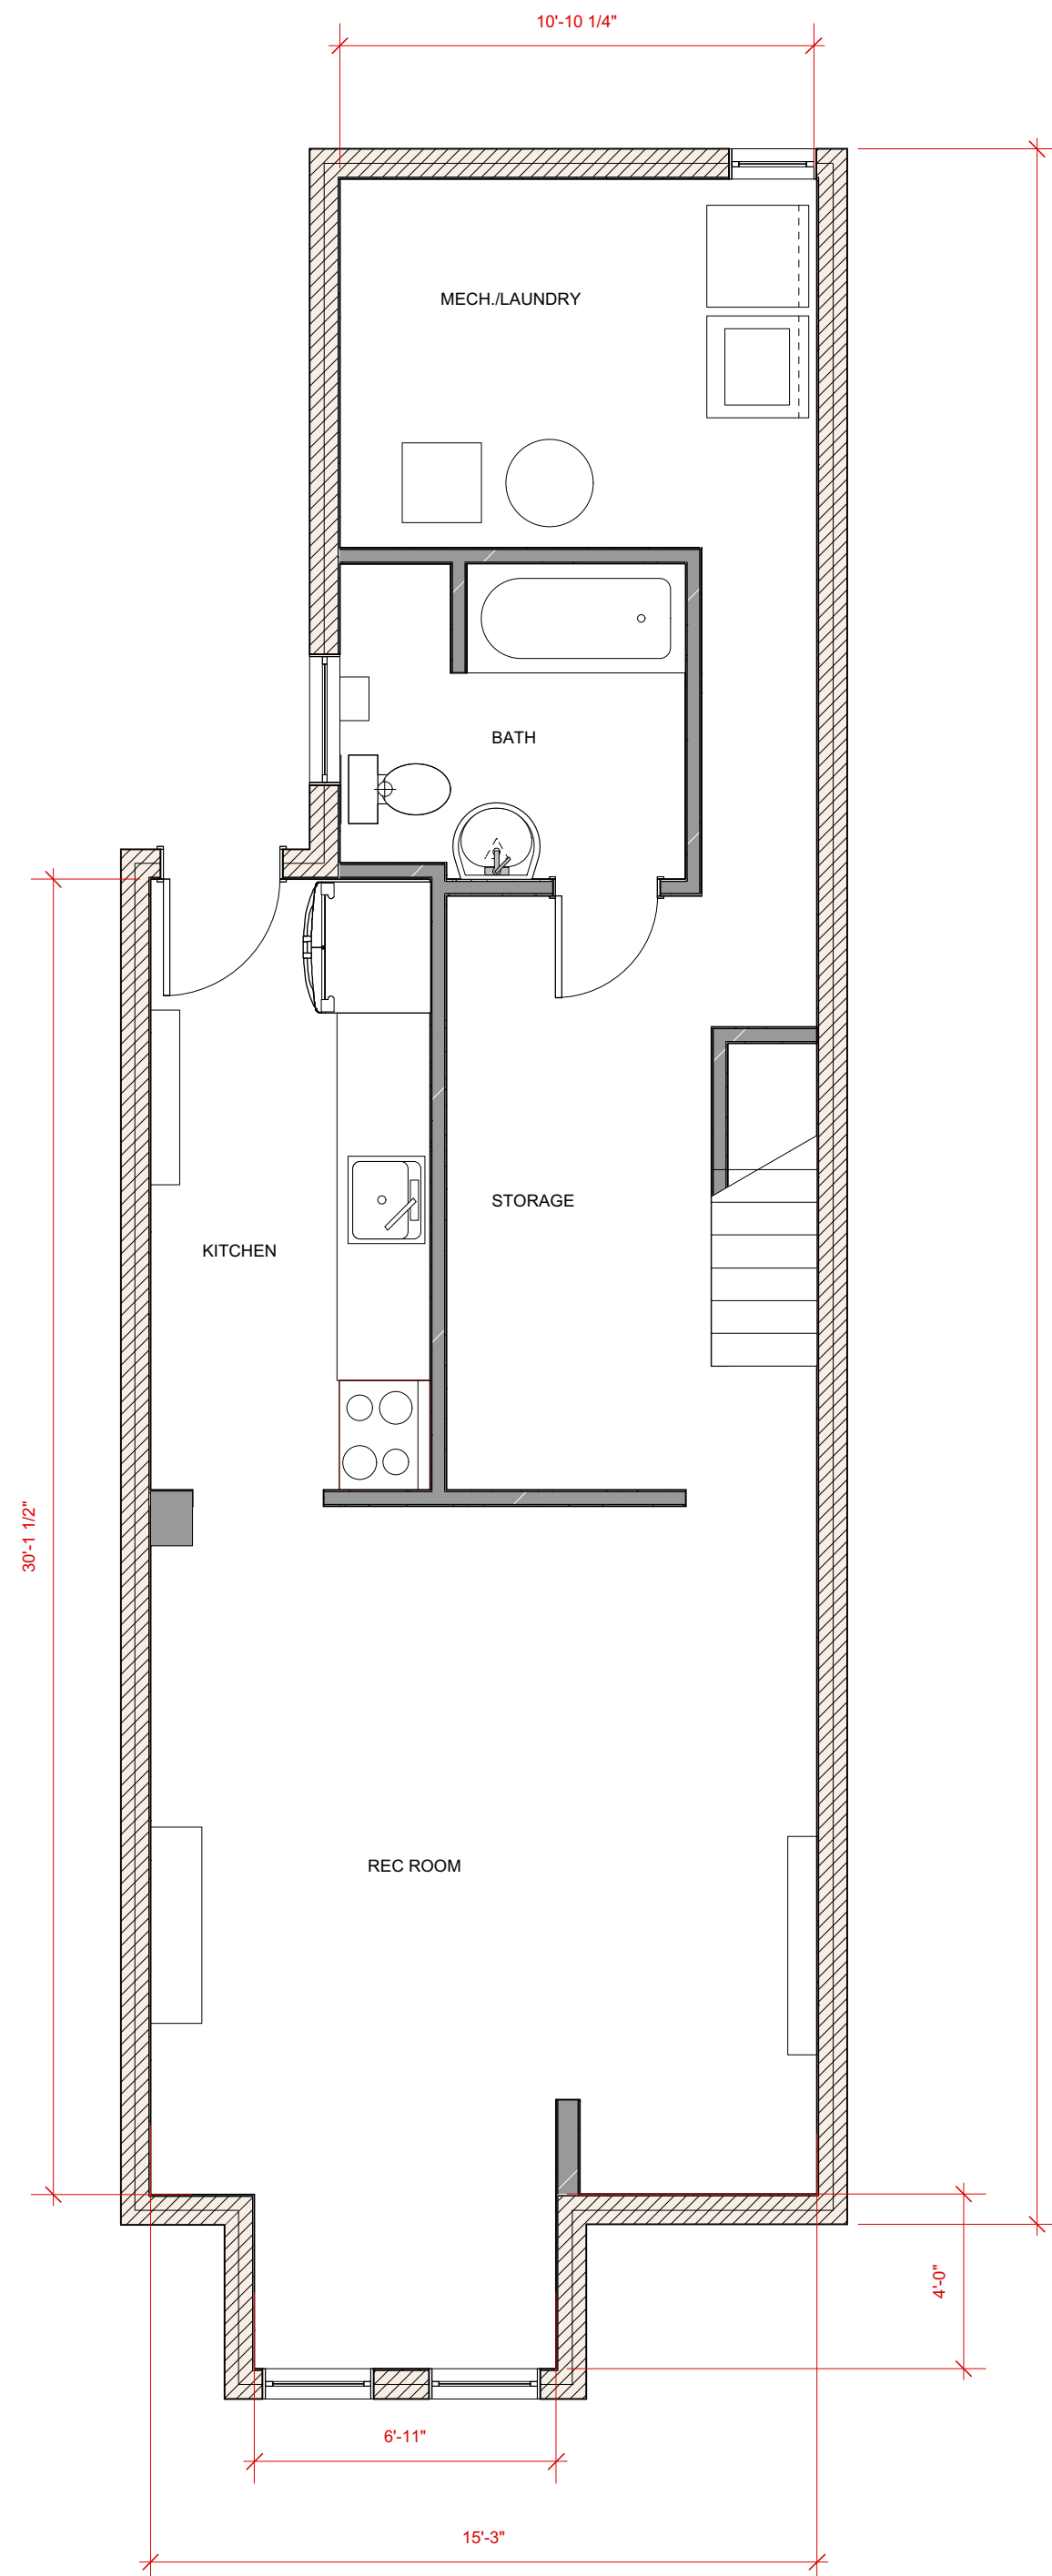

Basement - EXISTING/DEMO
 Scale: 1/4" = 1'-0"

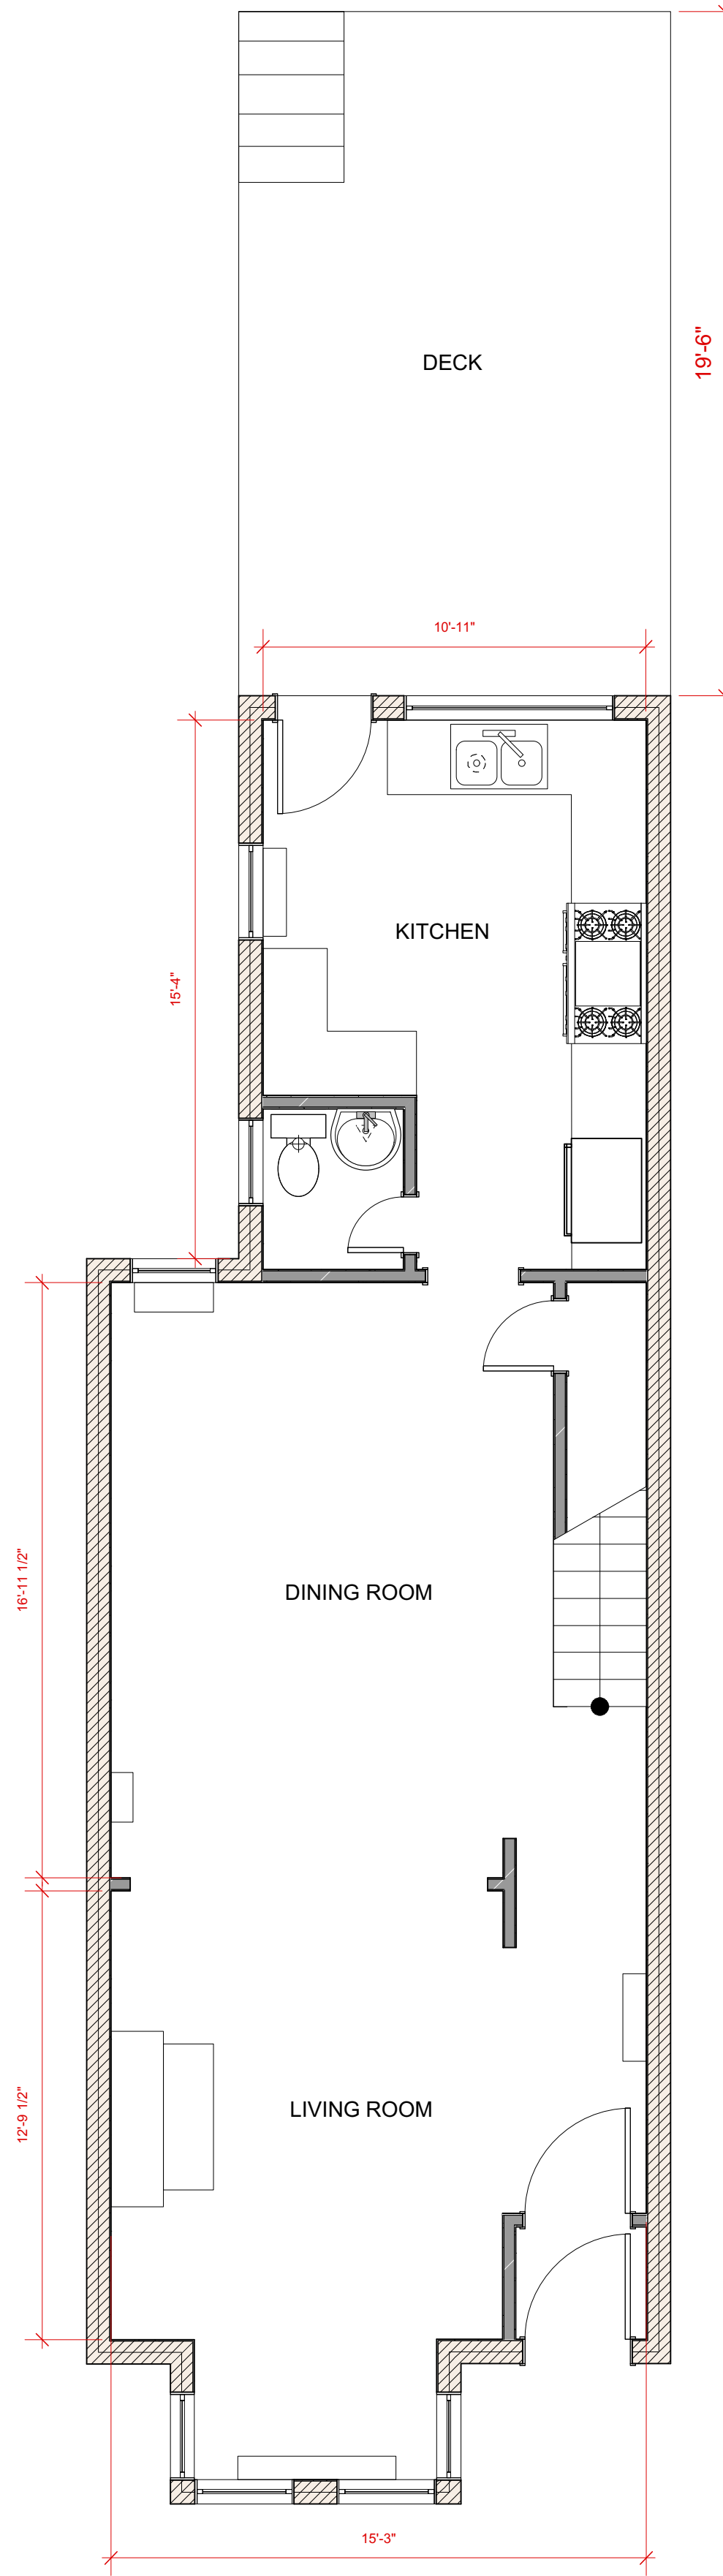


First Floor - EXISTING/DEMO
 Scale: 1/4" = 1'-0"

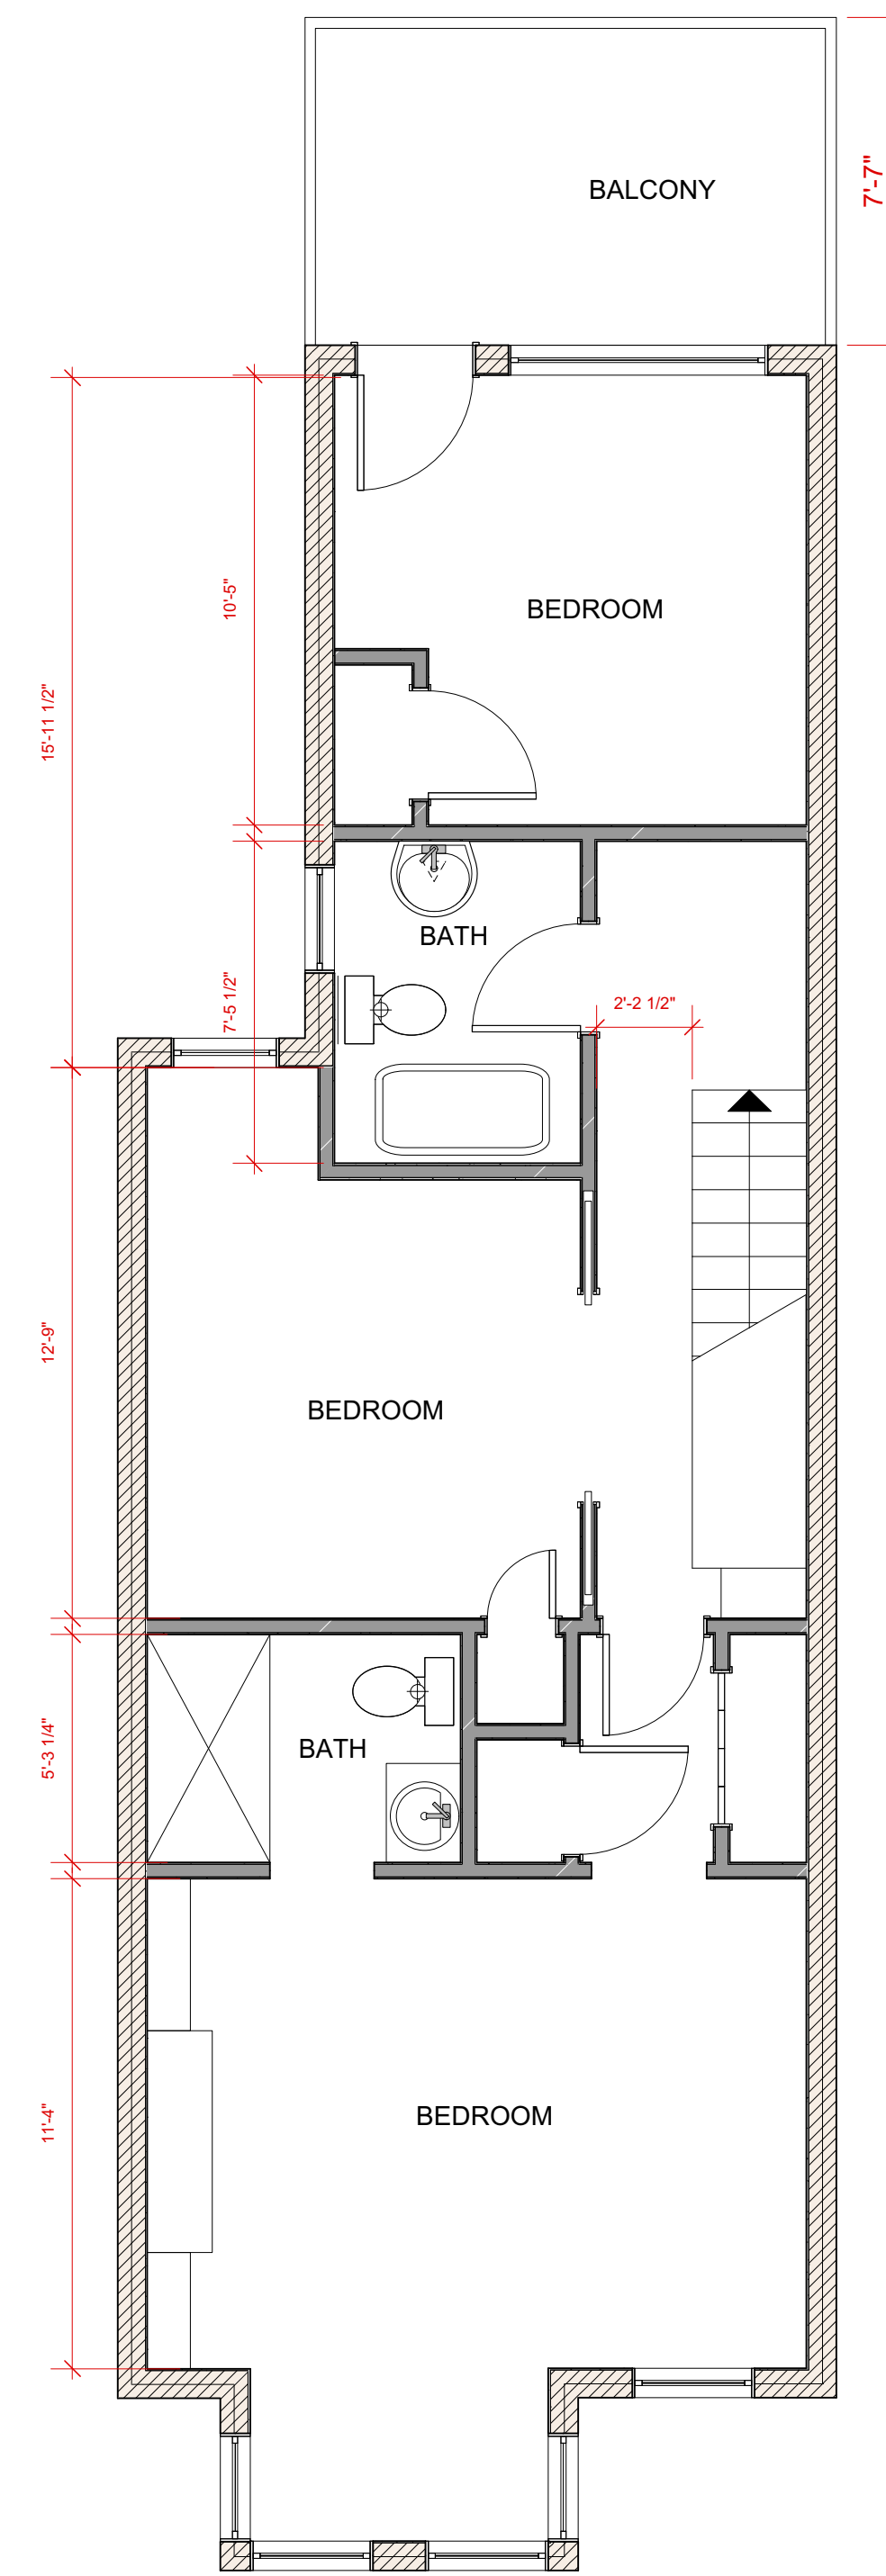

Second Floor - EXISTING
 Scale: 1/4" = 1'-0"

jobi jones llc

3801 GEORGIA AVE NW #305
 WASHINGTON, DC 20011

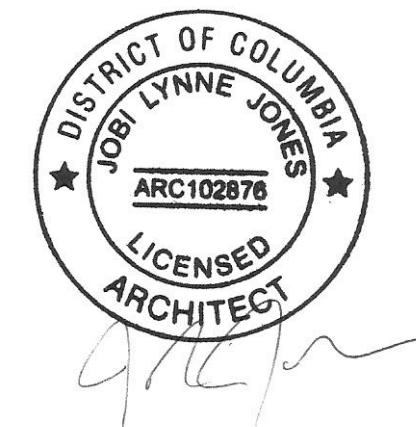


Project Name
 Miller Renovation

Client Name and Address
 135 Kentucky Ave SE
 Washington, DC 20003
DC2003 of Zoning Adjustment
 District of Columbia
 CASE NO 20713


Sheet Number A100 Sheet Title EXISTING

GENERAL NOTES:
 -EXTERIOR WALLS: 2x6 @ 16"o.c. U.N.O.
 -INTERIOR WALLS: 2x4 @ 16"o.c. U.N.O.
 -ALL ALARMS SHALL BE INTERCONNECTED AS PER R314.4
 -A 1" WATER SERVICE AND CORRESPONDING WATER METER IS REQUIRED
 -NEW EGRESS WINDOWS MEET MIN CLEAR OPENING OF 24" HEIGHT, 20" WIDTH, AND 5.7SF TYP. PER R310.1
 -SAFETY GLASS TO BE INSTALLED AS PER IRC R308.4 (1-11)
 -AT TUB & SHOWER LOCATIONS WHERE WATER-RESISTANT GYP. BD. IS USED AND A VAPOR RETARDER IS REQ'D THE VAPOR RETARDER SHALL BE ON THE ROOM SIDE OF THE GYP. BD. (NOT BETWEEN THE GYP. BD. AND STUDS) TYP.
 -CARBON MONOXIDE ALARMS TO BE LOCATED OUTSIDE OF EACH SLEEPING AREA PER IRC R315
 -TYPE 2-A: 10-B: C RATED FIRE EXTINGUISHER TO BE LOCATED IN THE KITCHEN PER IRC 329
 -A MINIMUM OF 50% OF LAMP BULBS IN PERMANENTLY INSTALLED NEW FIXTURES TO BE HIGH EFFICIENCY AND HOME TO HAVE AT LEAST ONE PROGRAMMABLE THERMOSTAT IN CONJUNCTION WITH ANY FORCED AIR HEATING SYSTEM PER N1103 AND N1104


STAIR, HANDRAIL AND GUARD GENERAL NOTES:
 - Stairways are no less than 36" in clear width at all points above the permitted handrail height and below the required headroom height per R311.7.1
 - Minimum headroom in all parts of stairway is no less than 6'8" per R311.7.2
 - Risers are no more than 7.75" in height per R311.7.5.1
 - Treads are no less than 10" in depth per R311.7.5.2
 - Stair nosing radius is no greater than 9/16"; solid risers to be used for any nosing less than 3/4" and greater than 1 1/4" per R311.7.5.3
 - All landings are no less than 36" in the direction of travel or less than the width of the stairway served per R311.7.6
 - Handrails are no less than 34" and no more than 38" from finished surface per R311.7.8.1
 - Grip size of handrails to meet Type I constraints per R311.7.8.3
 - Guards at open-sided walking surfaces are no less than 36" high per R312.1.1
 - Guard openings to not allow passage of a sphere 4" in diameter per R312.1.3

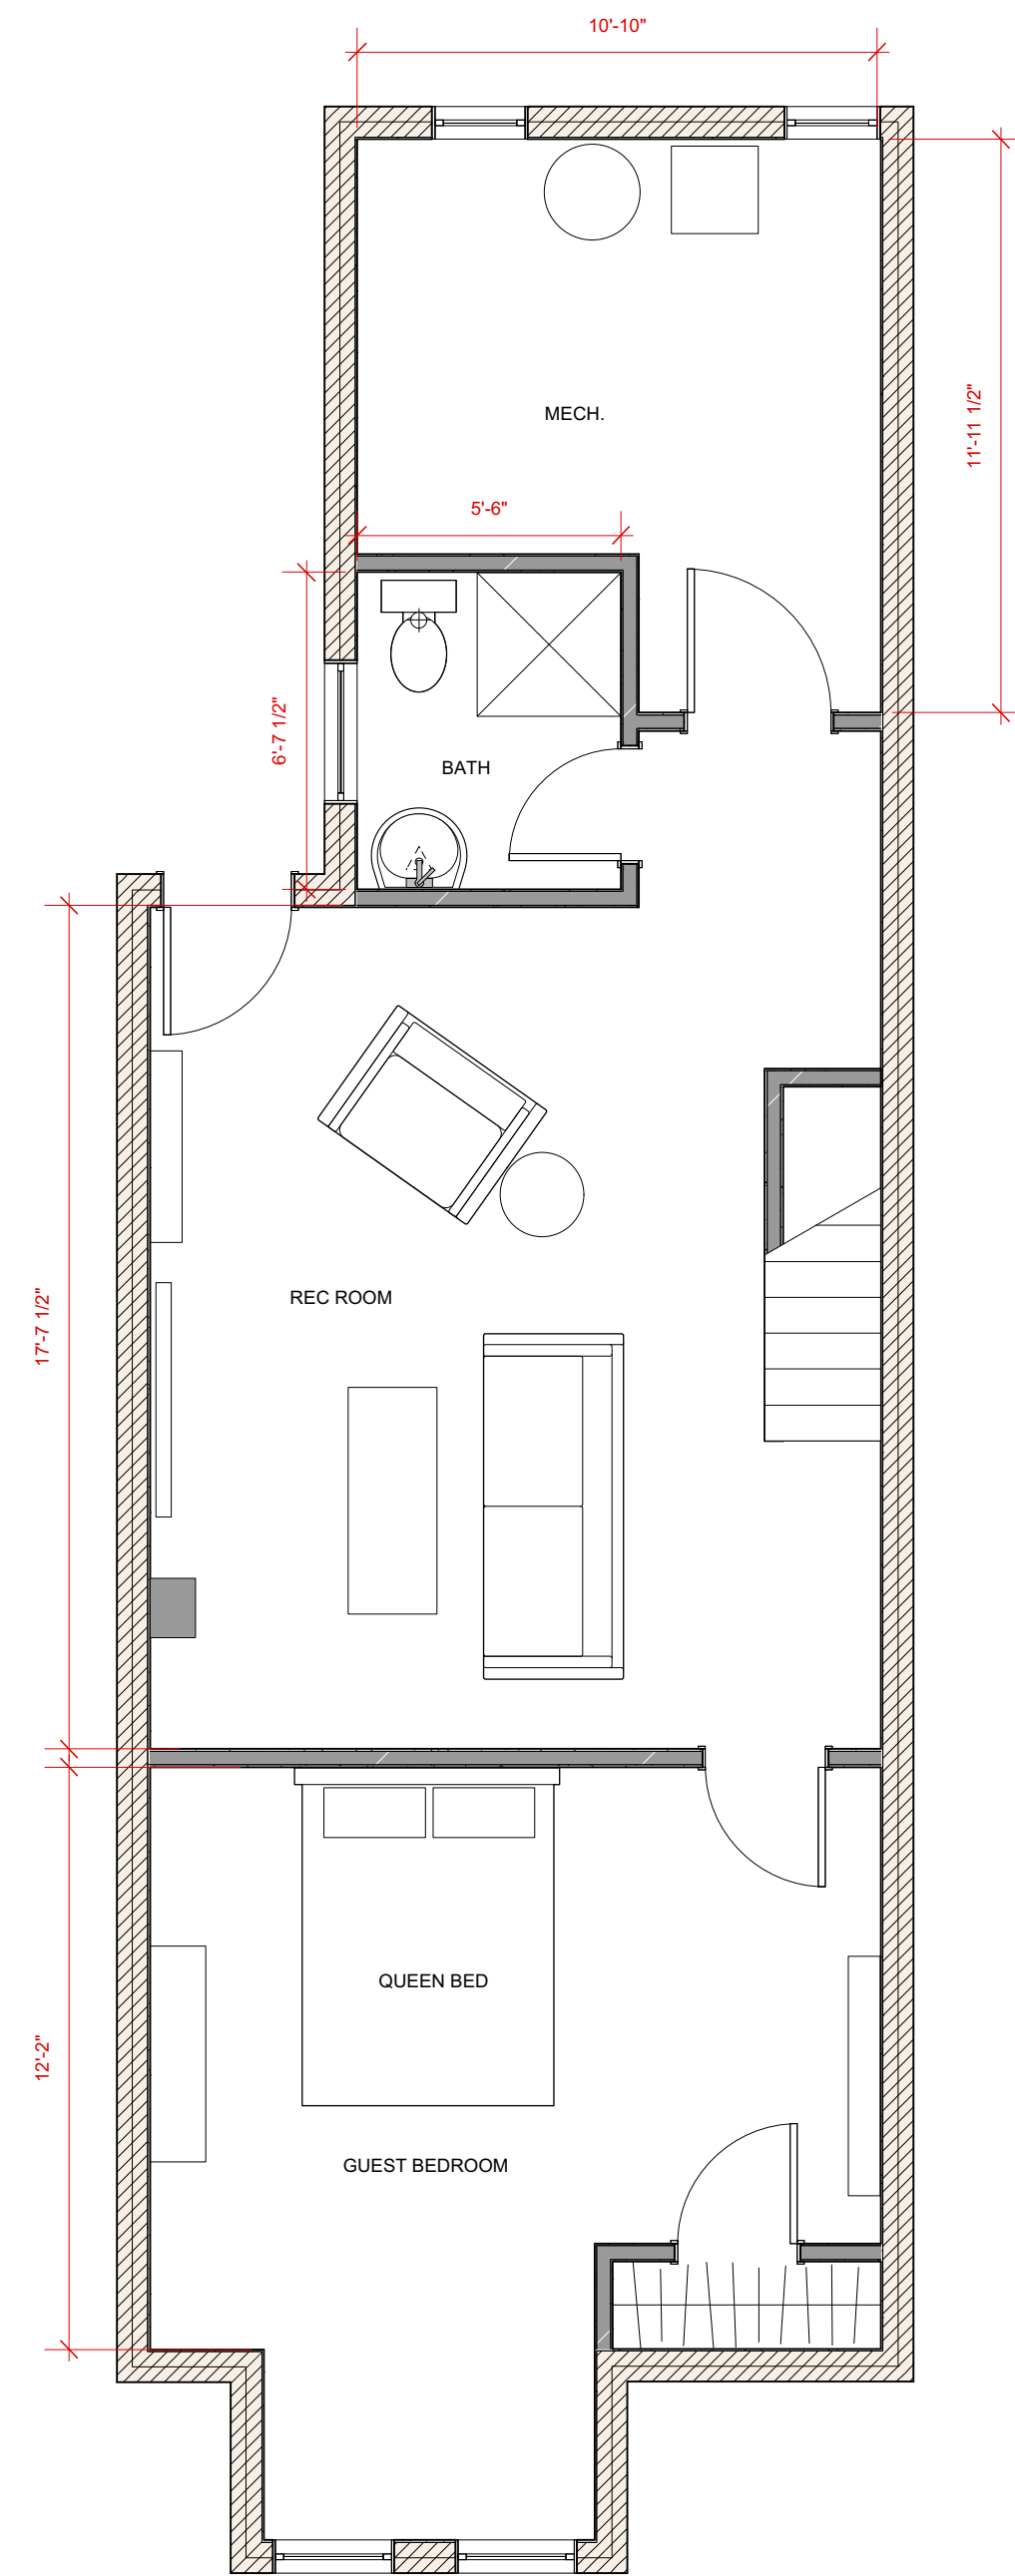

Basement - PROPOSED - NO ADDITION
 Scale: 1/4" = 1'-0"

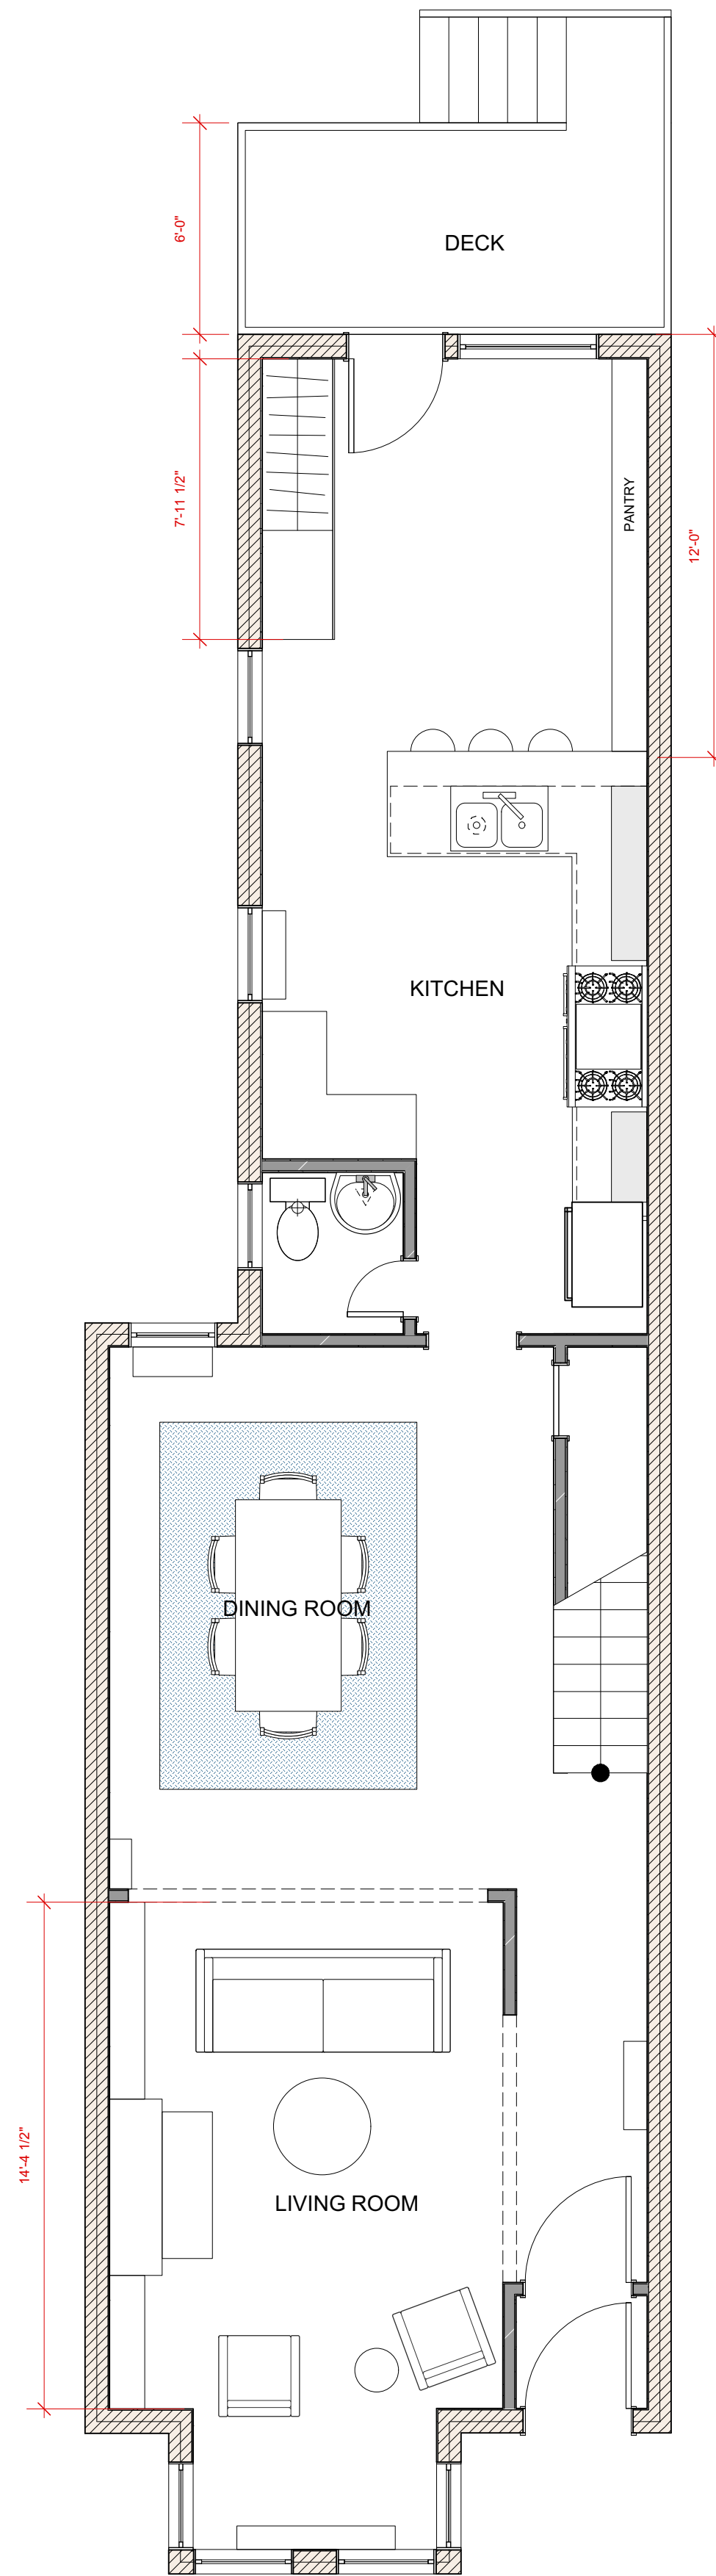


First Floor - PROPOSED
 Scale: 1/4" = 1'-0"

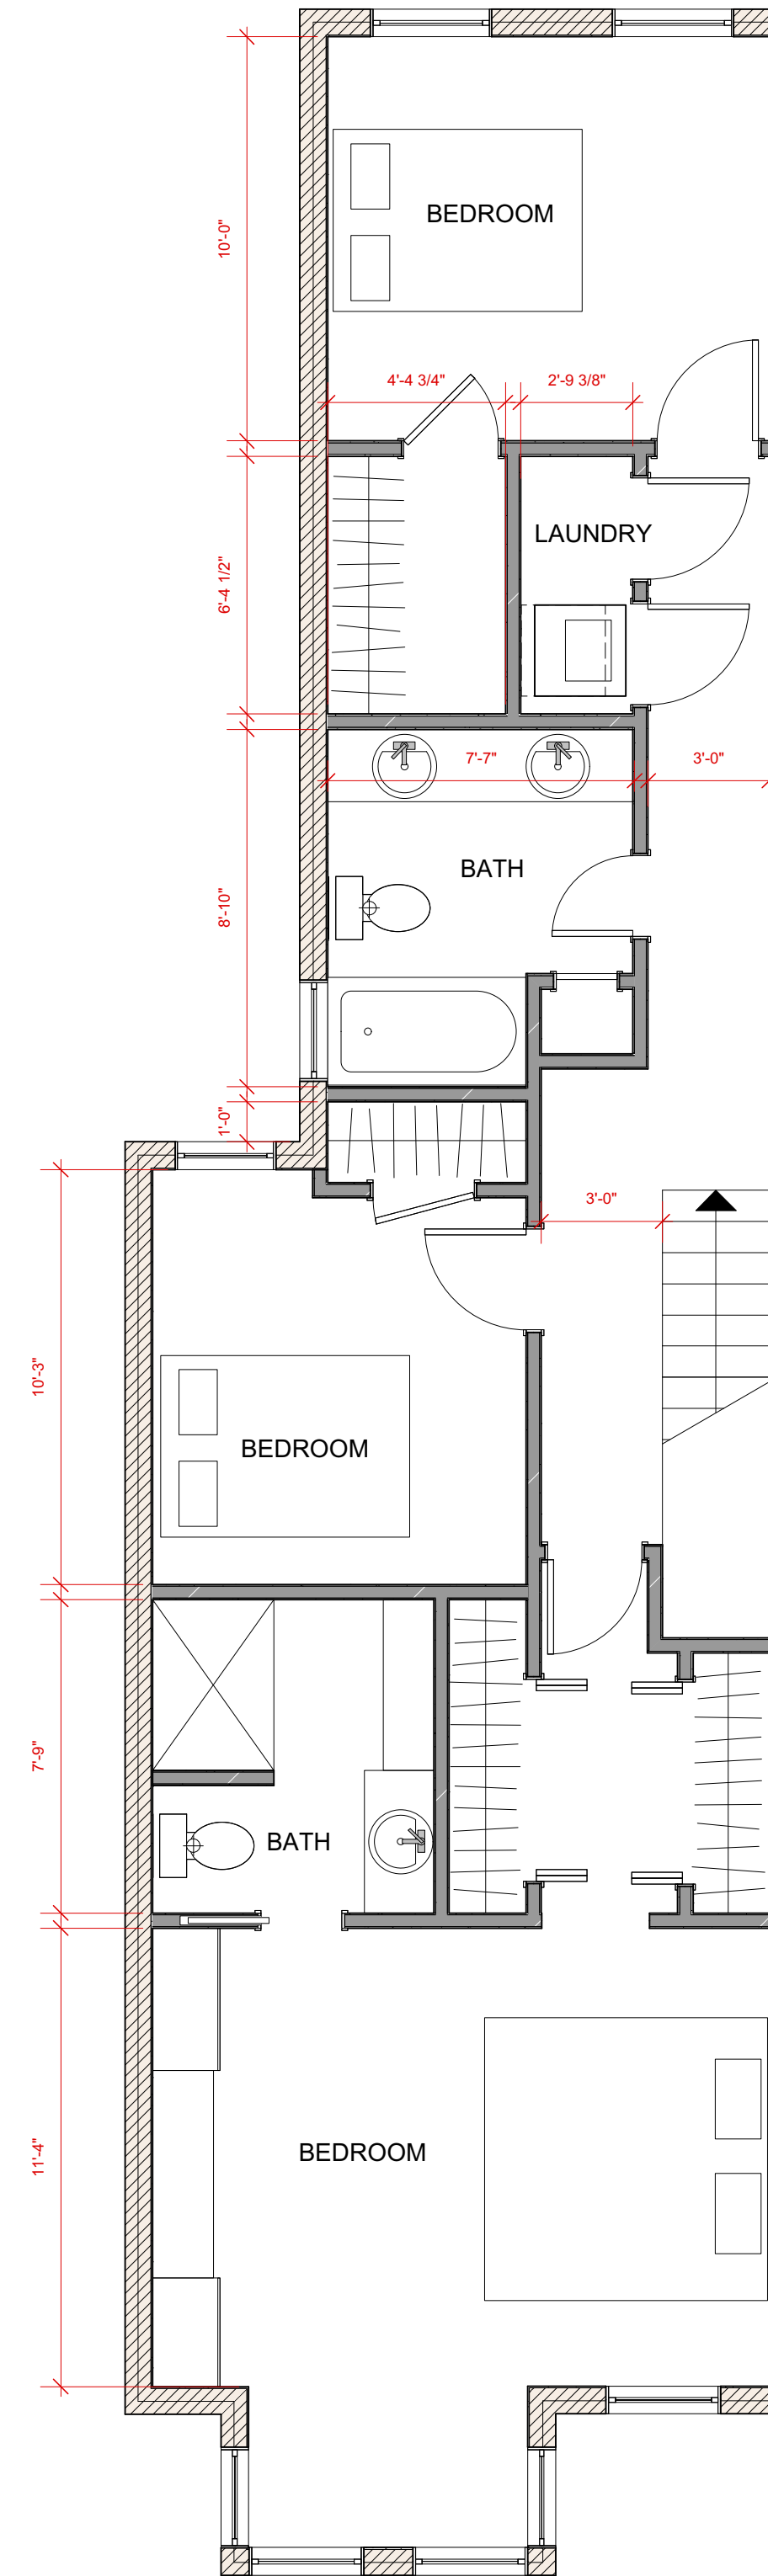

Second Floor - PROPOSED
 Scale: 1/4" = 1'-0"

jobi jones llc

3801 GEORGIA AVE NW #305
 WASHINGTON, DC 20011

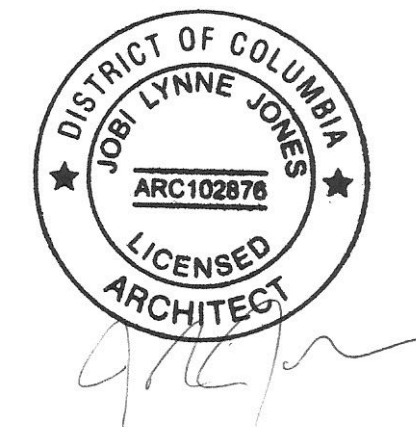


Project Name
 Miller Renovation

Client Name and Address
 135 Kentucky Ave SE
 Washington, DC 20003


Sheet Number A101 Sheet Title PROPOSED

GENERAL NOTES:
 -EXTERIOR WALLS: 2x6 @ 16"o.c. U.N.O.
 -INTERIOR WALLS: 2x4 @ 16"o.c. U.N.O.
 -ALL ALARMS SHALL BE INTERCONNECTED AS PER R314.4
 -A 1" WATER SERVICE AND CORRESPONDING WATER METER IS REQUIRED
 -NEW EGRESS WINDOWS MEET MIN CLEAR OPENING OF 24" HEIGHT, 20" WIDTH, AND 5.7SF TYP. PER R310.1
 -SAFETY GLASS TO BE INSTALLED AS PER IRC R308.4 (1-11)
 -AT TUB & SHOWER LOCATIONS WHERE WATER-RESISTANT GYP. BD. IS USED AND A VAPOR RETARDER IS REQ'D THE VAPOR RETARDER SHALL BE ON THE ROOM SIDE OF THE GYP. BD. (NOT BETWEEN THE GYP. BD. AND STUDS) TYP.
 -CARBON MONOXIDE ALARMS TO BE LOCATED OUTSIDE OF EACH SLEEPING AREA PER IRC R315
 -TYPE 2-A: 10-B: C RATED FIRE EXTINGUISHER TO BE LCATED IN THE KITCHEN PER IRC 329
 - A MINIMUM OF 50% OF LAMP BULBS IN PERMANENTLY INSTALLED NEW FIXTURES TO BE HIGH EFFICIENCY AND HOME TO HAVE AT LEAST ONE PROGRAMMABLE THERMOSTAT IN CONJUNCTION WITH ANY FORCED AIR HEATING SYSTEM PER N1103 AND N1104


STAIR, HANDRAIL AND GUARD GENERAL NOTES:
 - Stairways are no less than 36" in clear width at all points above the permitted handrail height and below the required headroom height per R311.7.1
 - Minimum headroom in all parts of stairway is no less than 6'8" per R311.7.2
 - Risers are no more than 7.75" in height per R311.7.5.1
 - Treads are no less than 10" in depth per R311.7.5.2
 - Stair nosing radius is no greater than 9/16"; solid risers to be used for any nosing less than 3/4" and greater than 1 1/4" per R311.7.5.3
 - All landings are no less than 36" in the direction of travel or less than the width of the stairway served per R311.7.6
 - Handrails are no less than 34" and no more than 38" from finished surface per R311.7.8.1
 - Grip size of handrails to meet Type I constraints per R311.7.8.3
 - Guards at open-sided walking surfaces are no less than 36" high per R312.1.1
 - Guard openings to not allow passage of a sphere 4" in diameter per R312.1.3

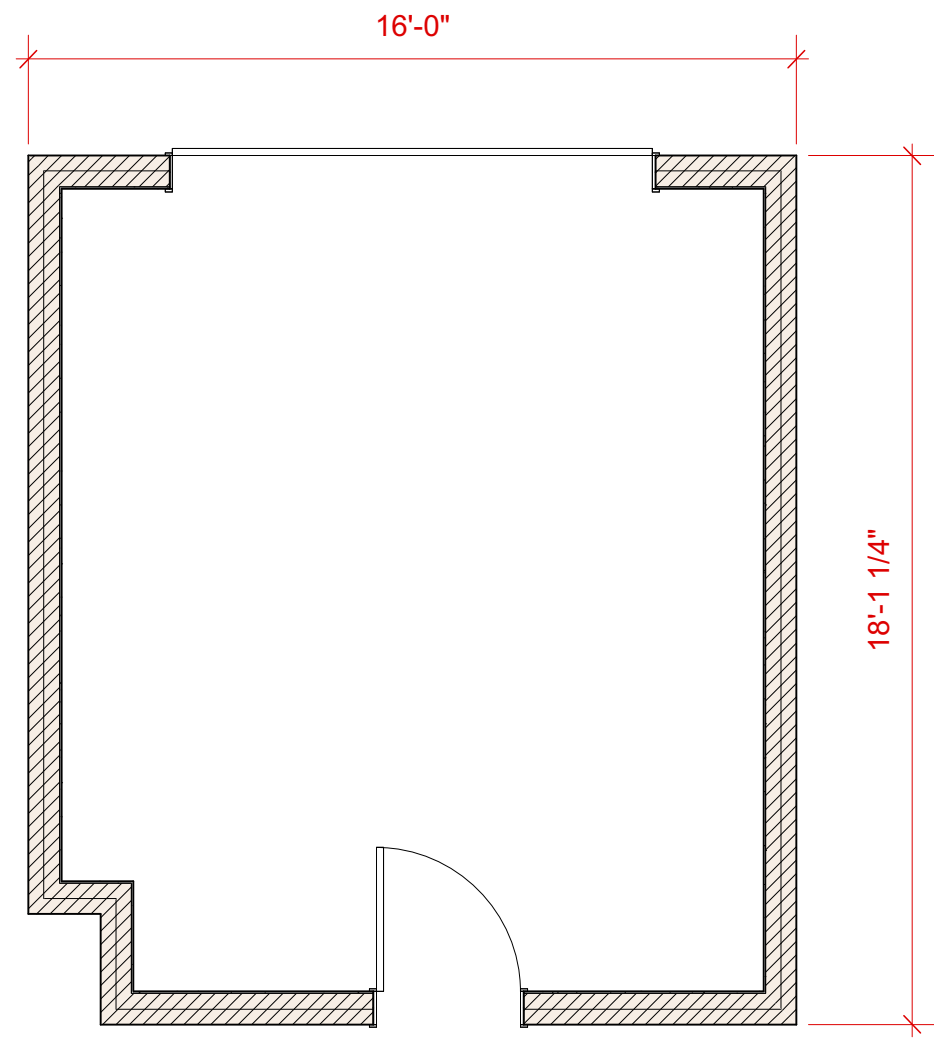

Garage Existing
 Scale: 1/4" = 1'-0"

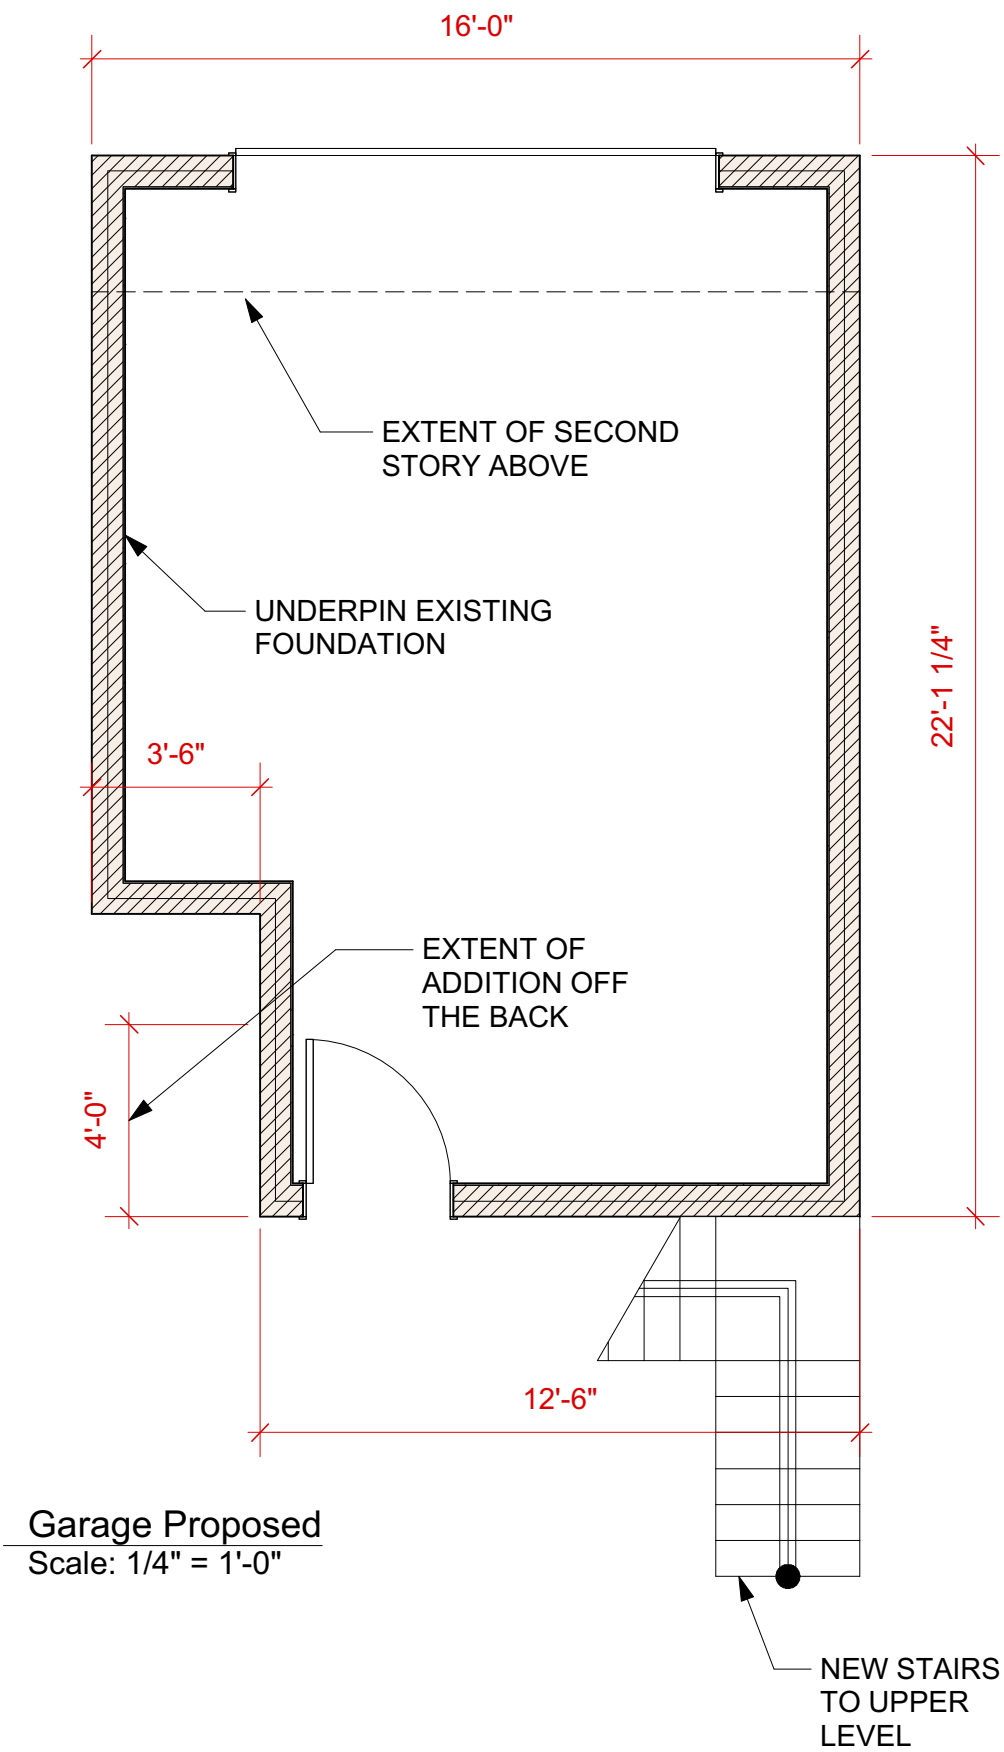

Garage Proposed
 Scale: 1/4" = 1'-0"

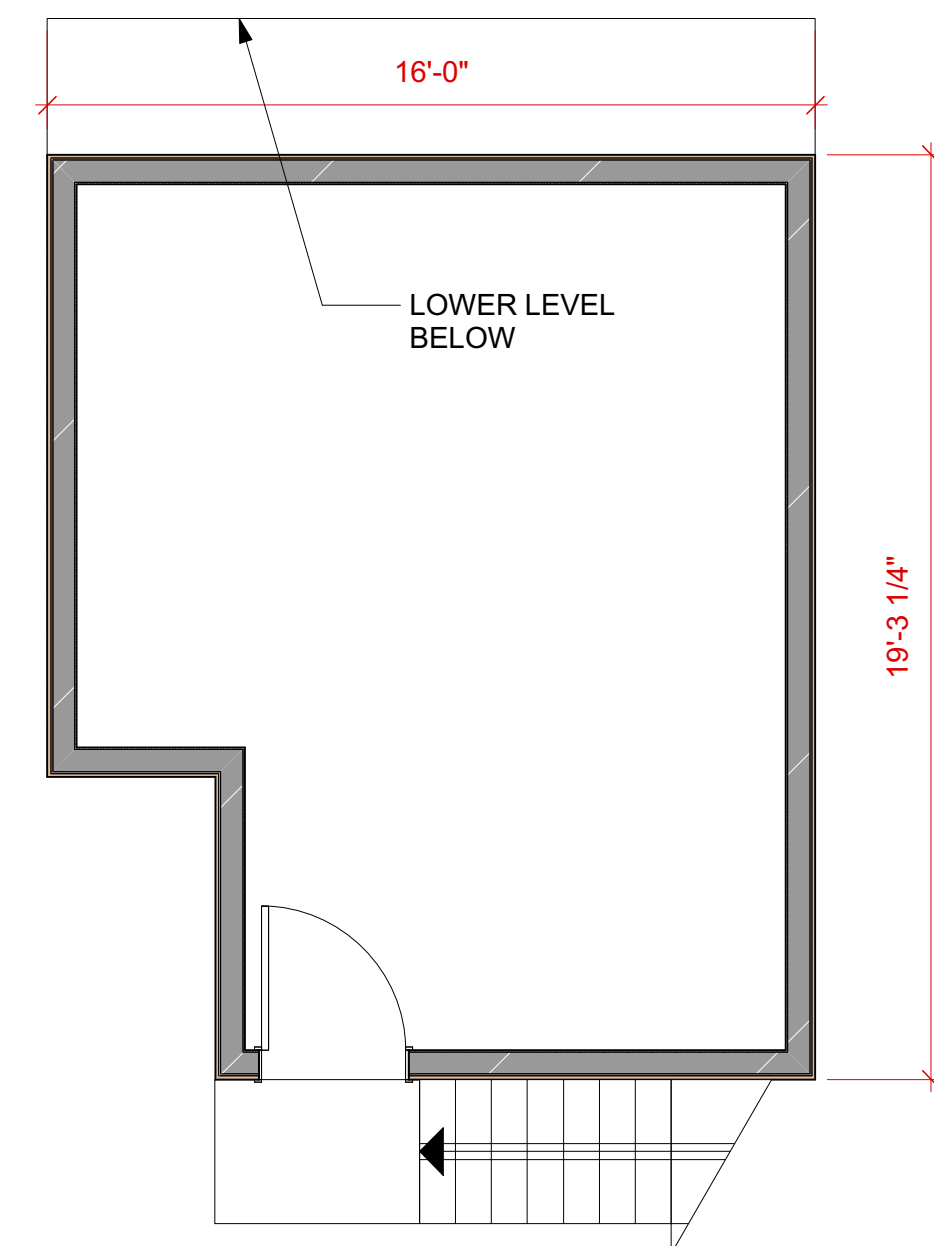


Garage Proposed - 2ND FLOOR
 Scale: 1/4" = 1'-0"

jobi jones llc


3801 GEORGIA AVE NW #305
 WASHINGTON, DC 20011




Project Name	Miller Renovation	
Client Name and Address	135 Kentucky Ave SE Washington, DC 20003	
Sheet Number	A102	Sheet Title GARAGE

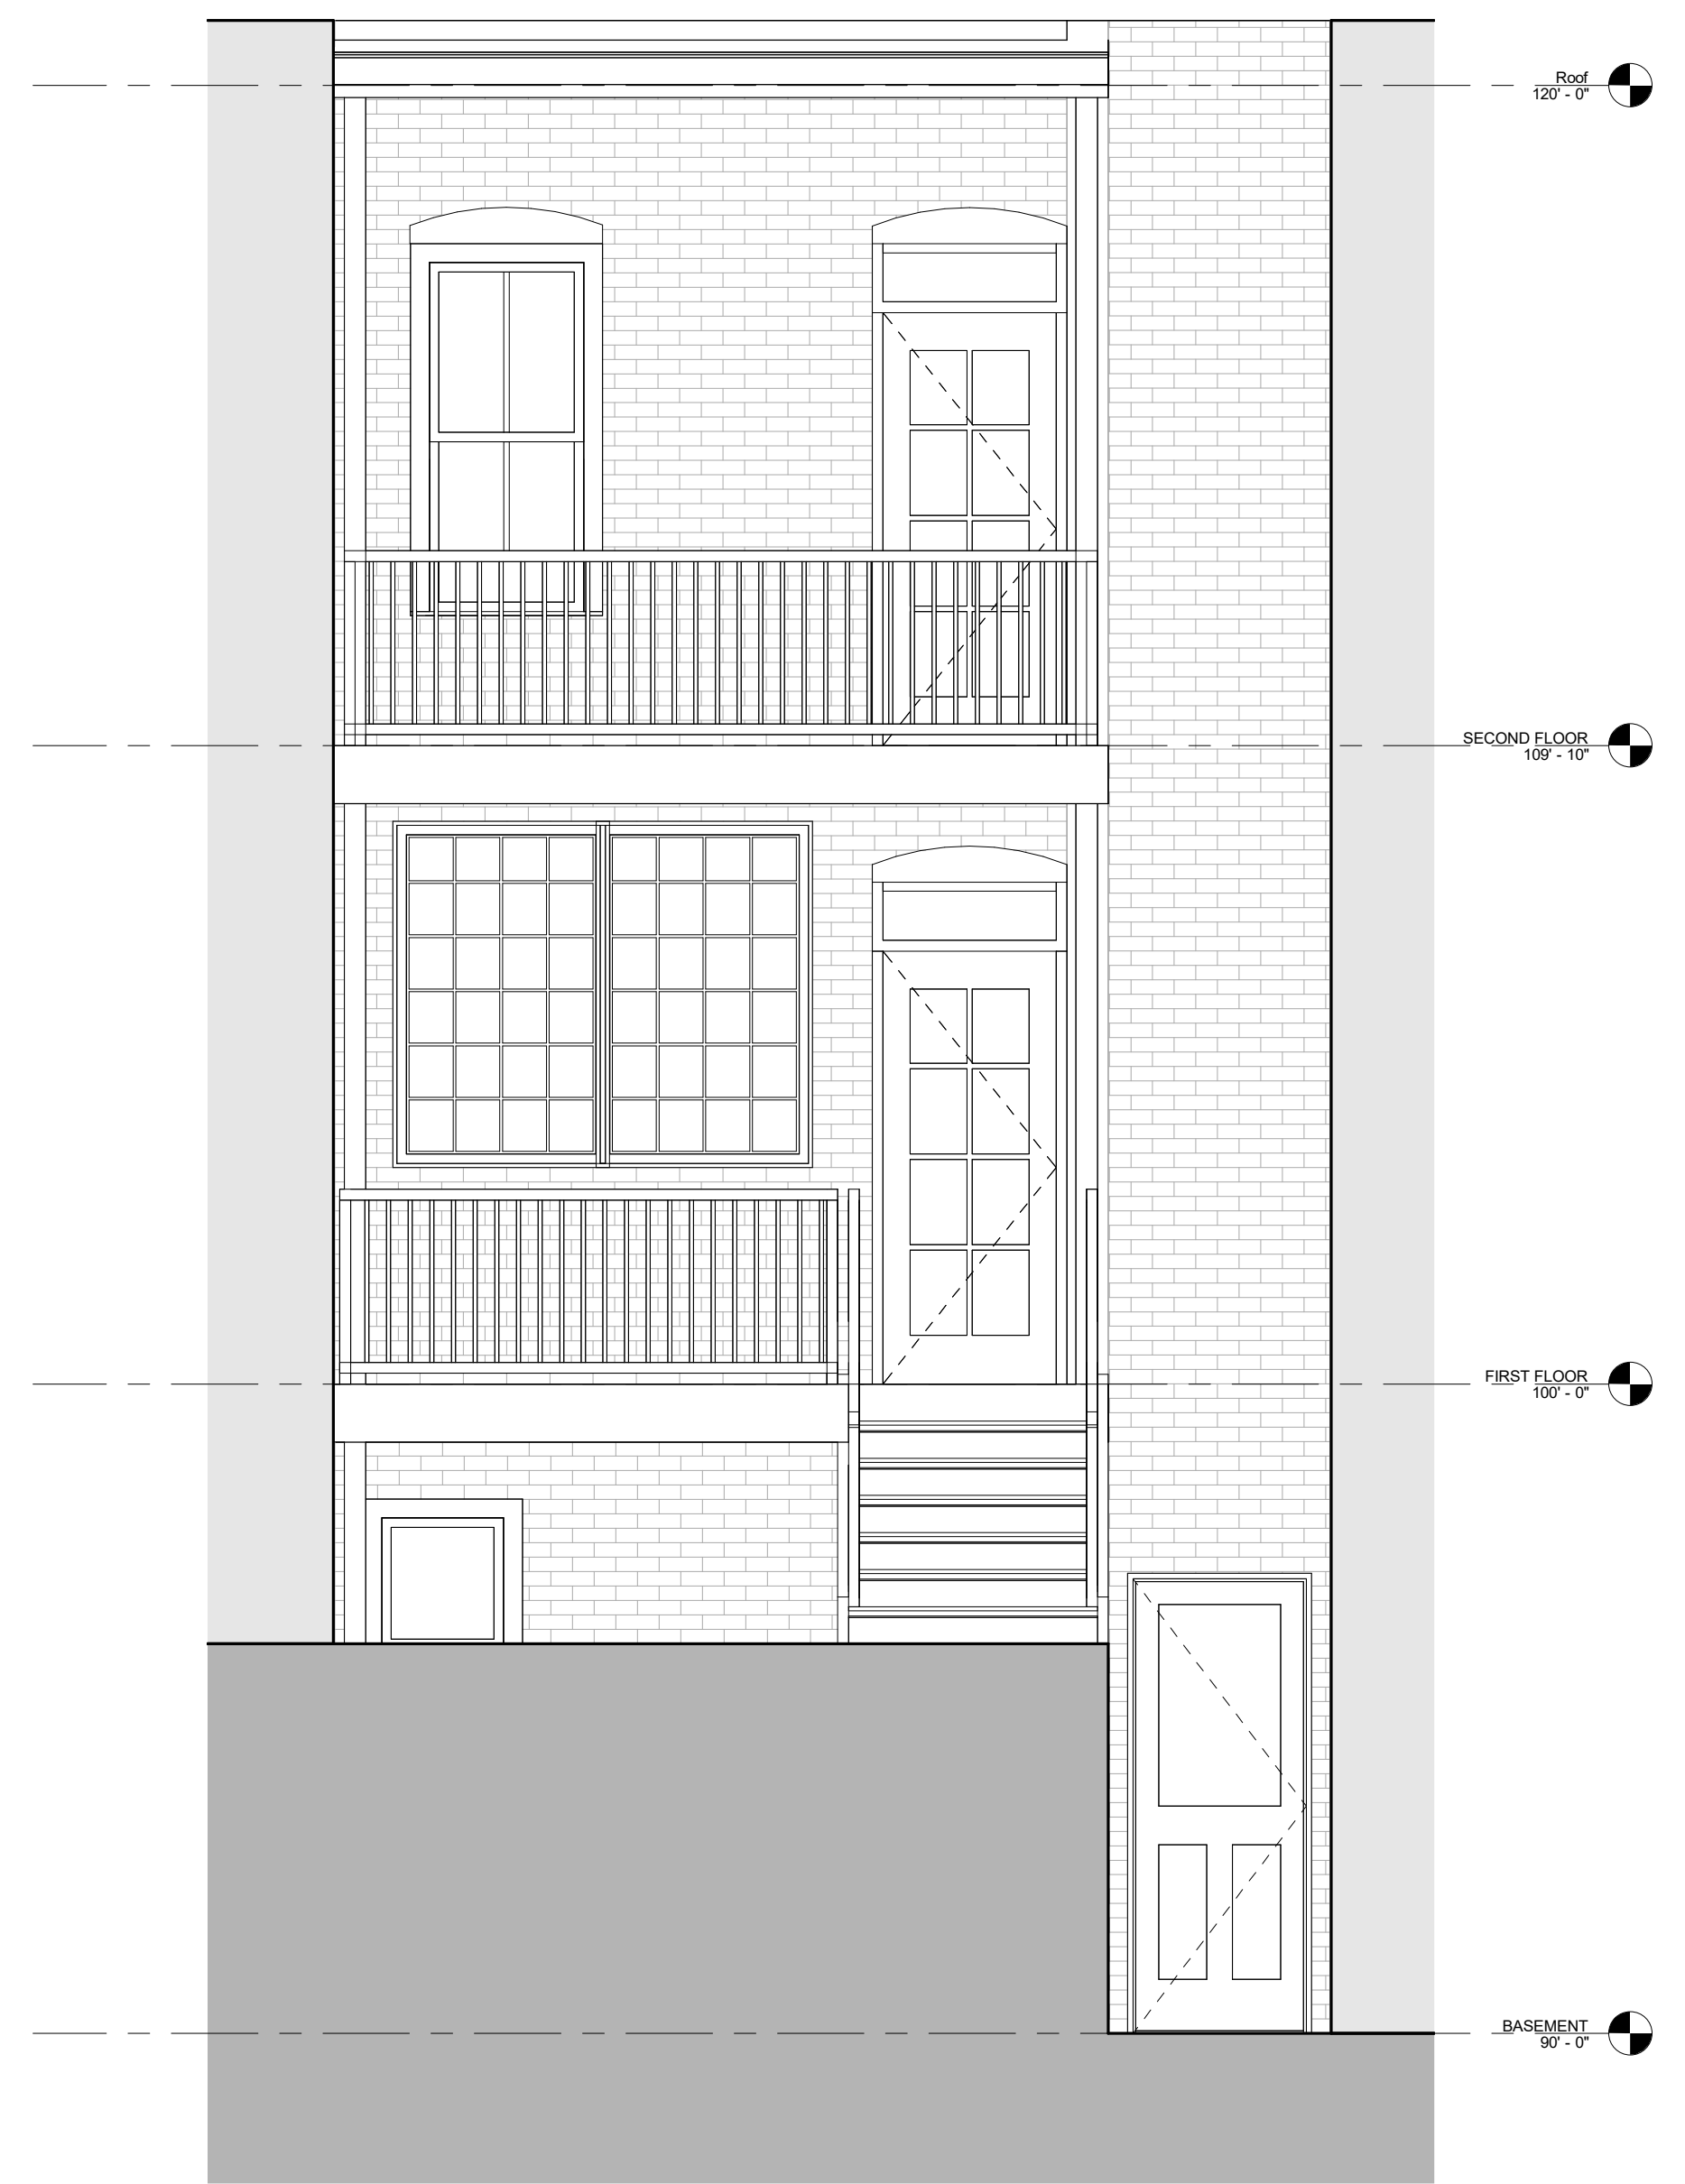


1 EXISTING - REAR
3/8" = 1'-0"

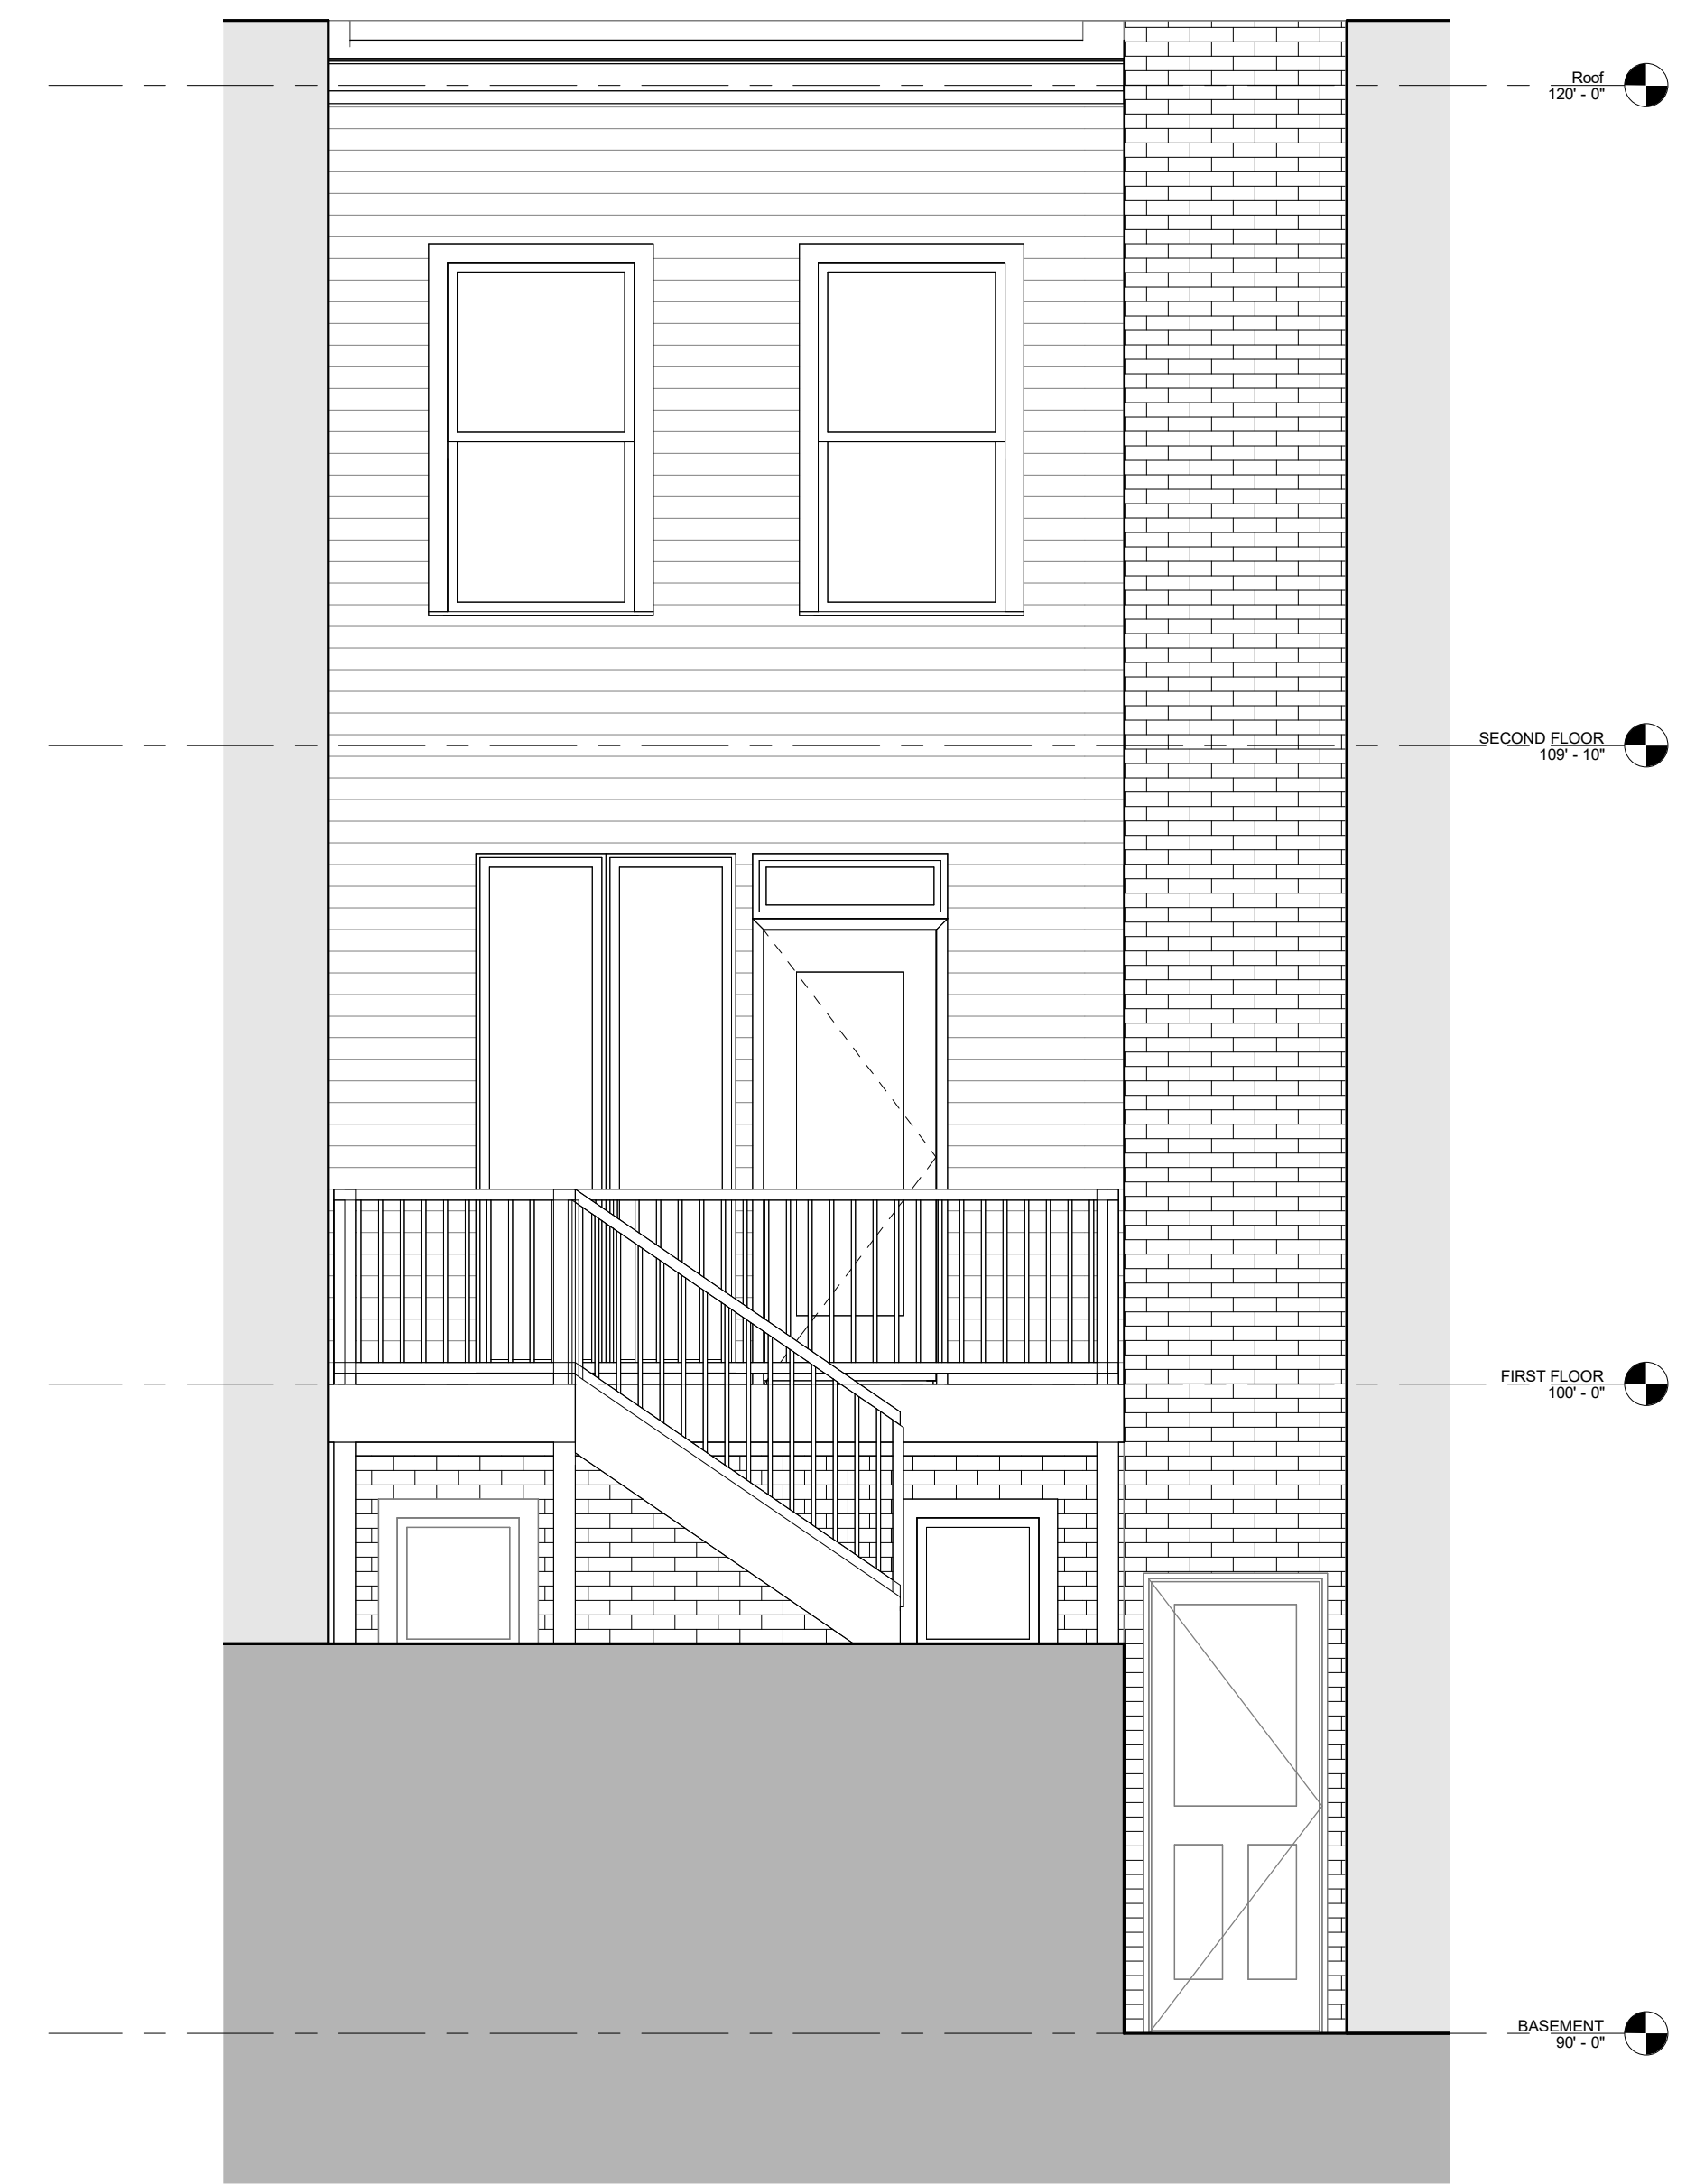

2 PROPOSED - REAR
3/8" = 1'-0"

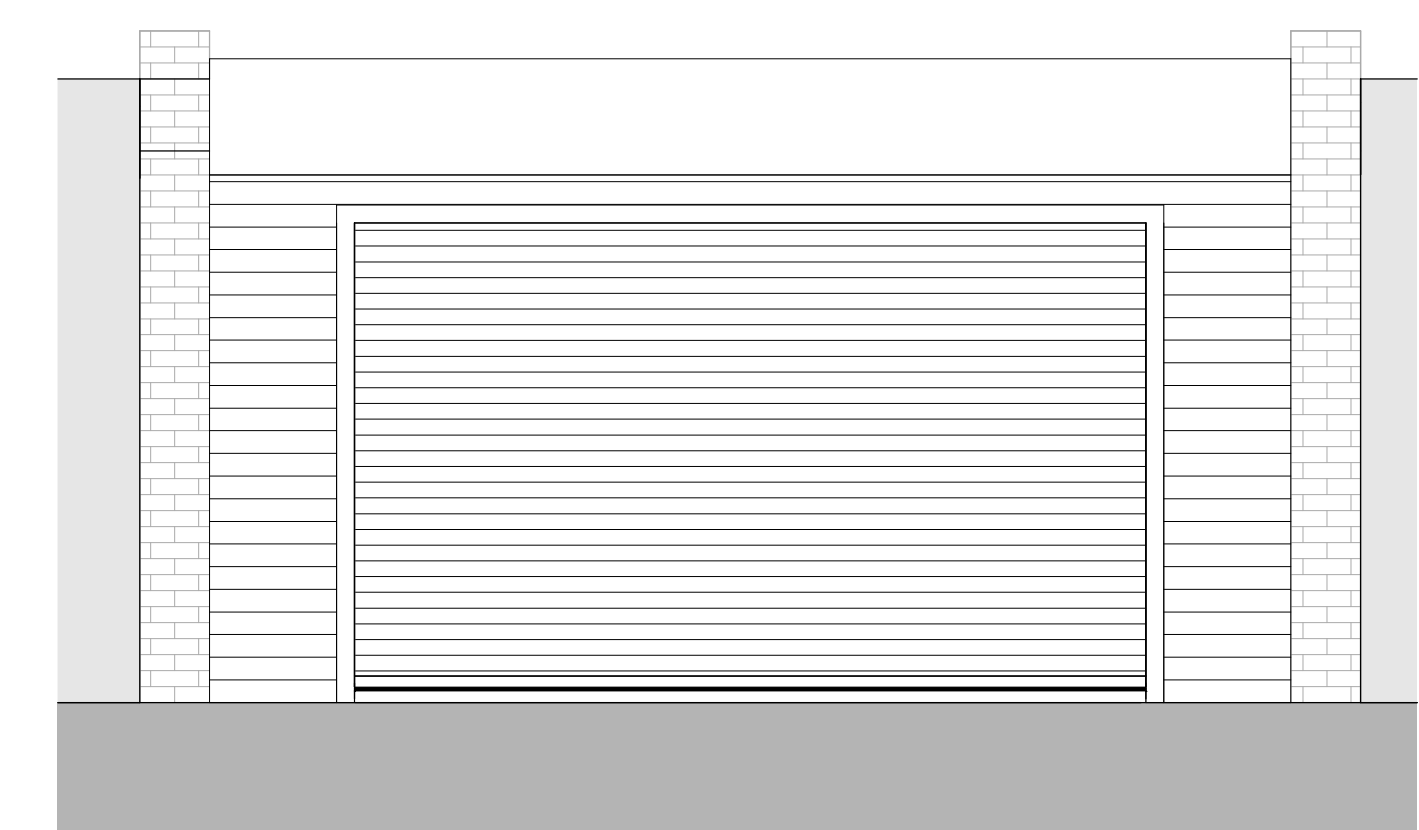


3 EXISTING - REAR GARAGE
3/8" = 1'-0"

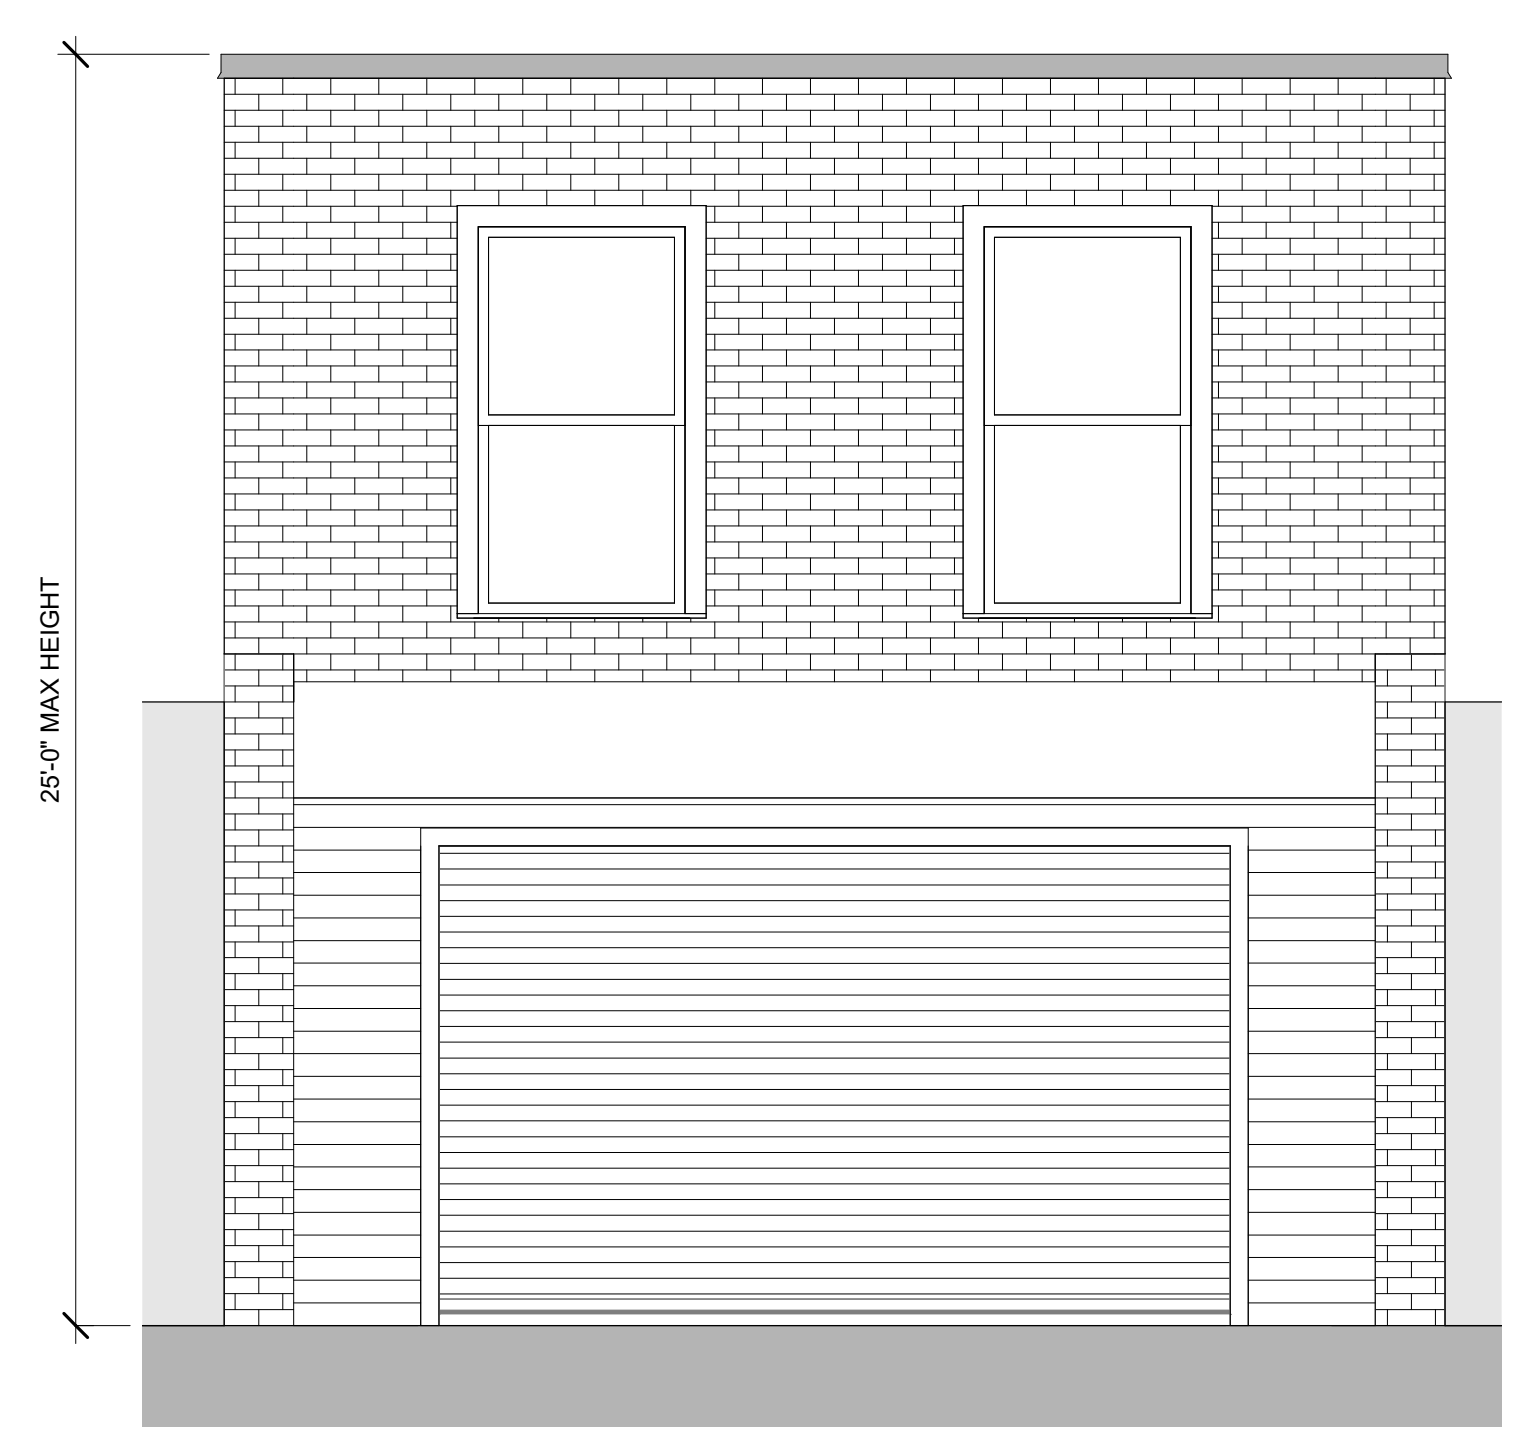


4 PROPOSED - REAR GARAGE
3/8" = 1'-0"

Project Name	Miller Renovation	
Client Name and Address	135 Kentucky Ave SE Washington, DC 20003	
Sheet Number	A200	Sheet Title Elevations

KENTUCKY AVENUE,

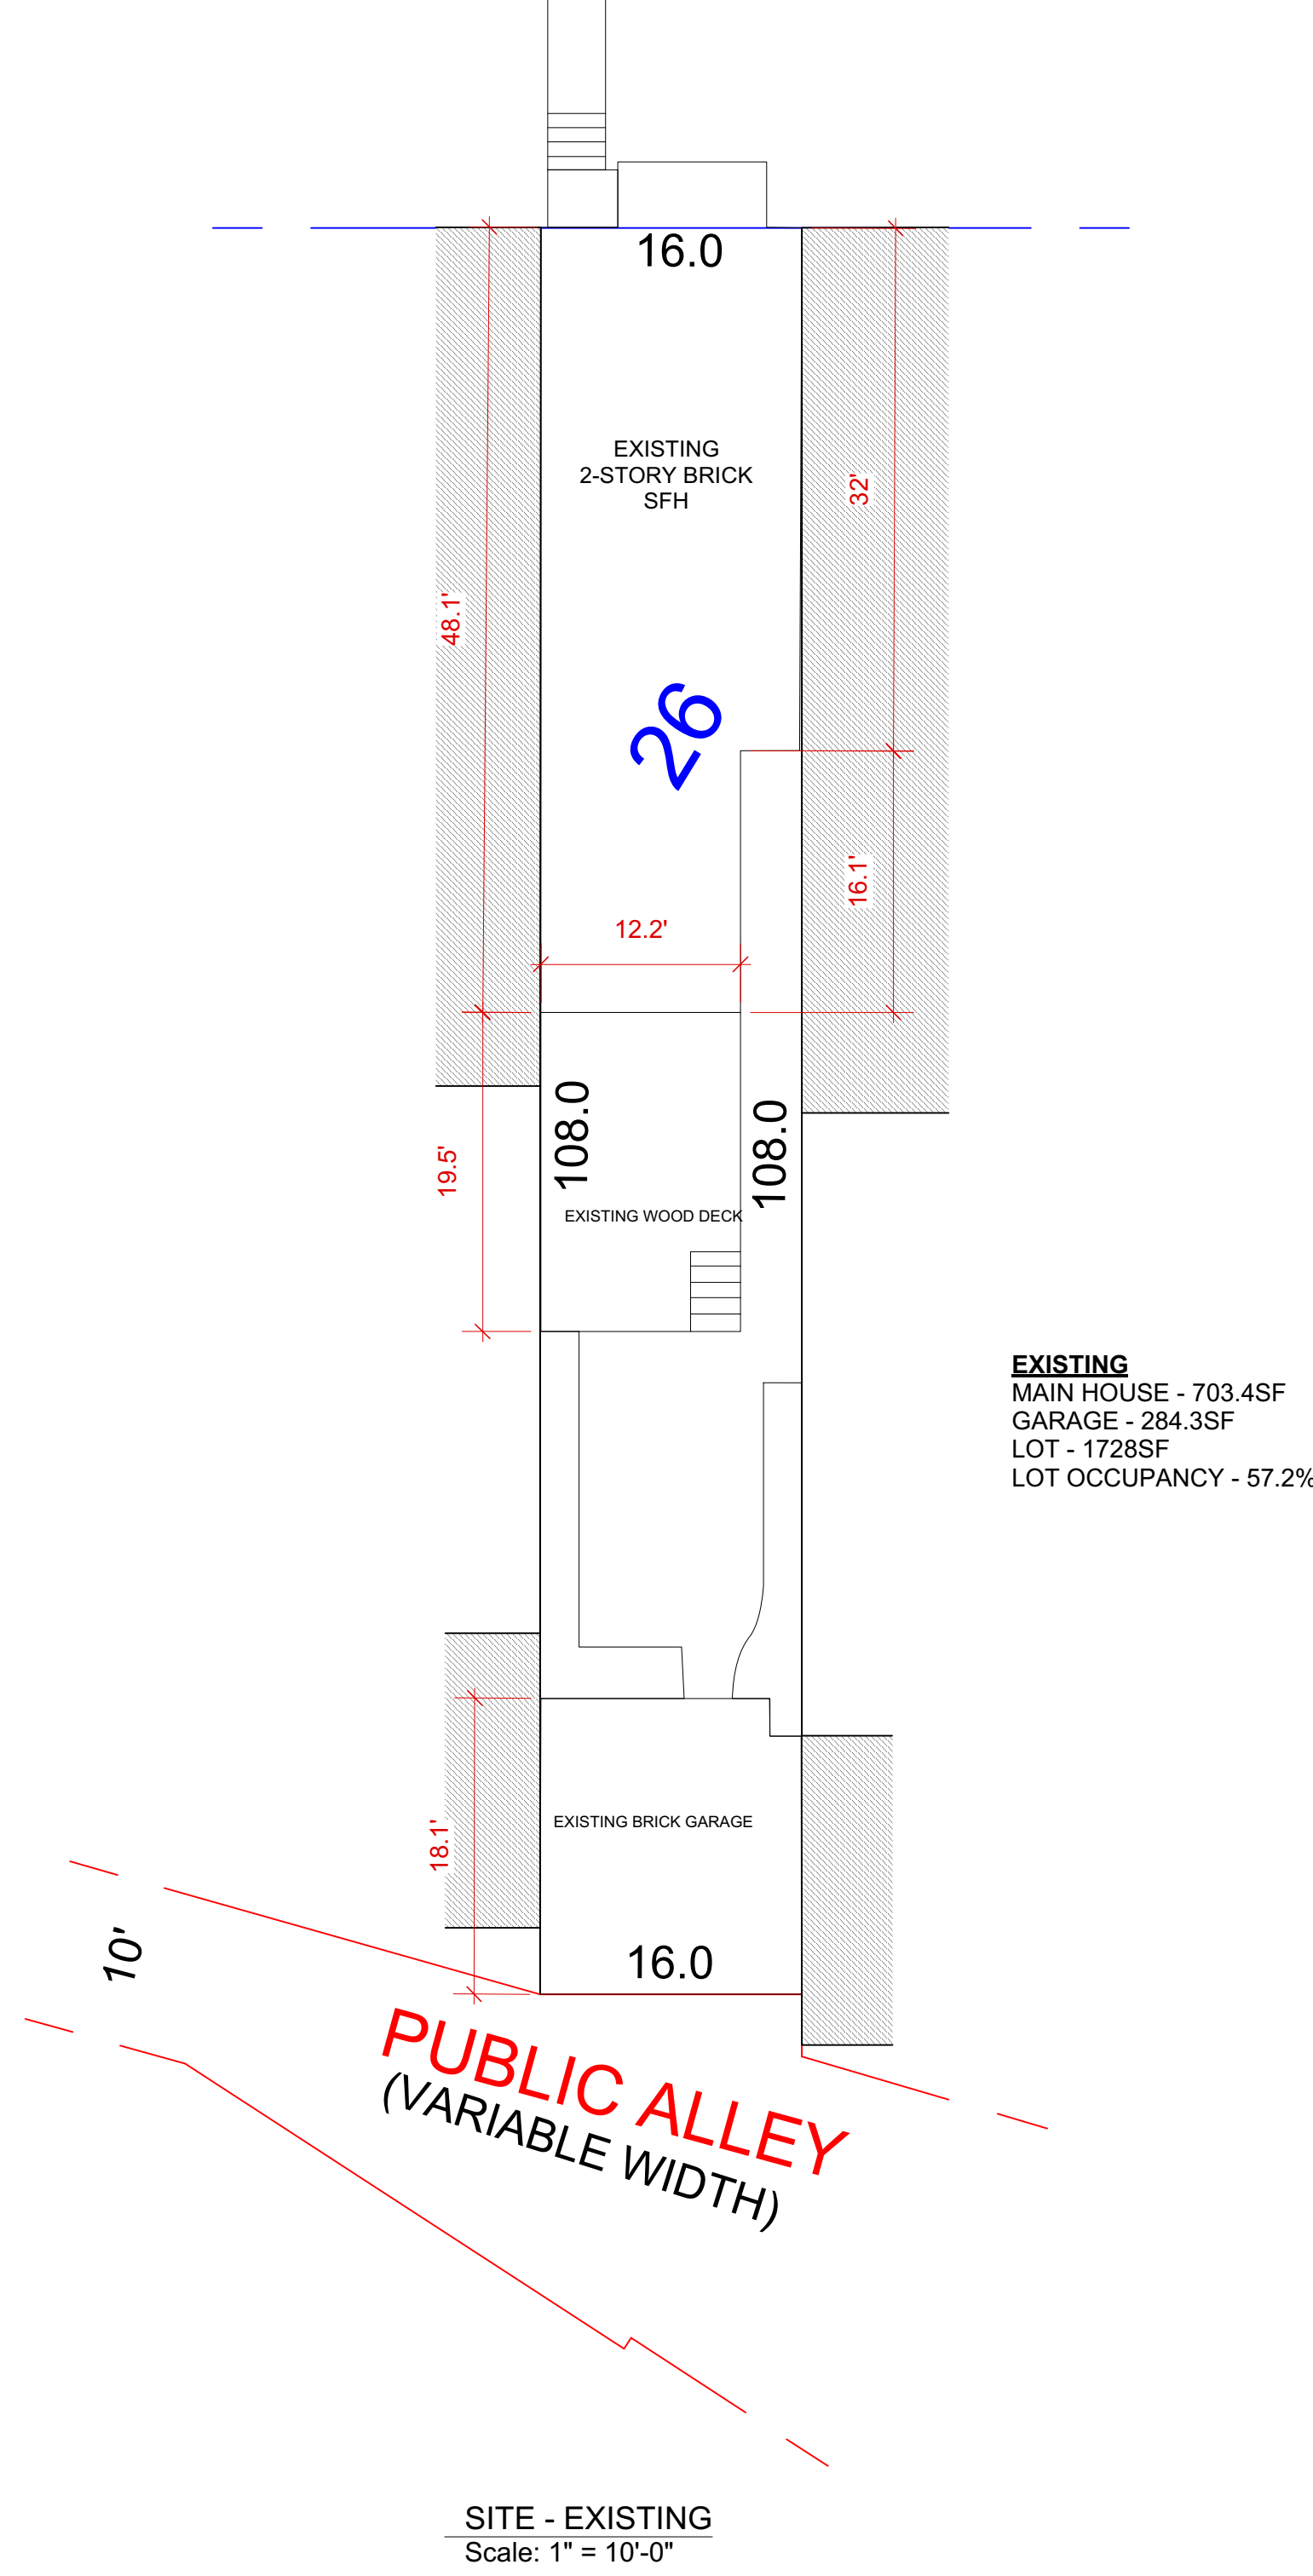

KENTUCKY AVENUE,

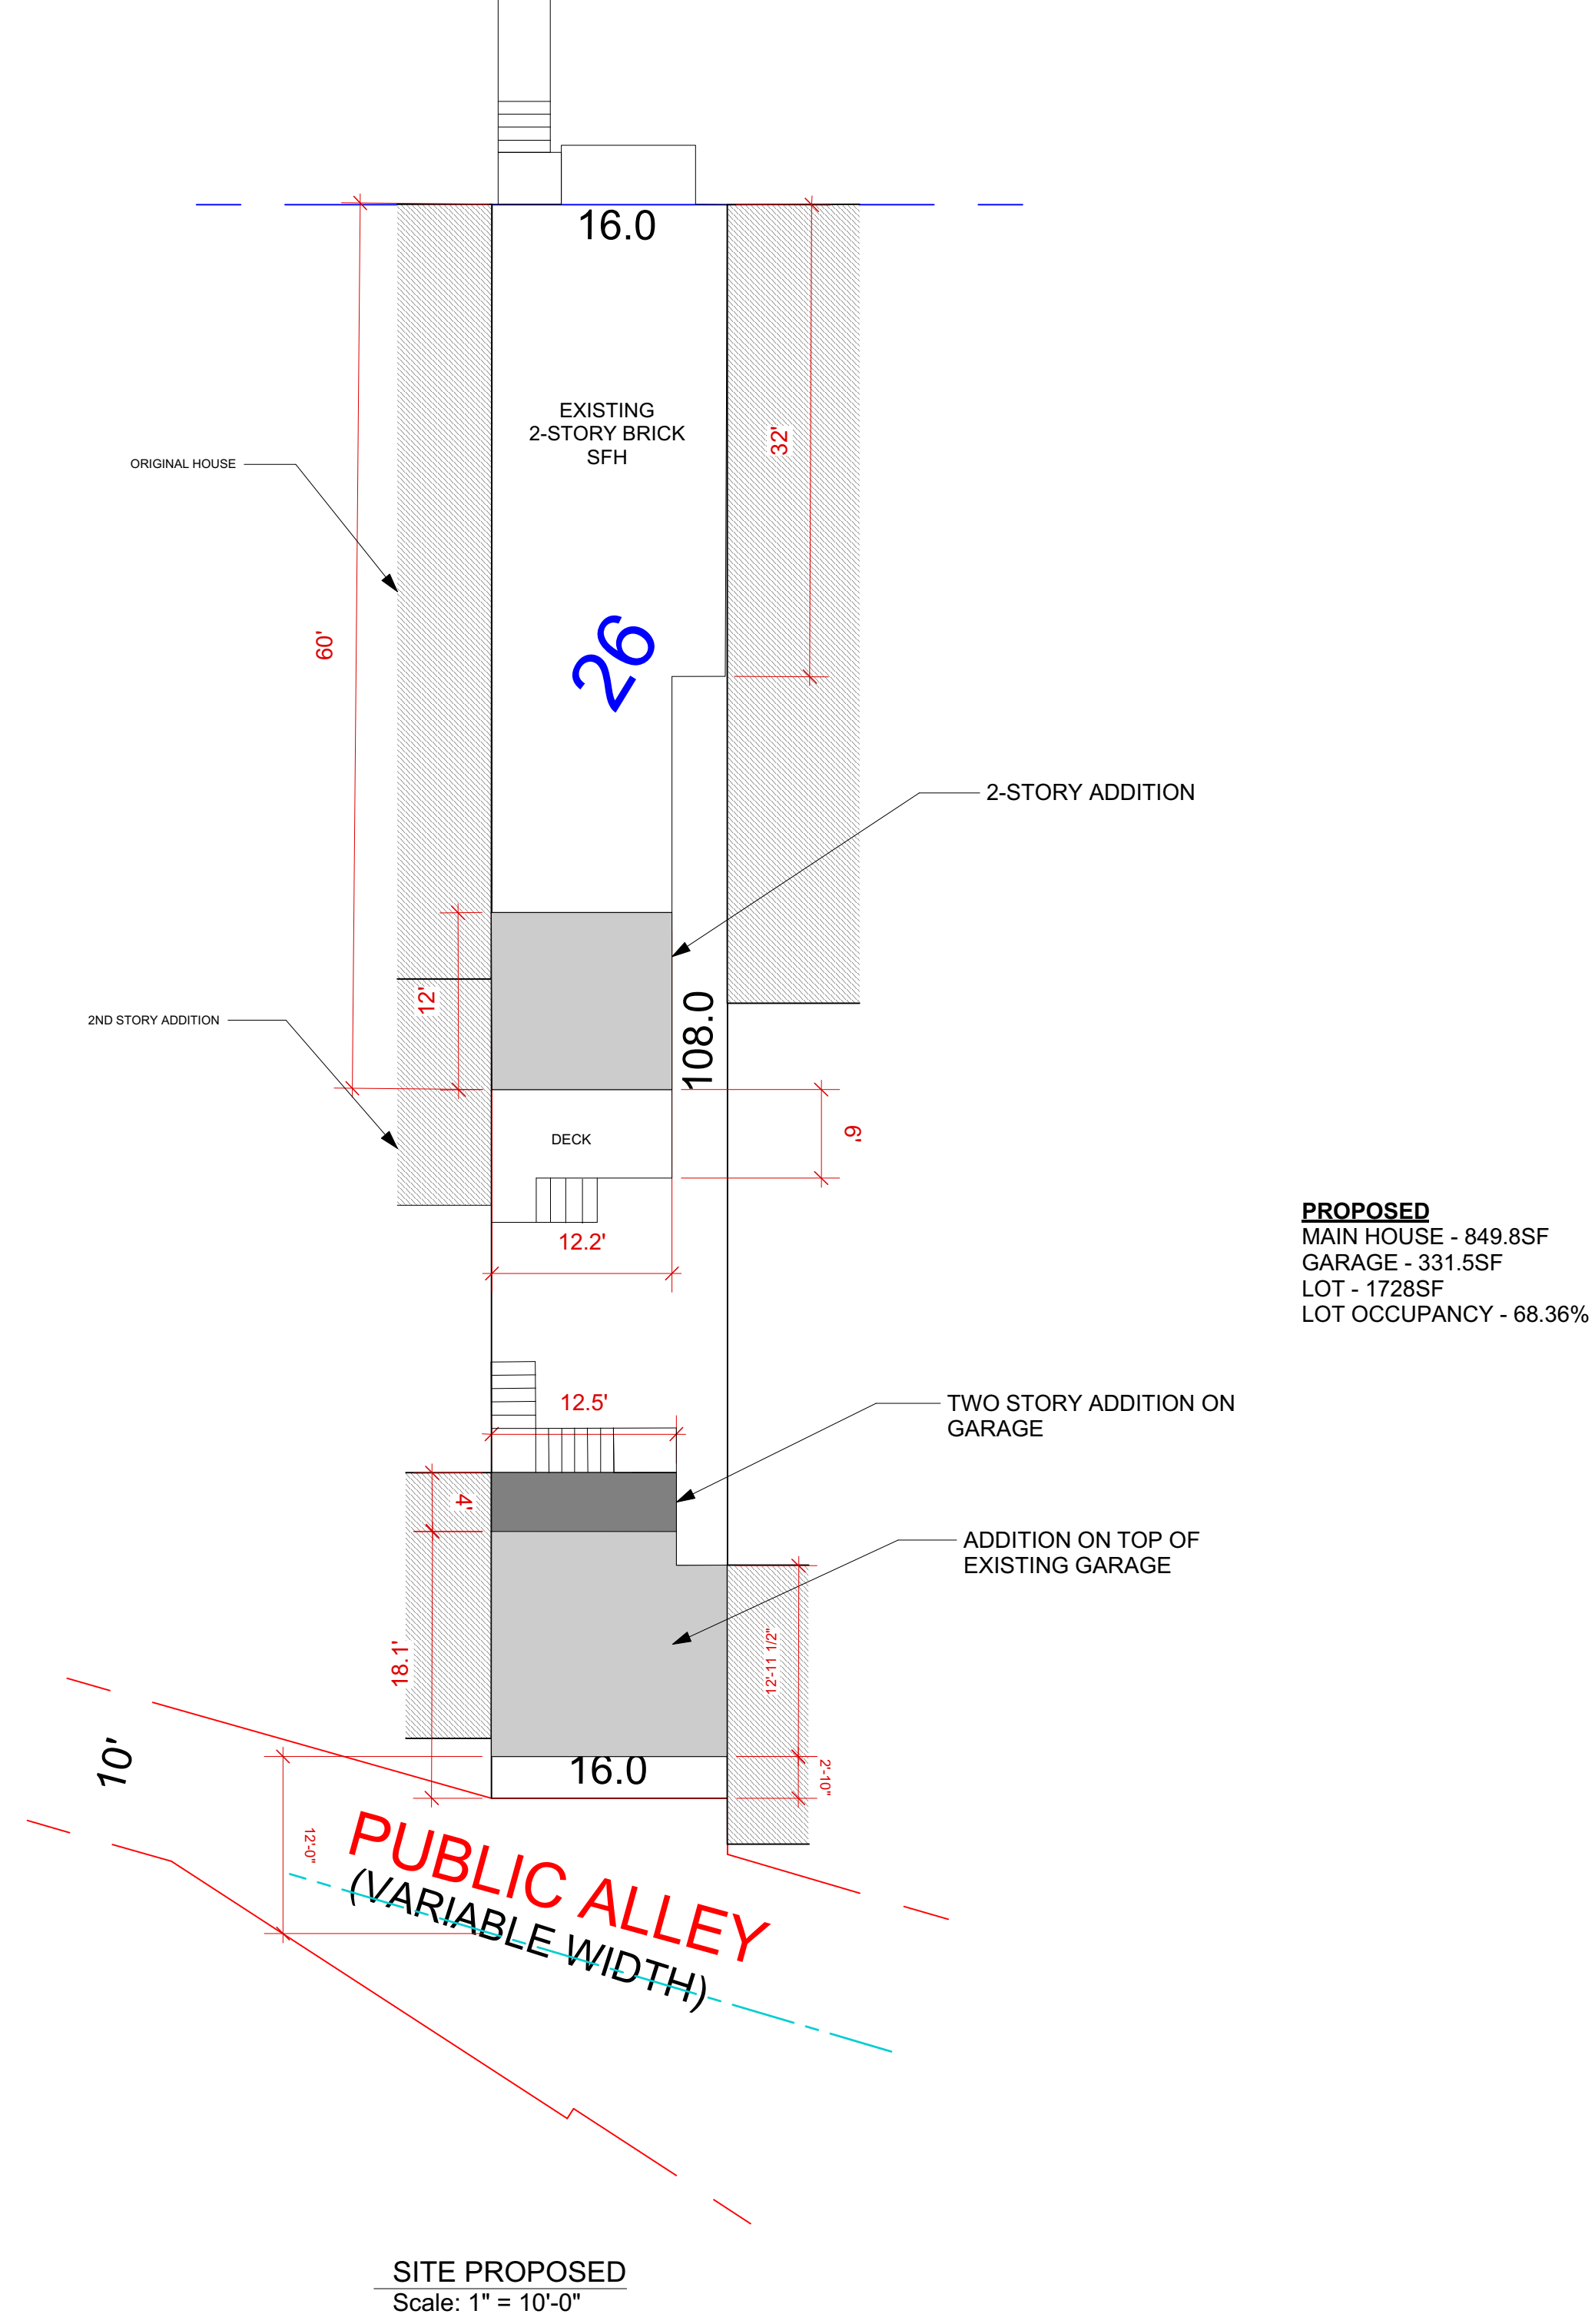

jobi jones llc

3801 GEORGIA AVE NW #305
 WASHINGTON, DC 20011



Project Name	Miller Renovation	
Client Name and Address	135 Kentucky Ave SE Washington, DC 20003	
Sheet Number	C100	Sheet Title SITE