


4237 EADS STREET NE
Washington, DC 20019



REFERENCED PLAN NOTES:

① EXISTING TO REMAIN SPLIT SYSTEM AIR HANDLING UNIT. TYPICAL.	⑧ EXISTING TO REMAIN SUPPLY AIR DUCT FEEDING REGISTERS FLOOR ABOVE. TYPICAL.
② EXISTING TO REMAIN SUPPLY AIR DUCTWORK. TYPICAL.	⑨ EXISTING TO REMAIN CONDENSATE DRAIN PIPING SYSTEM. TYPICAL.
③ EXISTING TO REMAIN SUPPLY AIR REGISTER. TYPICAL.	⑩ EXISTING TO REMAIN KITCHEN EXHAUST SYSTEM. TYPICAL.
④ EXISTING TO REMAIN FULLY RETURN SYSTEM. TYPICAL.	⑪ EXISTING TO REMAIN HOUSEKEEPING PAD MOUNT OUTDOOR UNIT. TYPICAL.
⑤ EXISTING TO REMAIN SWITCH CONTROL CEILING TYPE EXHAUST FAN WITH ASSOCIATED 4" BATHROOM EXHAUST DUCT FROM CEILING EXHAUST FAN TO BUILDING EXTERIOR.	⑫ RE-BALANCE REGISTER AIR AMOUNT TO MATCH THE LOAD. TYPICAL.
⑥ EXISTING TO REMAIN DRY VENT SYSTEM. TYPICAL.	⑬ EXISTING TO REMAIN OUTDOOR AIR DUCT FORM BUILDING EXTERIOR. TYPICAL.
⑦ EXISTING TO REMAIN WALL MOUNTED PROGRAMMABLE HEATING AND COOLING THERMOSTAT. TYPICAL.	⑭ ROUTE 8" OUTDOOR AIR DUCT WORK FORM BUILDING EXTERIOR. PROVIDE DUCT WORK WITH MOTORIZED DAMPER.
	⑮ ROUTE 10" OUTDOOR AIR DUCT WORK FORM BUILDING EXTERIOR. PROVIDE DUCT WORK WITH MOTORIZED DAMPER.

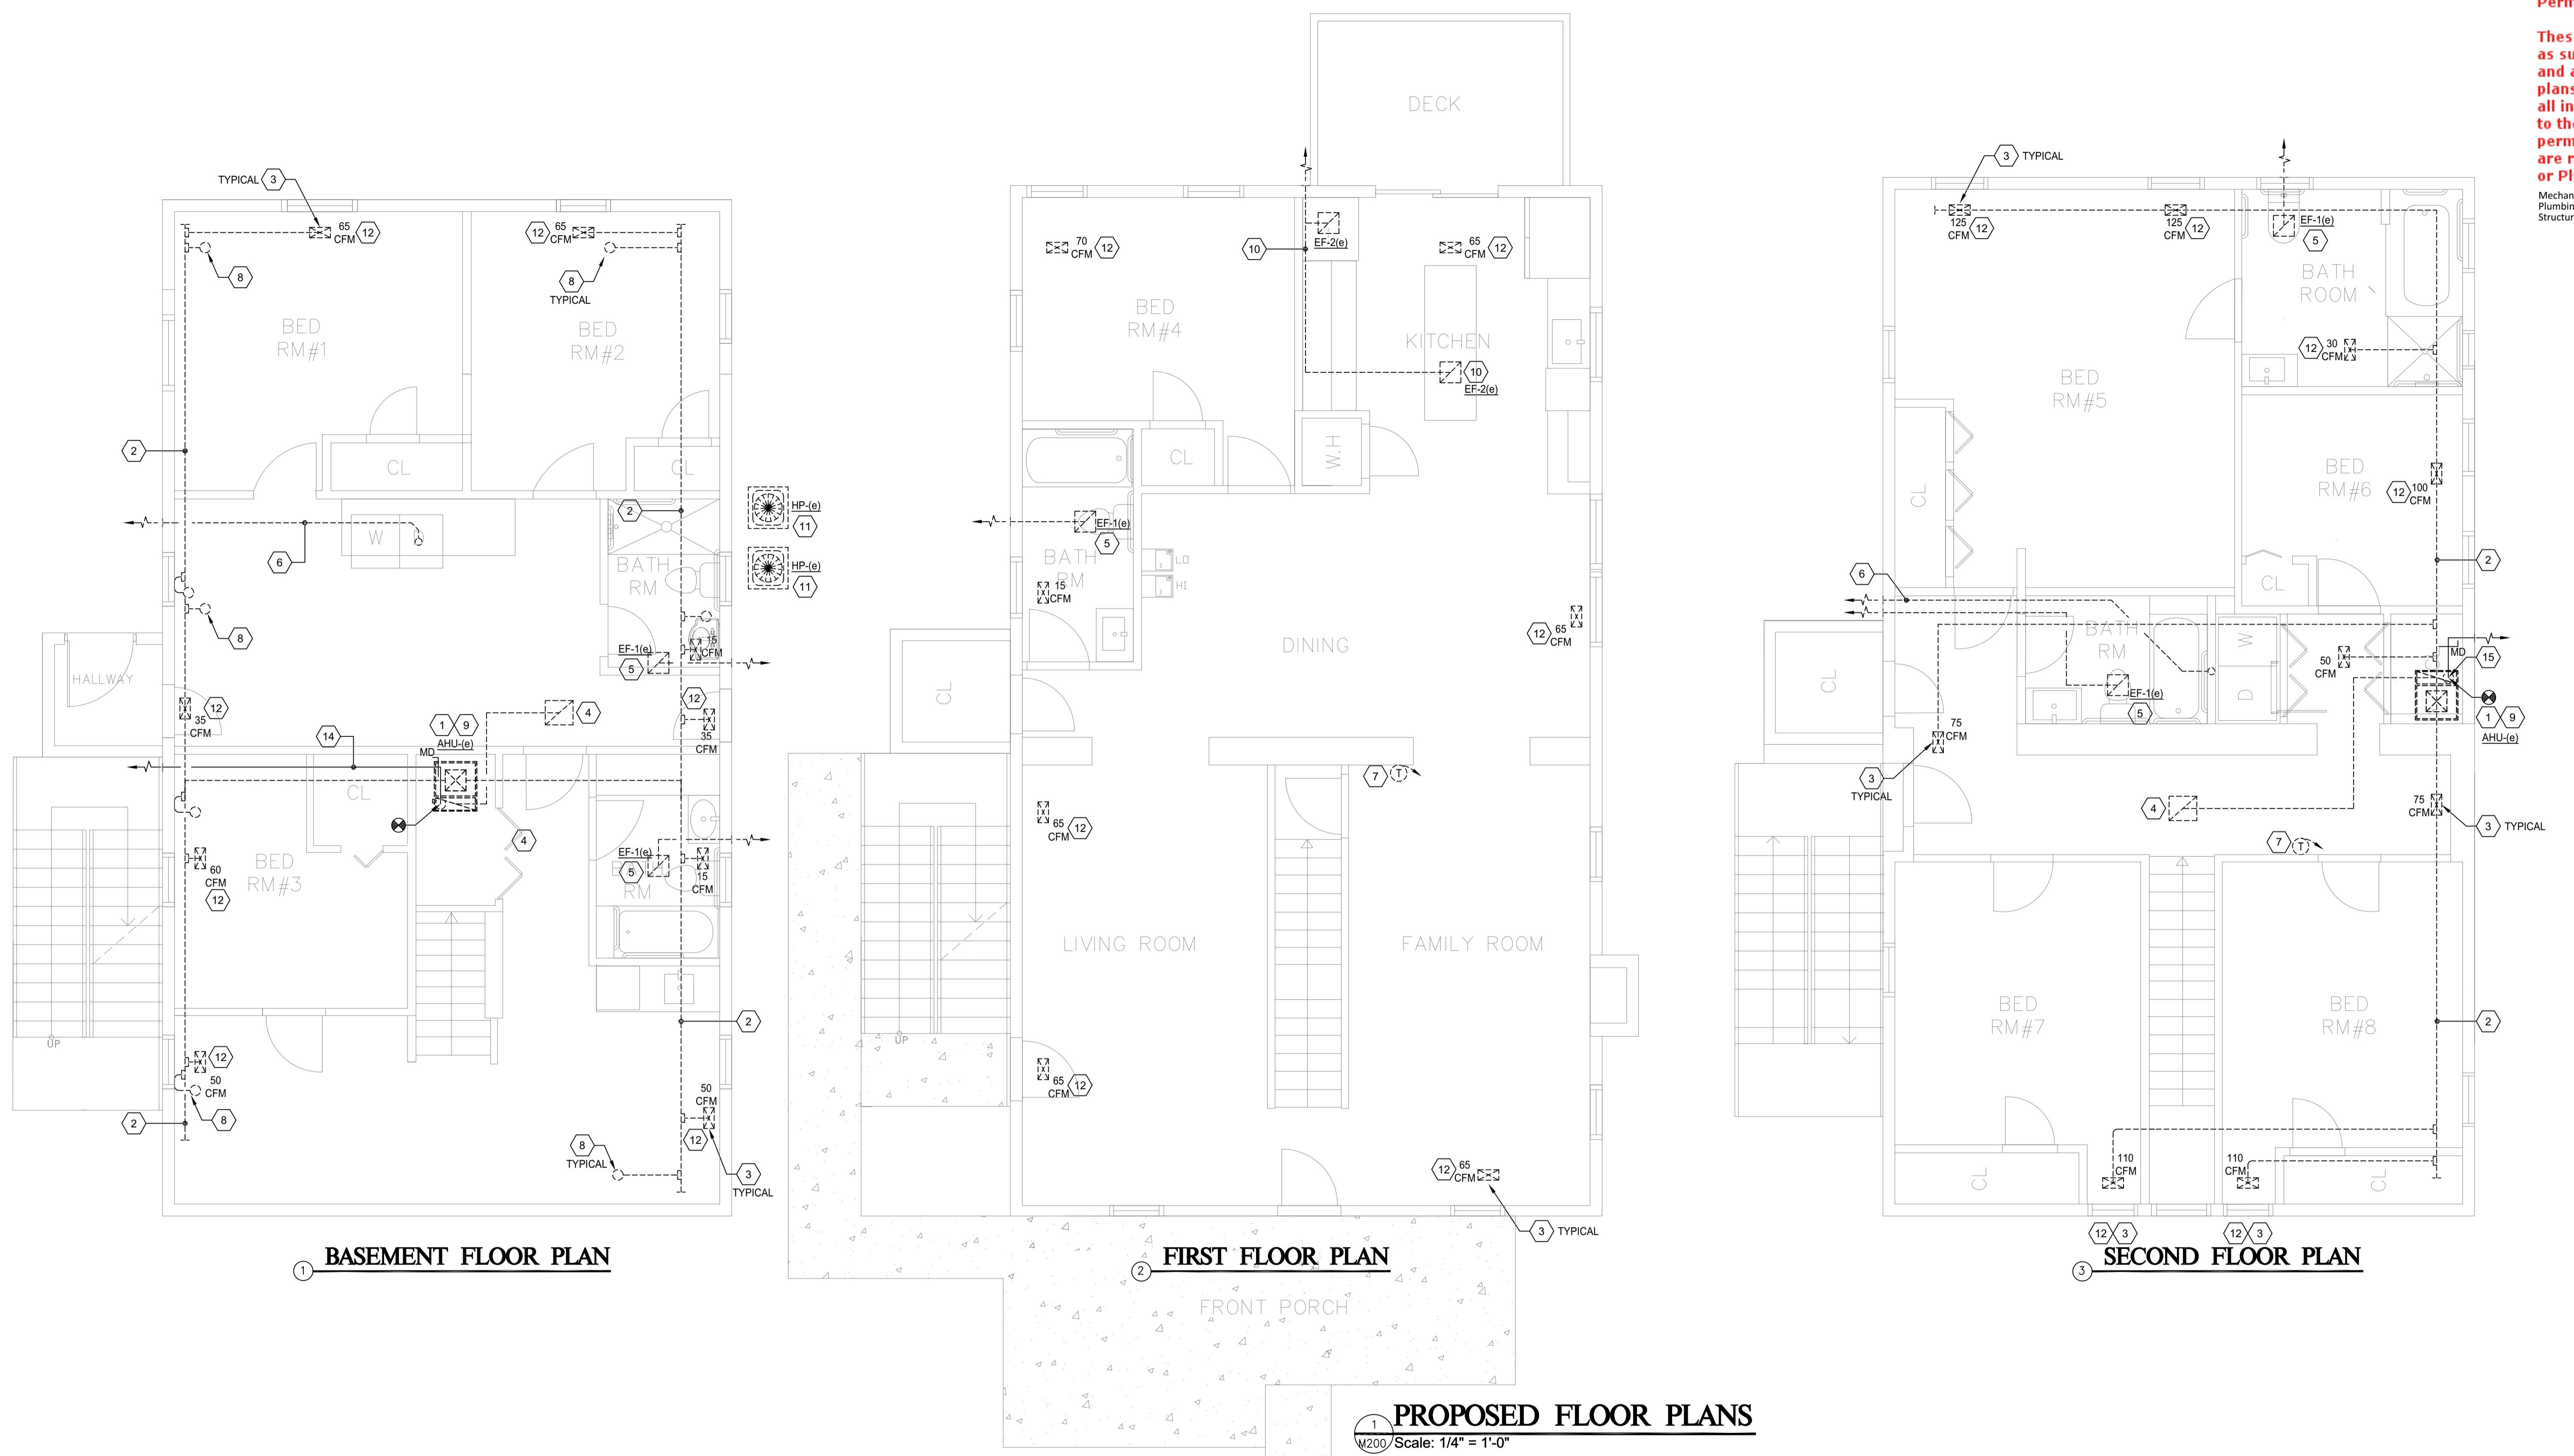

Professional Certification.
I certify that these documents were prepared or approved by me, and that I am a duly licensed engineer under the laws of the District of Columbia.

DRAWN BY:


CHECKED BY:

PROJECT NO.:


SHEET NO.:

M200


Board of Zoning Adjustment
District of Columbia
Case No. 21790
EXHIBIT NO. 1

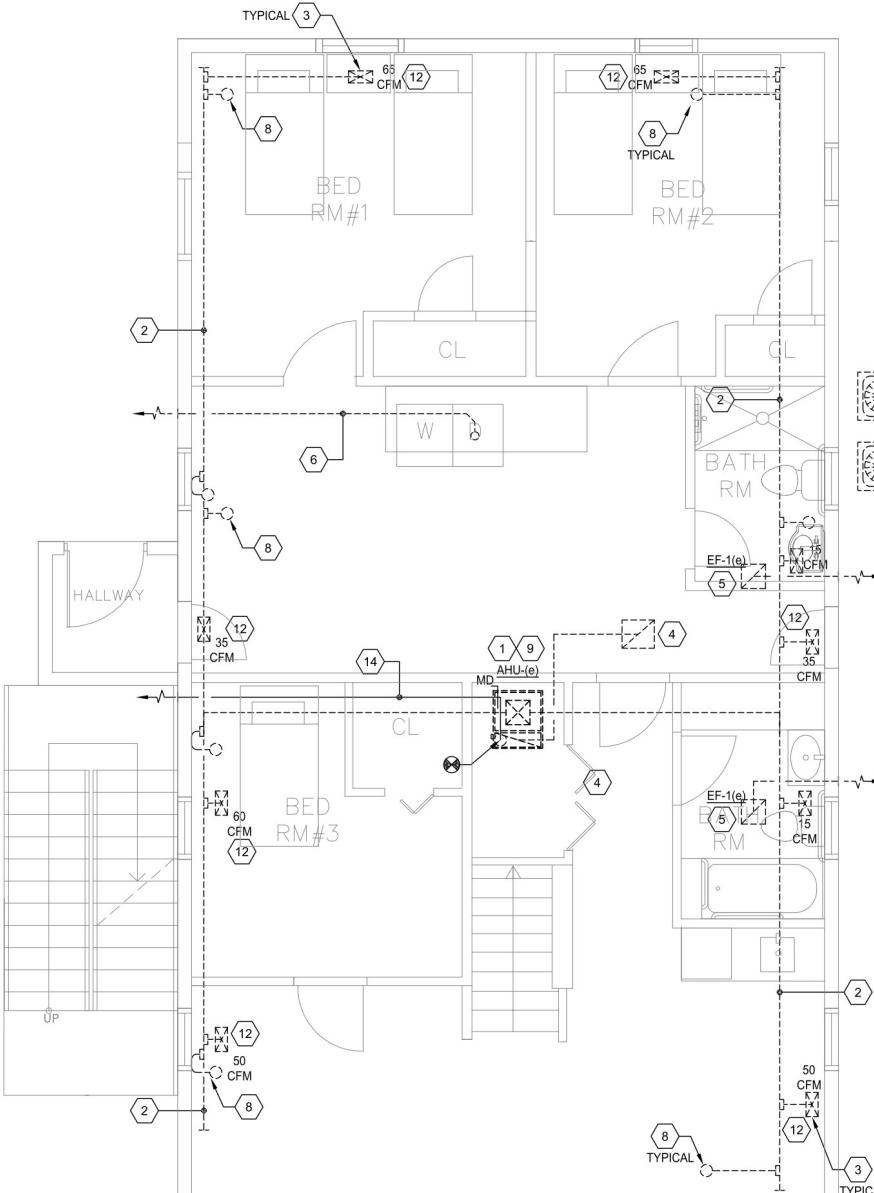

① **BASEMENT FLOOR PLAN**

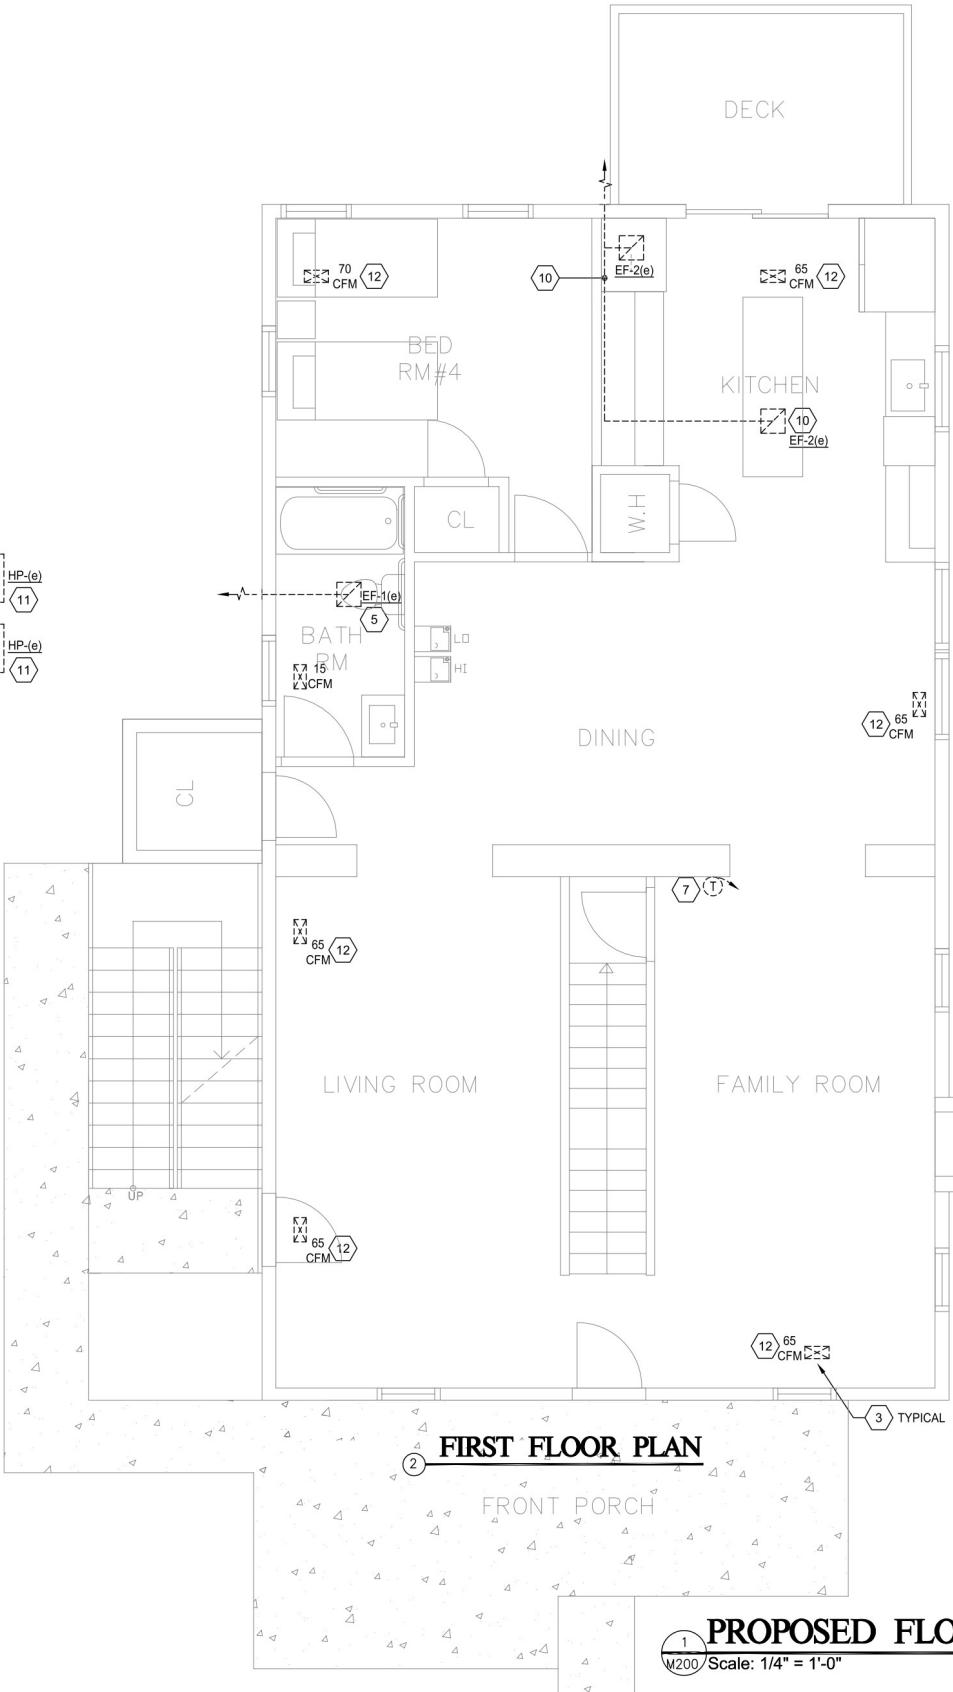

② **FIRST FLOOR PLAN**

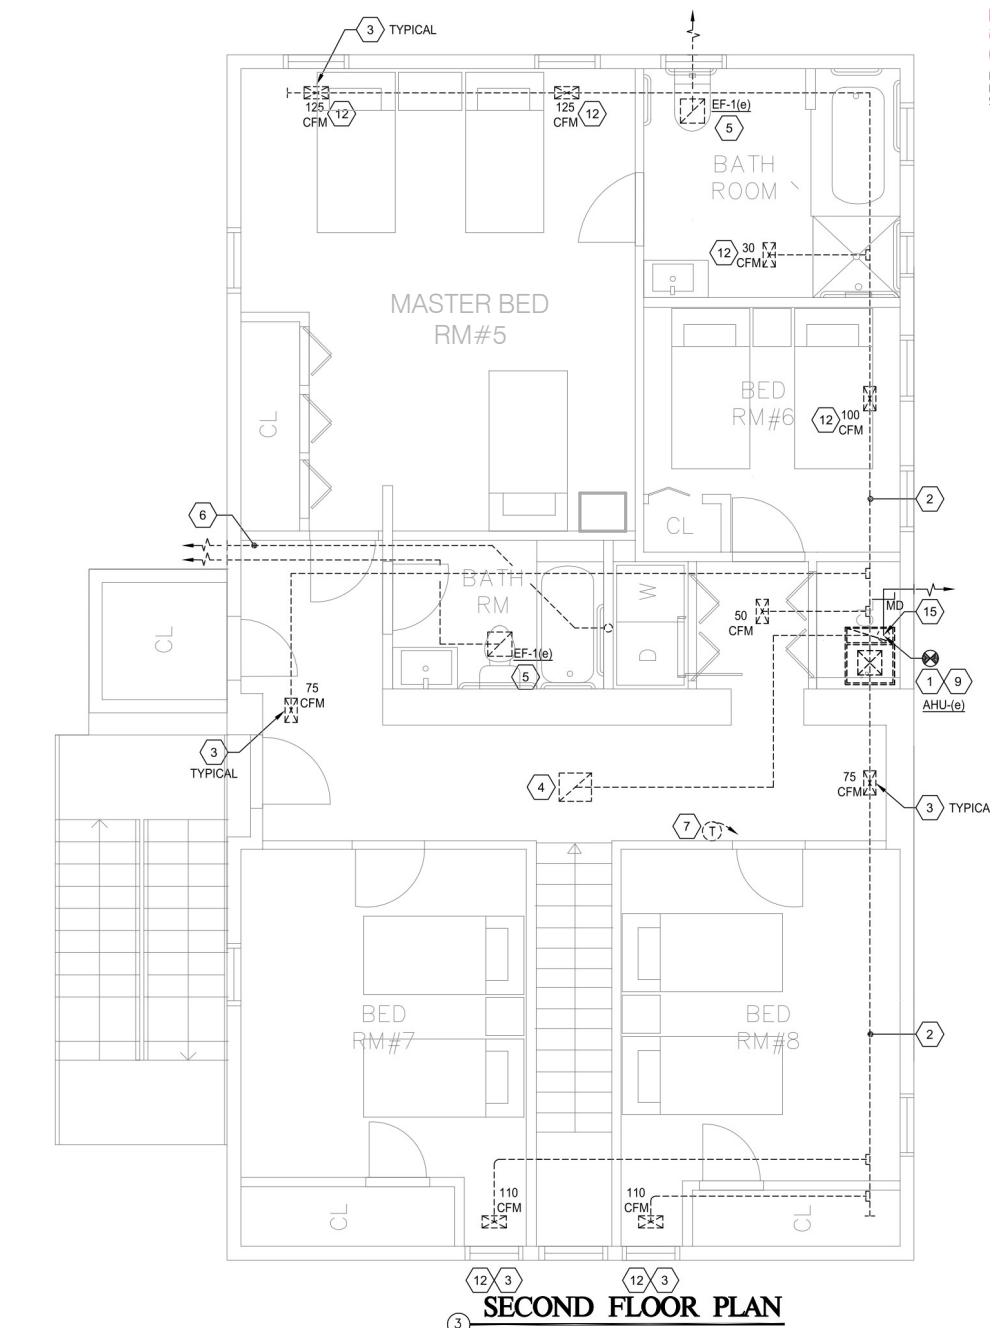

③ **SECOND FLOOR PLAN**

① **PROPOSED FLOOR PLANS**
M200 Scale: 1/4" = 1'-0"